

SECTION 009111 - ADDENDUM NUMBER 1

PARTICULARS

- 1.1 DATE: JANUARY 29, 2026**
- 1.2 PROJECT: SHERIDAN PUBLIC LIBRARY BUILDING ADDITION, RENOVATIONS & SITE IMPROVEMENTS**
- 1.3 PROJECT NUMBER: 25050**
- 1.4 OWNER: SHERIDAN PUBLIC LIBRARY, 103 W 1ST STREET, SHERIDAN, IN 46069**
- 1.5 ARCHITECT: ODLE MCGUIRE SHOOK MATTHEW R. MAYOL #IN19900090**



Matthew R. Mayol

TO: PROSPECTIVE BIDDERS:

- 2.1 THIS ADDENDUM FORMS A PART OF THE CONTRACT DOCUMENTS AND MODIFIES THE ORIGINAL PROCUREMENT DOCUMENTS DATED JANUARY 15, 2026, WITH AMENDMENTS AND ADDITIONS NOTED BELOW.**
- 2.2 ACKNOWLEDGE RECEIPT OF THIS ADDENDUM IN THE SPACE PROVIDED IN THE BID FORM. FAILURE TO DO SO MAY DISQUALIFY THE BIDDER.**
- 2.3 THIS ADDENDUM CONSISTS OF 16 PAGES AND THE FOLLOWING DRAWINGS: G000, C0.0, C0.1, C0.6, C0.7, DA101, A101, A102, A201, A202, A401, AI101, AI102, F101, F102, MD101, E001, E102, E103, E301, E302.**
- 2.4 GENERAL:**
 - A. There were Pre-Bid meetings held on January 22, 2026 and January 28, 2026. Copies of the Pre-Bid Sign-In-Sheets are attached to this Addendum and are for reference only.**
 - B. If an alternative site visit date is needed, Bidders may contact the Library directly for a site visit of the common (public) areas of the building during regular business hours by contacting Library Director Kim Riley (317) 758-5201. Please contact the Architect Matt Mayol directly if you need assistance accessing the non-public (service or utility) areas of the building (317) 408-9566, mmayol@omscorp.net.**
 - C. Please note that Heritage Painting had previously provided a painting quote directly to the Owner and has expressed an interest in the work. Contact is: Jason (317) 349-9181, jason@heritagecustompainting.com.**

Sheridan Public Library Building Addition,
Renovations & Site Improvements

D. Bidder questions are as follows:

1. Q: Is there a minority MBE requirement on this Project?
 - a. A: No
2. Q: Can you share Planholder lists?
 - a. A: Yes. Planholder lists will be added for reference only (and updated periodically) at the following link:
 - 1) <https://omscorp.sharefile.com/d-s9bee36bb174e496eb0d6e4460fff23d3>
3. Q: Will the Library permit after hours work?
 - a. A: Yes, but the Library will not have a representative on-site after hours so the Contractor will take full responsibility.
4. Q: Is the scope of work on Drawings F102 and F102 by the General Contractor?
 - a. No, these Drawings have been included for reference only. The Library materials, shelving, furniture and loose equipment move management is by others and the Owner's Consultant will coordinate and facilitate moving efforts with the Contractor's Construction Schedule.
5. Q: Can the Library close for three (3) days for the Parking Lot resurface & striping.
 - a. A: Yes, the Library can be flexible and close for three (3) days to accommodate the Parking Lot work.
6. Q: Can the quarter round stay for the carpet replacement?
 - a. A: It will be Contractor's Option for the quarter round to stay but an Allowance to replace quarter round will be forthcoming in a later Addendum.
7. Q: Should the sloping HVAC Pads on the north west area near the new addition be replaced as a part of the scope of work?
 - a. A: Yes, reference same in this Addendum.
8. Q: Should the roof decking thickness match the existing?
 - a. A: Yes, this is clarified in this Addendum and a Unit Price for damaged decking will be forthcoming in a future Addendum.
9. Q: Will you consider an Allowance figure for Drywall patch and repair to assure a quality finish and paint job?
 - a. A: Yes. An Allowance will be forthcoming in a future Addendum.
10. Q: Will the Restroom floor drains be demolished and replaced with new adjustable height drains to accommodate the new floor install?
 - a. A: Yes. This will be forthcoming in a future Addendum.
11. Q: Has the Engineer of Record contacted the Gas Company to schedule the meter to be relocated or replaced?

Sheridan Public Library Building Addition,
Renovations & Site Improvements

- a. A: The Engineer of Record will be working on this once we have a construction schedule that would dictate when the the wall of the Addition will be in place to install the meter.
12. Q: Are there any previaling wage requirements?
 - a. A: No, to the best of the Architect's knowledge, for public contracts awarded after July 1, 2015, state or local governments cannot require a prevailing wage schedule for public works unless federal or other state law says otherwise.
13. Q: Do you know what the existing brick is? Did you specify the new brick?
 - a. A: Yes, reference the Masonry Specifications for the closest brick match we have been able to find. The original brick has reportedly been discontinued so please suggest any brick you feel may be a closer match
 - 1) Field Brick: Bostonian Modular Flash by Brickcraft or approved equal. Design intent is to match similar to Glen-Gery Aberdeen with natural gray colored mortar.
 - 2) Accent Brick: Bostonian Modular Flash (Dark Red) by Brickcraft, or approved equal. Design intent is to match simiar to existing Glen-Gery Crimson Point.
14. Q: What is the Phasing Plan for the Project and is there flexibility regarding what areas get renovated in what order?
 - a. A: Yes, there is flexibility. Refer to Specification Section 011100-Summary of Work and Drawing G005 Phasing Plan.
15. Q: Can the Library endure some construction noise related to the reroofing?
 - a. A: Yes. Refer to Div 1 Specifications for more details.
16. Q: Will there be any permit fees?
 - a. A: To the best of the Architect's knowledge permits are required but the fees should be waived since this is a publicly funded Project.
17. Q: Is Elwood the local fire department?
 - a. A: Yes.
18. Q: Please clarify if 120V is required for the smoke detectors?
 - a. A: This has been addressed in this Addendum.
19. Q: Is there a water shut off valve or isloation valve?
 - a. A: Yes, the existing Drawings will be provided for refernece at this ShareFile link: <https://omscorp.sharefile.com/d-s9bee36bb174e496eb0d6e4460fff23d3>
20. Q: Verify if the electrican provides the Data Cabling Y/N?
 - a. A: No, just provide conduit and pull string and the Owner's Data Consultant will pull the data cabling.
21. Q: Where can I find the Handicapped Accesible door acuator infomation?
 - a. A: Reference Specification Section 87113-Power Door Operators.
22. Q: Please clairify if EPDM vs TPO is a Contractor's Option?

Sheridan Public Library Building Addition,
Renovations & Site Improvements

- a. A: Yes. Either system is acceptable and can be found in the written Specifications for the Project.
23. Q: Are lighting substitutions acceptable?
 - a. A: Yes. Please submit alternatives per Specification Section 002244-Bidder's Substitution Request Form.
24. Q: Do the gutters and downspouts get replaced in the Roofing Alternate?
 - a. A: Yes, include new gutters, downspouts and edge metal as a part of the Roofing Alternate #2. The design intent is to have 100% new roof and warranty with this Alternate.
25. Q: It is difficult to see existing conditions with snow on the ground so can you provide some photos?
 - a. A: Yes, see existing photos at this link:
<https://omscorp.sharefile.com/d-s0e588c00a4c1462aa3a8262cde08ae52>
26. Q: Do you know what the original roof shingle is?
 - a. A: The O&M Manual for the Project says Oakridge Pro 30 AR Shingles Estate Gray Provided by T.F. Rainbow Inc. Commercial & Industrial Roofing. Prefinished aluminum drip edge metal Wilco Supply color Linen, .019 Prefinished aluminum soffit panels, prefinished aluminum fascia board wrap and a 6" ogee .027 prefinsihed aluminum gutter. Decking has ice and water shield 3' from all gutter edges and in valleys with GAF Shingle Mate felt paper over entire roof +30 year O.C. Pro 30 Shingles.

3.1 CHANGES TO PRIOR ADDENDA: NONE

CHANGES TO THE PROJECT MANUAL - SPECIFICATIONS:

4.1 SECTION 000010-TABLE OF CONTENTS

- A. Delete 072726-Fluid Applied Air Barriers

4.2 SECTION 000105-CERTIFICATIONS PAGE-ADD-1

- A. Replace Certifications Page in it's entirety to properly read:
 1. OWNER: SHERIDAN PUBLIC LIBRARY, 103 W 1ST STREET, SHERIDAN, IN 46069

4.3 SECTION 048100-UNIT MASONRY ASSEMBLIES

- A. 2.3.C.7 Change the accent brick color to read "Design intent is to match simiar to existing Glen-Gery Crimson Point"

4.4 SECTION 072726-FLUID APPLIED AIR BARRIERS

- A. Delete this Section in it's entirety and refer to Section 061600-Sheathing for Air Infiltration Barrier.

4.5 SECTION 123400-PLASTIC LAMINATE FACED CASEWORK-ADD-1

- A. PART 2 - PRODUCTS 2.1 MANUFACTURERS:

1. Add Fredericks, Inc., www.fredericksinc.com, (765) 778-7588

CHANGES TO DRAWINGS:

5.1 G000 COVER SHEET

- A. Refer to revision triangle 1.
- B. Add the following sheets to the Drawing Index.
 - 1. E102 ELECTRICAL LIGHTING CONTROL PLAN
 - 2. E103 ELECTRICAL LIGHTING CONTROL RISER DIAGRAM
 - 3. E301 SITE LIGHTING PLAN
 - 4. E302 SITE POWER PLAN

5.2 C0.0 COVER SHEET, C0.1 GENERAL NOTES, C0.6 SWPPP DETAILS, C0.7 SWPPP DETAILS

- A. Refer to revision triangle 1.
- 1. Date changed to correctly reflect sheet issue date.

5.3 DA101 FIRST FLOOR DEMO PLAN

- A. Refer to revision triangle 1.
- 1. Added note 37. (Relocate built in bookshelf to children's area 120 by GC.)

5.4 A101 FIRST FLOOR PLAN

- A. Refer to revision triangle 1.
- 1. Added note 20. (Reinstall bookshelf from Indiana history 107. Connect power in shelf base. Ref 'E' series dwgs.)

5.5 A102 FIRST FLOOR RCP

- A. Refer to revision triangle 1.
- 1. Added note 11 to a decorative pendant.

5.6 A202 INTERIOR ELEVATIONS, ELEV. KITCHEN NORTH

- A. Refer to revision triangle 1.
- 1. Altered casework configuration

5.7 A401 WALL SECTION

- A. Refer to revision triangle 1.
- 1. Revise OSB roof deck thickness to 19/32"

5.8 AI101 FIRST FLOOR FINISH PLAN

- A. Refer to revision triangle 1.
- 1. Added plan note 9. (Provide 48"x48"x1/4" thick solid surface (SS-2) back for drinking fountain. Center to drinking fountains. eased edge. Translucent sealant around perimeter.)

5.9 AI102 FINISH LEGEND

- A. Refer to revision triangle 1.
- 1. Added Solid Surface "SS-2" to finish legend.

5.10 F101 EXISTING FURNITURE & SHELVING PLAN

- A. Refer to revision triangle 1.

Sheridan Public Library Building Addition,
Renovations & Site Improvements

1. Added note to sheet: (This drawing is included to the general contractor for reference only. Library materials, shelving, loose furniture and equipment will be moved by owner provided consultant in combination with the general contractor's construction schedule. UNO.)
2. Altered plan note 6 to read: (Assemble bookshelf from owner provided surplus shelving located in Mezzanine 200.)
3. Added note 7. (Relocate built in bookshelf to Children's Area 120 by GC.)

5.11 F102 NEW FURNITURE & SHELVING PLAN

- A. Refer to revision triangle 1.
 1. Added note to sheet: (This drawing is included to the general contractor for reference only. Library materials, shelving, loose furniture and equipment will be moved by owner provided consultant in combination with the general contractor's construction schedule. UNO.)
 2. Altered plan note 6 to read: (Assemble bookshelf from owner provided surplus shelving located in Mezzanine 200.)
 3. Added note 8. (Reinstall bookshelf from Indiana History 107. Connect power in shelf base. Ref 'E' series dwgs.)

5.12 MD101 MECHANICAL DEMOLITION PLAN & M101 MECHANICAL PLANS

- A. Refer to Revision Triangle 1.
 1. Remove existing damaged equipment pads and replace with new.

5.13 E001 UPDATE DRAWING INDEX

5.14 E002 ADD DETAIL H TYPICAL DATA OUTLET ROUGH IN

5.15 E005 MODIFICATIONS TO PANEL SCHEDULE

5.16 ED101 ADD EXTERIOR LIGHTING NOTES

5.17 E101 LIGHTING REVISIONS

5.18 ADD SHEET E102

5.19 ADD SHEET E103

5.20 E104 REFERENCE REVISION TRINAGLE 1 FOR CHANGES

5.21 ADD SHEET E301

5.22 ADD SHEET E302

END OF SECTION

1/22/26

PRE-BID CONFERENCE SIGN IN SHEET

NAME: Josh Burns
COMPANY NAME: SUN Electric, Inc
PHONE: 812-350-4004
EMAIL: JBurns@sunelectricinc.net

NAME: Mike Davidson
COMPANY NAME: GILLIATTS
PHONE: 317-910-1435
EMAIL: M.Davidson@Gilliatts.com

NAME: Mike Duncan
COMPANY NAME: Hearn Construction, Inc.
PHONE: 765-461-9543
EMAIL: mduncan@hcibuilt.com

NAME: _____
COMPANY NAME: _____
PHONE: _____
EMAIL: _____

NAME: _____
COMPANY NAME: _____
PHONE: _____
EMAIL: _____

NAME: _____
COMPANY NAME: _____
PHONE: _____
EMAIL: _____

NAME: _____
COMPANY NAME: _____
PHONE: _____
EMAIL: _____

1/22/26

NAME: Trace Harruff
COMPANY NAME: CDI, Inc.
PHONE: (812) 232-3327 (office) 812-240-1033 (cell)
EMAIL: estimating@cdiinc.net

NAME: KYLE HARRUFF
COMPANY NAME: CDI, Inc.
PHONE: 812-264-6003 (cell)
EMAIL: KHARRUFF@CDIINC.NET

NAME: Randy Xeiter
COMPANY NAME: 3D Professional Contracting
PHONE: 317 340-8862
EMAIL: dhawkins@3dproinc.com

NAME: Skip Watkins
COMPANY NAME: W R DUNKIN & SON
PHONE: 765-643-3321
EMAIL: estimating@WRDUNKIN.COM

NAME: TOOD HUTCHINS
COMPANY NAME: RELIANT ELECTRIC
PHONE: 765-506-4599
EMAIL: INFO@RELIANTELECTRICCO.COM

NAME: JORDAN NICHOLSON
COMPANY NAME: MCGUFF ROOFING
PHONE: 765-760-2109
EMAIL: JORDAN@MCGUFFROOFING.COM

NAME: _____
COMPANY NAME: _____
PHONE: _____
EMAIL: _____

1/28/26

PRE-BID CONFERENCE SIGN IN SHEET

NAME: DAVE REEF
COMPANY NAME: BRAND ELECTRIC
PHONE: 765-296-3437
EMAIL: dreef@brandelectric.com

NAME: Troy McKee
COMPANY NAME: Triple J Plumbing
PHONE: 765-524-0447
EMAIL: estimates@triplejplumbing.net

NAME: Cory Brown
COMPANY NAME: Mattcon GC
PHONE: 317-872-4700
EMAIL: CORYB@MATTCONGC.COM

NAME: Chris Monroe
COMPANY NAME: Monroe Construction Group
PHONE: 765-455-2993
EMAIL: support@monroeconstruct.com

NAME: JORDAN NICHOLSON
COMPANY NAME: MCBOUFF ROOFING
PHONE: 765-760-2109
EMAIL: JORDAN@MCBOUFFROOFING.COM

NAME: Butch Loekhart
COMPANY NAME: Materiacy Roofing ~~and~~ Products
PHONE: 317 223 5114
EMAIL: b1roof5olutions@gmail.com

NAME: Jeff Owens
COMPANY NAME: Equity Builders Roofing
PHONE: 812-994-14973
EMAIL: jeff@equitybuildersroofing.com

1/28/24

PRE-BID CONFERENCE SIGN IN SHEET

NAME: Joe Browning
COMPANY NAME: AIS Construction Services
PHONE: 765-810-1779
EMAIL: j.browning@aisconstructionservices.com

NAME: Christian Brueggermann
COMPANY NAME: Nu-Tech Roofing
PHONE: 317 955 9885
EMAIL: Cbrueggermann@nutechroofing.com

NAME: Andrew Brinks
COMPANY NAME: FREDERICKS, INC
PHONE: (765) 425-3107
EMAIL: andrew.brinks@fredericksinc.com

NAME: Luke Weber
COMPANY NAME: Nugen Electric, Inc.
PHONE: (765) 744-9517
EMAIL: LukeWeber@nugenelectric.net

NAME: Ryan Burlison
COMPANY NAME: Cunningham Construction Group
PHONE: 317-840-2056
EMAIL: ~~Ryan~~ @CCG Ryan @theccg.biz

NAME: Brian Cate
COMPANY NAME: Cunningham Construction Group
PHONE: 765-714-1967
EMAIL: Brian @theccg.biz

NAME: _____
COMPANY NAME: _____
PHONE: _____
EMAIL: _____

1/23/26

PRE-BID CONFERENCE SIGN IN SHEET

NAME: Kevin Action
COMPANY NAME: Wabash Valley Exteriors
PHONE: 765-585-6891
EMAIL: Kevin @ WUExteriors.com

NAME: MARTY VAUGHN
COMPANY NAME: ROYAL FLUSH PLUMBING
PHONE: 765-642-7066
EMAIL: MARTY @ ROYAL FLUSH PROS . COM

NAME: Andy Hall
COMPANY NAME: JG BOWERS, INC.
PHONE: 765-620-7020
EMAIL: ahall@jgbowers.com

NAME: Bob Webster
COMPANY NAME: Bauma-Betten Corp
PHONE: 765 447-5000
EMAIL: BobW@bauma-betten.com

NAME: _____
COMPANY NAME: _____
PHONE: _____
EMAIL: _____

NAME: _____
COMPANY NAME: _____
PHONE: _____
EMAIL: _____

NAME: _____
COMPANY NAME: _____
PHONE: _____
EMAIL: _____

1/28/26

PRE-BID CONFERENCE SIGN IN SHEET

NAME: Oliver Wise
COMPANY NAME: FAM Construction
PHONE: 317-691-7211
EMAIL: OWise@FAMConstruction.com

NAME: Noah Worsham
COMPANY NAME: Industrial Handyman LLC
PHONE: 574 549-3497
EMAIL: industrial.handyman.25@gmail.com

NAME: Tanner Watkins
COMPANY NAME: Berline Construction, Inc.
PHONE: 765-639-7642
EMAIL: t.watkins@berlineconstruction.com

NAME: Caron DiRuzza
COMPANY NAME: Indiana Flooring Carpet One
PHONE: 765-623-9606
EMAIL: cdiruzza@Inde1.com

NAME: _____
COMPANY NAME: _____
PHONE: _____
EMAIL: _____

NAME: _____
COMPANY NAME: _____
PHONE: _____
EMAIL: _____

NAME: _____
COMPANY NAME: _____
PHONE: _____
EMAIL: _____

SPECIFICATION TABLE OF CONTENTS

Volume 1 of 1

000101	Project Title Page
000102	Project Information
000105	Certifications Page
000107	Seals Page
000110	Table of Contents
BIDDING REQUIREMENTS	
001113	Advertisement for Bids
002113	Instructions to Bidders
002213	Supplementary Instructions to Bidders
002214	Bidder's Substitution Request Form
002513	Pre-Bid Conference
004113	Contractor's Bid for Public Work
004336	Subcontractors and Products List
CONTRACTING REQUIREMENTS	
005200	Agreement
007000a	General Conditions
007000b	AIA A201-2017 General Conditions
007300	Supplementary Conditions
DIV01	GENERAL REQUIREMENTS
011100	Summary of Work
012100	Allowances
012200	Unit Prices
012300	Alternates
012513	Product Substitution Procedures
012600	Contract Modification Procedures
012900	Applications for Payment
013113	Project Coordination
013119	Project Meetings
013300	Submittal Procedures
014200	Reference Standards and Definitions
014326	Quality Control Services
015000	Construction Facilities and Temporary Controls
015639	Temporary Tree and Plant Protection
015700	Erosion and Sediment Control
016000	Materials and Equipment
017123	Field Engineering
017329	Cutting and Patching
017500	Starting of Systems
017700	Contract Closeout
017836	Warranties
DIV02	EXISTING CONDITIONS
024119	Selective Demolition
DIV03	CONCRETE
032000	Concrete Reinforcing
033000	Cast-In-Place Concrete
DIV04	MASONRY
044301	Limestone Masonry
048100	Unit Masonry Assemblies
DIV05	METALS
055000	Metal Fabrications
DIV06	WOOD, PLASTICS, AND COMPOSITES (NOT IN USED)
060573	Wood Treatment
061000	Rough Carpentry
061005	Miscellaneous Carpentry

061600 Sheathing
064020 Interior Architectural Woodwork
064600 Wood Trim

DIV07 THERMAL AND MOISTURE PROTECTION

070150 Preparation for Reroofing
070553 Fire and Smoke Assembly Identification
072100 Thermal Insulation
073113 Asphalt Shingles
075323 EPDM Fully Adhered Membrane Roofing (Contractor's Option)
075423 Adhered TPO Membrane Roofing (Contractor's Option)
076200 Sheet Metal Flashing and Trim
077100 Manufactured Roof Specialties
078413 Through-Penetration Fire Stop Systems
079200 Joint Sealants

DIV08 OPENINGS

081213 Steel Doors and Frames
081416 Flush Wood Doors
083100 Access Doors
084100 Aluminum Entrances and Storefronts
087100 Door Hardware
087113 Power Door Operators
088000 Glazing

DIV09 FINISHES

092116 Gypsum Board Assemblies
095100 Acoustical Panel Ceilings
096519 Resilient Tile Flooring
096813 Carpet Tile
099100 Painting
099700 Special Coatings

DIV10 SPECIALTIES

101422 Electronic Message Board
101440 Interior Signs
102113 Toilet Compartments
102813 Toilet Accessories
105520 Exterior Book Receiving Box
107333 Fabricated Outdoor Shelters

DIV11 NOT USED

DIV12 SPECIALTIES
123400 Plastic Laminate Faced Casework

DIV21-28 REFERENCE DRAWINGS

DIV31 EARTHWORK
311000 Site Clearing
312000 Earth Moving
313116 Termite Control

DIV32 EXTERIOR IMPROVEMENTS
321216 Asphalt Paving
321313 Concrete Paving
321373 Concrete Pavement Joint Sealants
323119 Decorative Metal Fences & Gates
323300 Site Furnishings
329113 Soil Preparation
329200 Turf and Grasses
329300 Plants

DIV33 REFERENCE DRAWINGS

Sheridan Public Library Building Addition,
Renovations & Site Improvements

SECTION 000105 - CERTIFICATIONS PAGE

PROJECT:

BUILDING ADDITION, RENOVATIONS & SITE IMPROVEMENTS FOR:
SHERIDAN PUBLIC LIBRARY
103 W 1ST STREET
SHERIDAN, INDIANA 46069

OWNER:

SHERIDAN PUBLIC LIBRARY
103 W 1ST STREET
SHERIDAN, INDIANA, 46069

ARCHITECT / LANDSCAPE ARCHITECT:

ODLE MCGUIRE SHOOK
7222 N. SHADELAND AVE., SUITE 100
INDIANAPOLIS, INDIANA 46250
OFFICE: (317) 842-0000 / DIRECT: (317) 408-9566
WWW.OMSCORP.NET
PROJECT MANAGER: MATTHEW R. MAYOL, AIA, MMAYOL@OMSCORP.NET

CIVIL / STRUCTURAL ENGINEER:

JQOL
8440 ALLISON POINTE BLVD. SUITE 425
INDIANAPOLIS, INDIANA 46250
OFFICE: (317) 661-1964
WWW.JQOLUSA.COM
CIVIL PROJECT MANAGER: ROBERT SANTOS, P.E., RSANTOS@JQOLUSA.COM
STRUCTURAL PROJECT MANAGER: DANIEL MOBLEY, P.E., DMOBLEY@JQOLUSA.COM


ELECTRICAL & MECHANICAL ENGINEER:

DAE-DESIGN AIRE ENGINEERING
2707 RAND ROAD
INDIANAPOLIS, INDIANA 46241
(317) 431-3293
WWW.DAEENGINEERING.COM
PROJECT MANAGER: WILLIAM "BILL" SNODGRASS, WSNODGRASS@DAEENGINEERING.COM

Sheridan Public Library Building Addition,
Renovations & Site Improvements

END OF SECTION

SHERIDAN PUBLIC LIBRARY BUILDING ADDITION, RENOVATIONS AND SITE IMPROVEMENTS

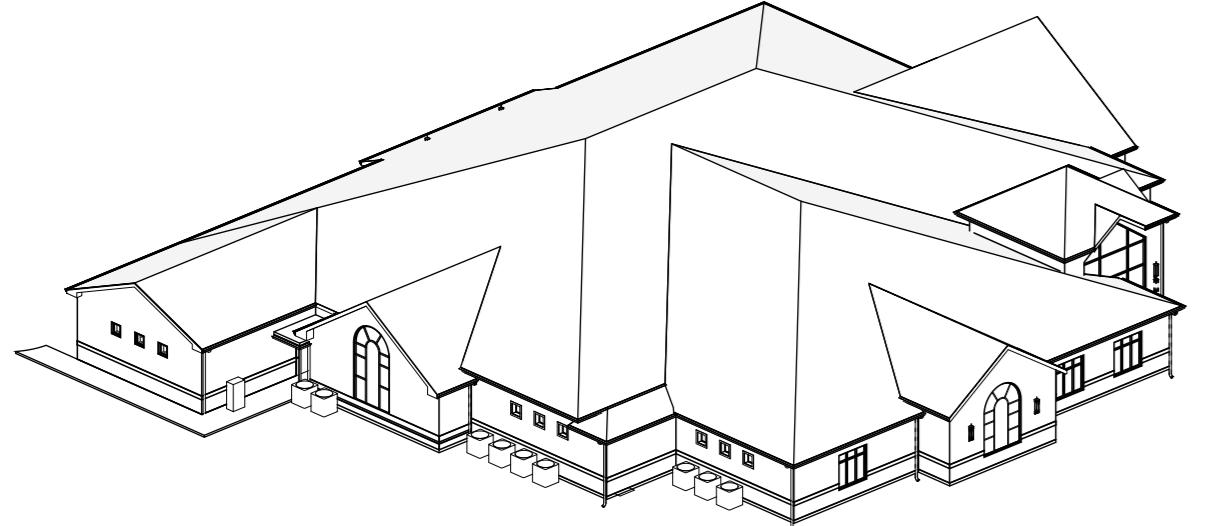

103 W 1ST ST, SHERIDAN, IN 46069, HAMILTON COUNTY

100% CONSTRUCTION DOCUMENTS

OMS PROJECT NUMBER: 25050

ISSUE DATE: 01.15.26

OWNER: SHERIDAN PUBLIC LIBRARY
103 W. 1ST. STREET, SHERIDAN, INDIANA, HAMILTON COUNTY
KIM RILEY, DIRECTOR (317)758-5201, KIM@SHERIDAN.LIB.IN.US

BOARD OF TRUSTEES:

LORETTA SUTHERLAND: PRESIDENT
RUTH GERBIG: VICE PRESIDENT
ALICIA BURNELL: SECRETARY
LAURA GLUNT: TREASURER
FLOYD BARKER: BOARD MEMBER
BARB HYBARGER: BOARD MEMBER
KATHY BRAY: BOARD MEMBER

LIBRARY ADMINISTRATION:

KIM RILEY DIRECTOR

ARCHITECT
ODLE MCGUIRE SHOOK
7222 N. Shadeland Avenue, Suite 100
Indianapolis, Indiana 46250
Contact: Matt Mayol, Architect
office: 317.842.0000
direct: 317.408.9566
email: mmayol@omscorp.net
www.omscorp.net

Relo Design
Rethink. Renovate. Refresh.

INTERIOR DESIGN / FURNITURE, SHELVING & EQUIPMENT
CONSULTANT
RELOCATION STRATEGIES
7222 North Shadeland Avenue, Suite 170
Indianapolis, Indiana 46250
Contact: Gretchen Bontrager, Project Manager
phone: 317.202.0000
gbontrager@relocationstrategies.com
www.relostrategies.com

JQOL
QUALITY OF LIFE™

STRUCTURAL / CIVIL
8440 Allison Pointe Blvd, Suite 425
Indianapolis, Indiana 46250
Civil Contact: Robert Santos, P.E.
phone: 915.202.2649
rsantos@jqolusa.com
Structural Contact: Daniel Mobley, P.E.
phone: 812.454.8521
dmobley@jqolusa.com
www.jqolusa.com

DAE
DESIGN-AIRE ENGINEERING, INC.

MECHANICAL / PLUMBING / ELECTRICAL / FIRE ALARM
2707 Rand Rd
Indianapolis, Indiana 46241
Contact: William "Bill" Snodgrass, P.E.
phone: 317.431.3293
wsnodgrass@daengineering.com
www.daengineering.com



DRAWING INDEX	
GENERAL	
G000	COVER SHEET
G001	CODE SUMMARY & LIFE SAFETY PLAN
G002	ACCESSIBILITY REFERENCE
G005	PHASING PLAN
CIVIL	
C0.0	COVER SHEET
C0.1	GENERAL NOTES
C0.2	EXISTING CONDITIONS PLAN
C0.3	PHASE 1 STORM WATER POLLUTION PREVENTION PLAN
C0.4	DEMOLITION PLAN
C0.5	PHASE 2 STORMWATER POLLUTION PREVENTION PLAN
C0.6	SWPPP DETAILS
C0.7	SWPP DETAILS
C1.0	OVERALL SITE PLAN
C1.1	SITE PLAN
C1.2	SITE DETAILS
C1.3	VEHICLE PATH
C2.0	GRADING PLAN
C3.0	UTILITY PLAN
LANDSCAPE	
L100	SITE PLAN SCOPE
L101	SITE DETAILS
L102	PLANTING PLAN LANDSCAPE DEMOLITION PLAN
L103	PLANT SPECIFICATIONS
STRUCTURAL	
S001	GENERAL NOTES & ABBREVIATIONS
S010	LOAD MAPS
S020	LEGENDS
SD100	DEMO FOUNDATION PLAN
S100	OVERALL FOUNDATION PLAN
S110	OVERALL FRAMING PLAN
S400	ENLARGED PLANS
S500	FOUNDATION SCHEDULES, SECTIONS & DETAILS
S510	FRAMING SCHEDULES, SECTIONS & DETAILS
S511	FRAMING SCHEDULES, SECTIONS, & DETAILS
ARCHITECTURAL	
A001	GENERAL INFORMATION
A002	GENERAL INFORMATION
A003	TYPICAL DETAILS
DA101	FIRST FLOOR DEMO PLAN & MEZZANINE DEMO PLAN
A101	FIRST FLOOR PLAN & MEZZANINE FLOOR PLAN
A102	FIRST FLOOR RCP
A103	ROOF PLAN & DETAILS
A105	ENLARGED PLANS, ELEVATIONS & TOILET ACCESSORY SCHEDULE
A201	EXTERIOR ELEVATIONS
A202	INTERIOR ELEVATIONS, ENLARGED PLAN, APPLIANCE SCHEDULE & DETAILS
A401	WALL SECTIONS
A501	OPENING SCHEDULES, ELEVATIONS, & DETAILS
INTERIORS	
A101	FIRST FLOOR FINISH PLAN
A102	FINISH LEGEND
A103	INTERIOR FINISH ELEVATIONS
F101	EXISTING FURNITURE & SHELVING PLAN - FOR REFERENCE ONLY. WORK BY OTHERS.
F102	NEW FURNITURE & SHELVING PLAN- FOR REFERENCE ONLY. WORK BY OTHERS.
MECHANICAL	
M001	MECHANICAL GENERAL INFORMATION
M002	MECHANICAL DETAILS
M003	MECHANICAL SCHEDULES
M004	MECHANICAL SPECIFICATIONS
M005	MECHANICAL CALCULATIONS
M006	MECHANICAL CALCULATIONS
M0101	MECHANICAL DEMOLITION PLAN
M101	MECHANICAL PLAN
PLUMBING	
P001	PLUMBING GENERAL INFORMATION
P002	PLUMBING DETAILS AND SCHEDULES
P003	PLUMBING SPECIFICATIONS
P004	PLUMBING SPECIFICATIONS
PD101	PLUMBING DEMOLITION PLAN
P101	PLUMBING FLOOR PLAN
ELECTRICAL	
E001	ELECTRICAL GENERAL INFORMATION
E002	ELECTRICAL DETAILS
E003	ELECTRICAL SPECIFICATIONS
E004	ELECTRICAL SPECIFICATIONS
E005	ELECTRICAL SCHEDULES
ED101	ELECTRICAL DEMOLITION PLAN
E101	ELECTRICAL LIGHTING PLAN
E102	ELECTRICAL LIGHTING CONTROL PLAN
E103	ELECTRICAL LIGHTING CONTROL RISER DIAGRAM
E201	ELECTRICAL POWER PLAN
E301	SITE LIGHTING PLAN
E302	SITE POWER PLAN





CONSTRUCTION PLANS FOR: SHERIDAN PUBLIC LIBRARY

103 W. 1ST ST.
SHERIDAN, IN 46069



SHEET LIST TABLE	
SHEET NUMBER	SHEET TITLE
C-0.0	COVER SHEET
C-0.1	GENERAL NOTES
C-0.2	EXISTING CONDITIONS PLAN
C-0.3	PHASE 1: STORMWATER POLLUTION PREVENTION PLAN
C-0.4	DEMOLITION PLAN
C-0.5	PHASE 2: STORMWATER POLLUTION PREVENTION PLAN
C-0.6	SWPPP DETAILS
C-0.7	SWPPP DETAILS
C-1.0	OVERALL SITE PLAN
C-1.1	SITE PLAN
C-1.2	SITE DETAILS
C-1.3	VEHICLE PATH
C-2.0	GRADING PLAN
C-3.0	UTILITY PLAN

SITE DATA:

TOTAL SITE ACREAGE - 2.0 AC.
TOTAL ACREAGE OF DISTURBANCE - 0.59 AC.
GROSS SQUARE FOOTAGE OF BUILDING - 680 SQ. FT.

PROPOSED CONSTRUCTION START - SPRING 2026
PROPOSED CONSTRUCTION END - FALL 2026
WORK IS SCHEDULED TO BE COMPLETED IN ONE CONTINUOUS CONSTRUCTION PHASE.

PROJECT LOCATION	103 W. 1ST ST. SHERIDAN, IN 46069
BENCHMARK DESCRIPTIONS:	
TBM #2153 MAG NAIL WEIHE WASHER.	ELEV. 947.03 (NAVD 88)
COORDINATE SYSTEM:	
US STATE PLANE 1983 (AT GROUND)	
PROJECT DATUM:	
WORLD GEODETIC SYSTEM (WGS 1984)	

VERTICAL DATUM:	
NAVD 88	
ZONE:	
INDIANA EAST 1301	
GEOID MODEL:	
GEOID12A (CONUS)	
COORDINATE UNITS US SURVEY FEET	
DISTANCE UNITS US SURVEY FEET	
HEIGHT UNITS US SURVEY FEET	

GENERAL NOTES:

1. THE CONSTRUCTION PLANS SHALL GOVERN OVER ANY OTHER FORM OF MEDIA, WHICH INCLUDES DIGITAL FILES OF THIS PROJECT.
2. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING OR VERIFYING THAT ALL PERMITS AND APPROVALS ARE FOR OBTAINING FROM THE RESPECTIVE CITY, COUNTY, STATE & FEDERAL AGENCIES PRIOR TO STARTING CONSTRUCTION.
3. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES IN THE VICINITY OF THE CONSTRUCTION AREA PRIOR TO STARTING CONSTRUCTION UNLESS OTHERWISE INDICATED IN THE CONSTRUCTION DRAWINGS.
4. PRIOR TO WORKING WITH OR AROUND EXISTING UTILITIES, THE APPLICABLE UTILITY COMPANY SHALL BE CONTACTED BY THE CONTRACTOR. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO NOTIFY AND COORDINATE CONSTRUCTION WITH ALL RESPECTIVE UTILITIES.
5. ALL CONSTRUCTION METHODS AND MATERIALS MUST CONFORM TO CURRENT STANDARDS AND SPECIFICATIONS FOR THE GOVERNING MUNICIPALITY REQUIREMENTS.
6. MAINTENANCE OF TRAFFIC NEEDED FOR THIS PROJECT SHALL BE INSTALLED AND MAINTAINED PER INDOT SPECIFICATIONS/STANDARD DRAWINGS, INDOT DESIGN MANUAL, AND THE INDIANA MUTCD MANUAL ALONG WITH GOVERNING MUNICIPALITY REQUIREMENTS AND SHALL BE COORDINATED WITH THE ENGINEER.
7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL FIELD DIMENSIONS AND SHALL VERIFY ALL DIMENSIONS ON THE SITE PRIOR TO THE START OF CONSTRUCTION. IF ANY DISCREPANCIES ARE FOUND IN THE PLAN FROM ACTUAL FIELD CONDITIONS, THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY.
8. IT SHALL BE THE RESPONSIBILITY OF THE DEVELOPER AND CONTRACTOR TO MAINTAIN QUALITY CONTROL THROUGHOUT THIS PROJECT.
9. ALL GRADES AT THE SITE'S BOUNDARY SHALL MEET EXISTING GRADES.
10. NO WORK SHALL BE CONSTRUCTED OFFSITE UNLESS SHOWN OR DENOTED WITHIN THESE PLANS.
11. NO CONSTRUCTION WORK SHALL BE PERFORMED WITHIN THE ADJACENT OR ON SITE WATER TRIBUTARIES/WATERCOURSES UNLESS SHOWN OR DENOTED AS SUCH OTHERWISE WITHIN THESE PLANS.
12. CONTRACTOR SHALL MINIMIZE DAMAGE TO ANY EXISTING TREES UNLESS NOTED OTHERWISE.
13. ALL CONSTRUCTION ACTIVITY ON THIS SITE IS TO BE PERFORMED IN COMPLIANCE WITH ALL APPLICABLE O.S.H.A. STANDARDS FOR WORKERS' SAFETY.
14. BEARING, DIMENSIONS, AND EASEMENTS ARE SHOWN FOR REFERENCE ONLY. SEE RECORD SURVEYS AND PLATS FOR EXACT INFORMATION.

SPECIFICATIONS:

1. ALL WORK SHALL BE IN ACCORDANCE WITH ALL APPLICABLE TOWN OF SHERIDAN STANDARDS, DETAILS, AND SPECIFICATIONS (LATEST EDITIONS) - UNLESS OTHERWISE NOTED.
2. INDIANA STATE DEPARTMENT OF TRANSPORTATION (INDOT) STANDARD DRAWINGS AND SPECIFICATIONS (LATEST EDITIONS) SHALL BE INCORPORATED INTO AND UTILIZED WITH THESE PLANS (SUPPLEMENTAL SPECIFICATIONS AND DETAILS).
3. CITIZENS WATER STANDARDS, DETAILS, AND SPECIFICATIONS (LATEST EDITIONS) SHALL BE INCORPORATED INTO AND UTILIZED WITH THESE PLANS PERTINENT TO WATER LINE CONSTRUCTION.
4. CITIZENS AND SHERIDAN FIRE DEPARTMENT STANDARDS, DETAILS, AND SPECIFICATIONS SHALL BE UTILIZED FOR ALL FIRE PROTECTION WATER LINES AND APPURTENANCE CONSTRUCTION PERTINENT TO THIS PROJECT.
5. CITIZENS SANITARY SEWER STANDARDS, DETAILS, AND SPECIFICATIONS (LATEST EDITIONS) SHALL BE INCORPORATED INTO AND UTILIZED WITH THESE PLANS PERTINENT TO THIS PROJECT.
6. THE INDIANA MUTCD MANUAL (LATEST EDITION) SHALL BE INCORPORATED INTO AND UTILIZED WITH THESE PLANS.

MAINTENANCE OF TRAFFIC (MOT) NOTES:


ALL MAINTENANCE OF TRAFFIC SHALL BE DESIGNED TO, FOLLOW, AND BE INSTALLED PER THE INDIANA MUTCD MANUAL, INDIANA DEPARTMENT OF TRANSPORTATION (INDOT) SPECIFICATIONS AND STANDARD DRAWINGS, AND INDOT DESIGN MANUAL.

SIGNS AND PAVEMENT MARKING NOTES:

ALL SIGNS, PAVEMENT MARKINGS, AND STRIPING SHALL MEET THE CURRENT EDITION OF THE INDIANA MUTCD MANUAL, TRAFFIC CONTROL FOR CYCLE FACILITIES, AND INDOT STANDARD DRAWINGS AND SPECIFICATIONS AND SHALL BE INSTALLED PER THE INDIANA MUTCD MANUAL, INDIANA DEPARTMENT OF TRANSPORTATION (INDOT) SPECIFICATIONS AND STANDARD DRAWINGS, AND INDOT DESIGN MANUAL.

QUANTITIES NOTE:

ANY AND ALL QUANTITY TABLES, NOTES OR VALUES AS SHOWN ON THESE PLANS ARE FOR REFERENCE ONLY. THE PLANS, DETAILS, AND SPECIFICATION GOVERN. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO REVIEW THE ENTIRE CONSTRUCTION SET AND DETERMINE ALL THE FINAL QUANTITIES FOR ALL NECESSARY ITEMS REQUIRED TO COMPLETE THIS PROJECT. THE OWNER OR THE ENGINEER WILL NOT BE HELD LIABLE OR RESPONSIBLE FOR ESTIMATES NOT CONFIRMED BY THE CONTRACTORS. THE CONTRACTOR SHALL VERIFY ALL QUANTITIES PRIOR TO BIDDING AND CONSTRUCTION. IF DISCREPANCIES ARE FOUND, CONTACT THE ENGINEER IMMEDIATELY.

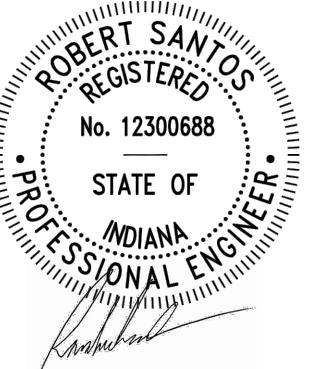

DATE: 1/15/2026

These Drawings and Specifications, and all copies thereof are and shall remain the property and copyright of the Engineer. They shall be used only with respect to this Project and are not to be used on any other Project or Work without prior written permission from the Engineer.



8440 Allison Pointe Blvd.
Indianapolis, IN 46250
www.jqolusa.com

CONSTRUCTION
DOCUMENT

PROJECT:
103 W. 1ST ST.
SHERIDAN, IN 46069
PREPARED FOR:

ODILE MC GUIRE SHOOK ARCHITECTS
7222 N. SHARLAND AVE. STE. 100
INDIANAPOLIS, IN 46250

Revision Date
1 ADD-1 01/29/26
2 - -
3 - -





PROJECT NO: 2025.207

SHEET NAME:

COVER SHEET

SHEET ISSUE DATE: 15-Jan-26
SCALE: NO SCALE
DESIGNED: SB CHECKED: RS
SHEET NO.: C-0.0
SHEET X OF X



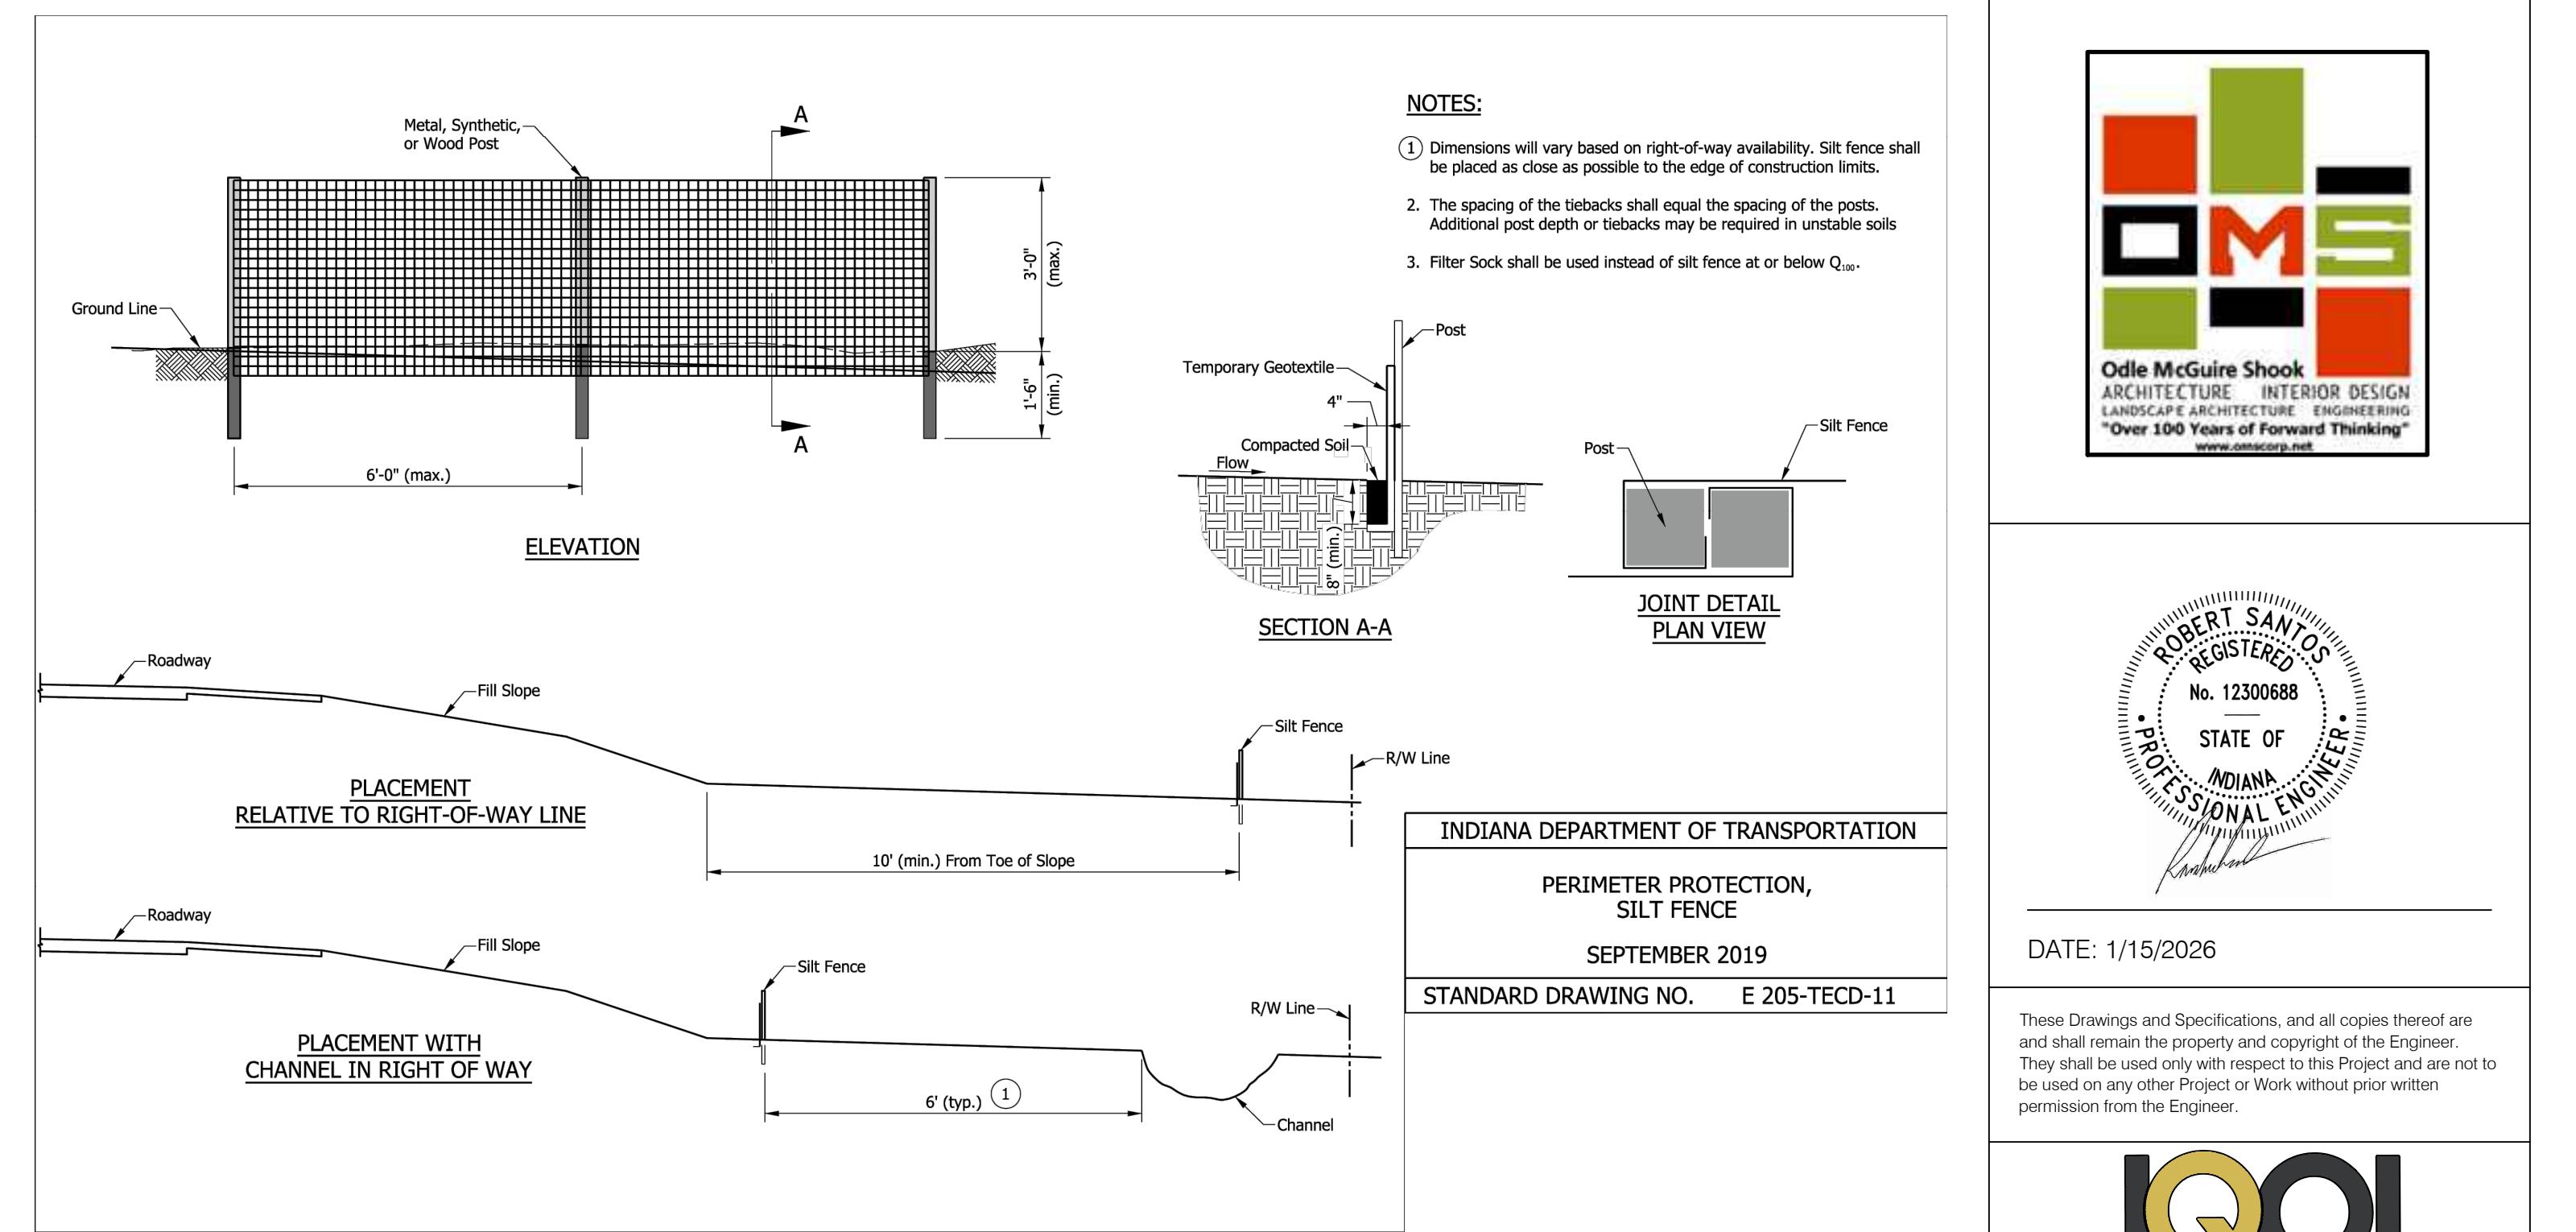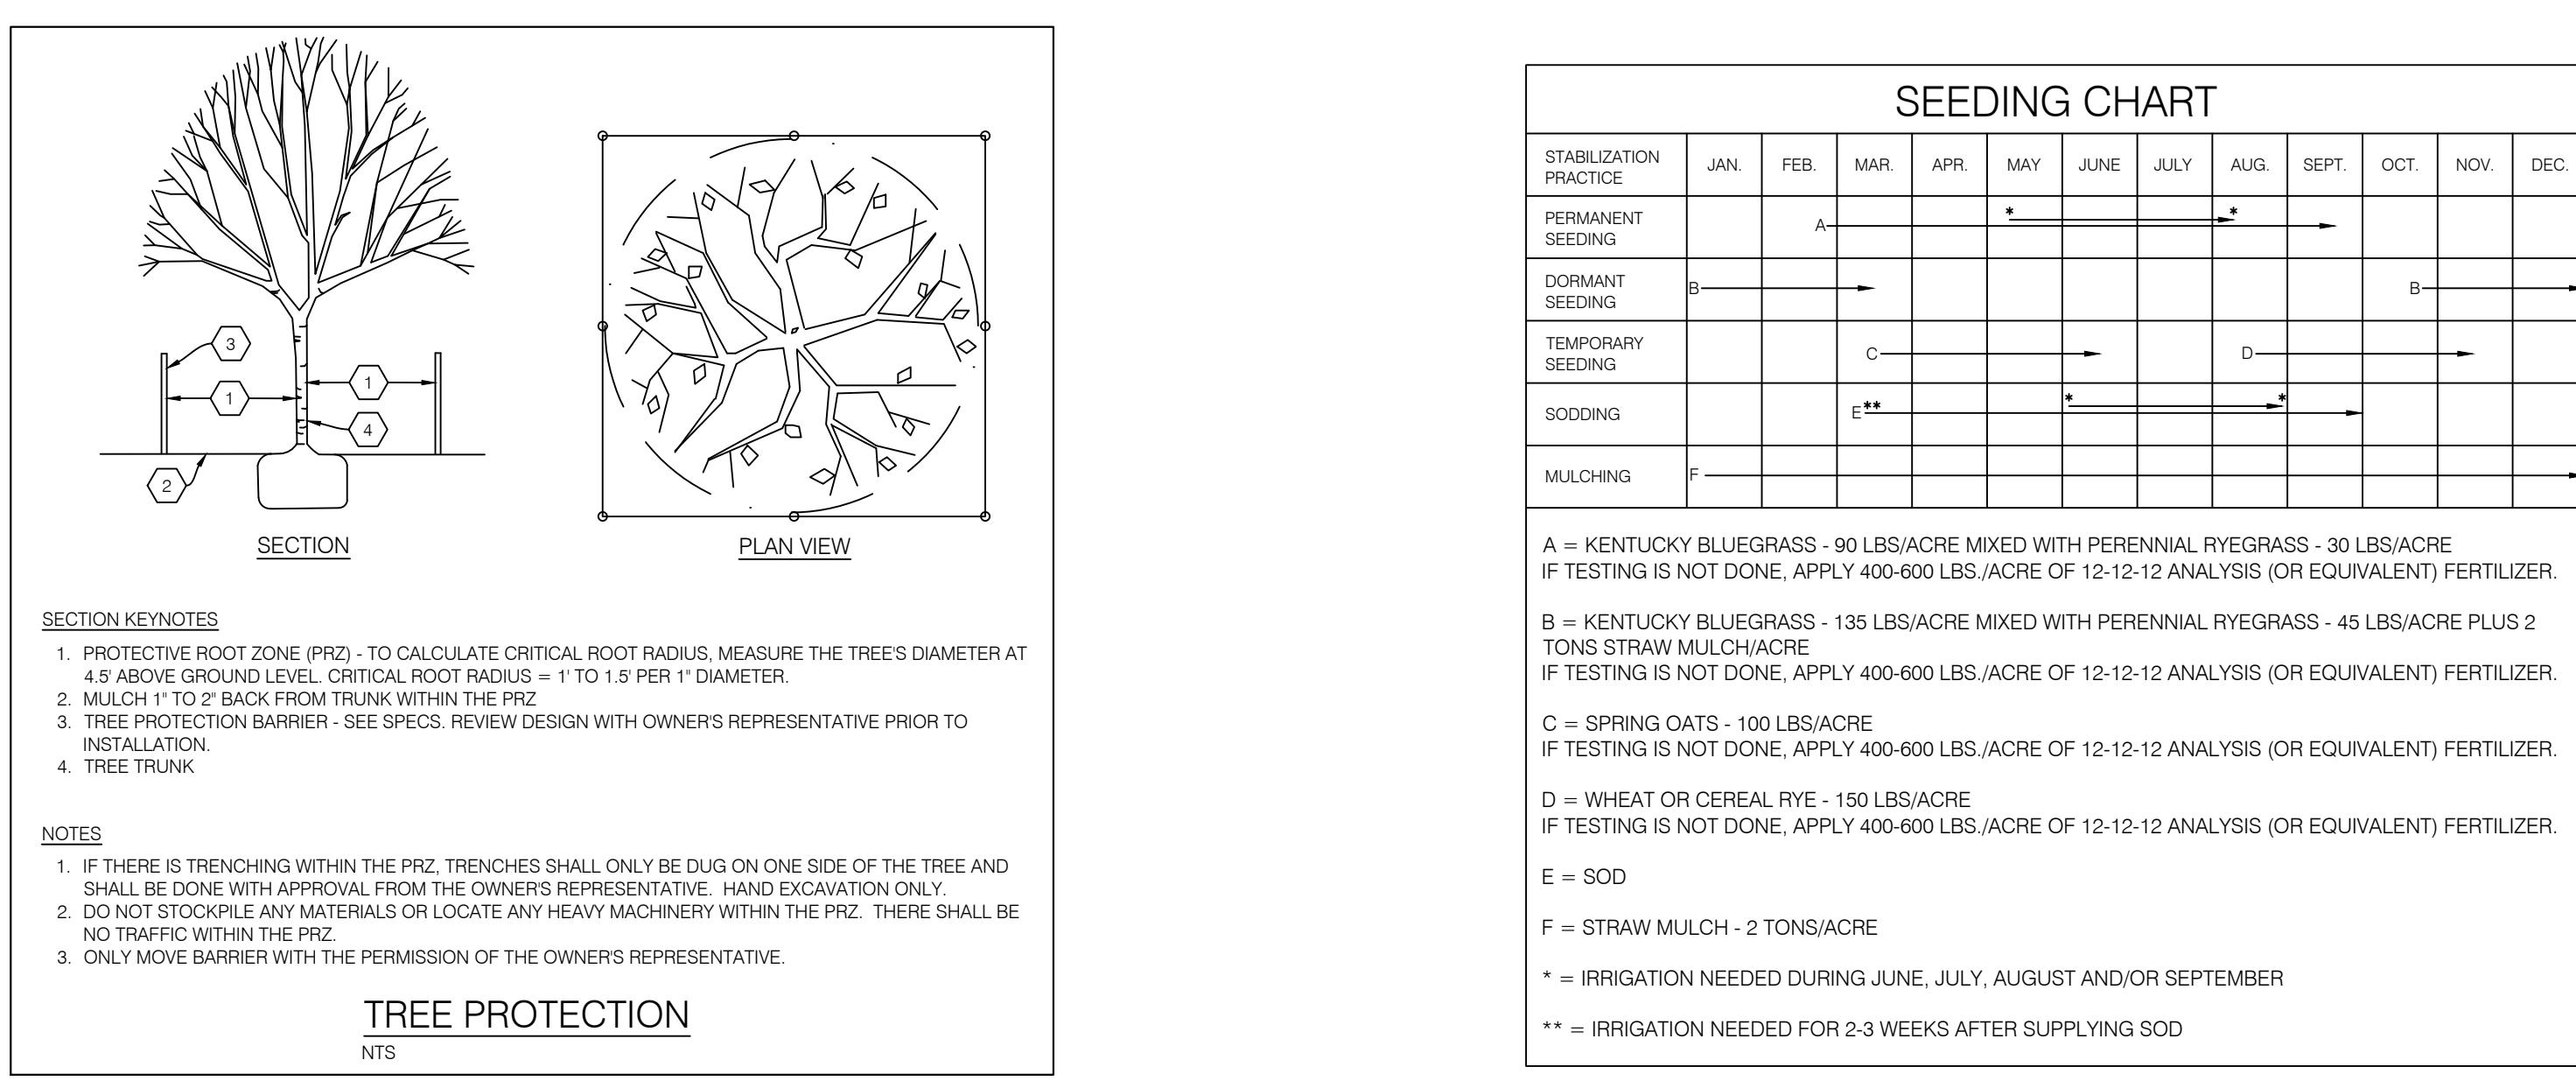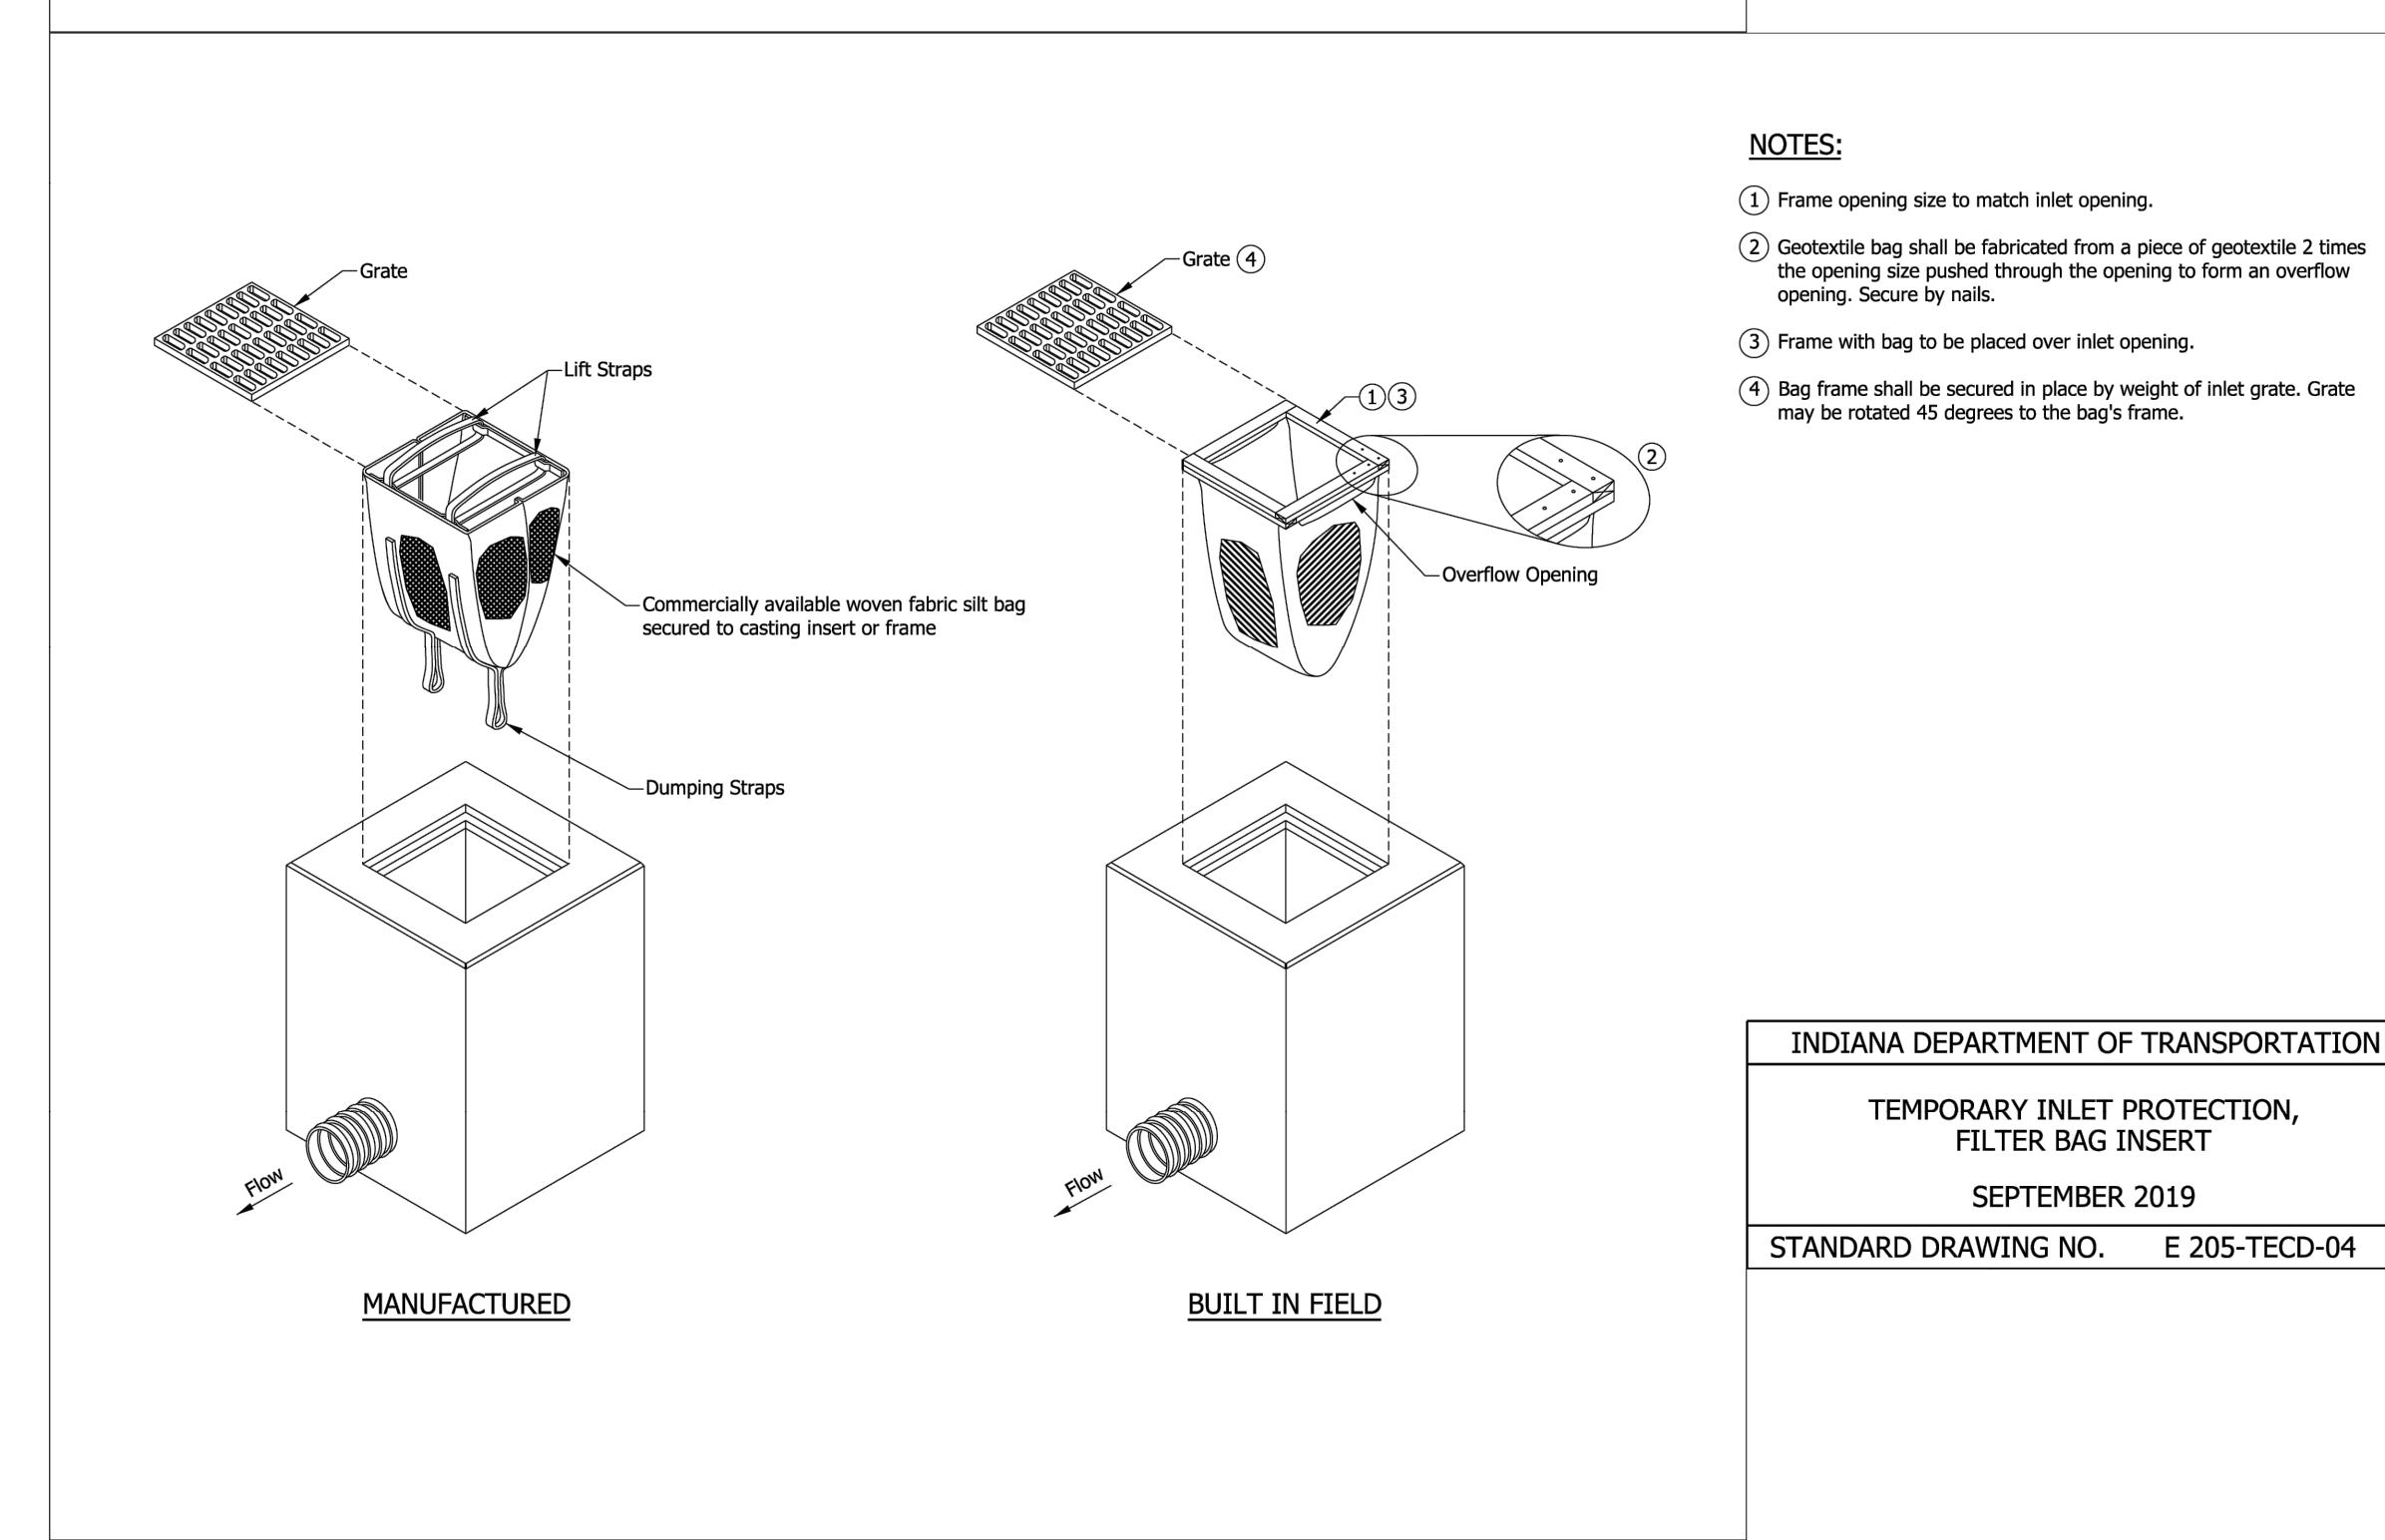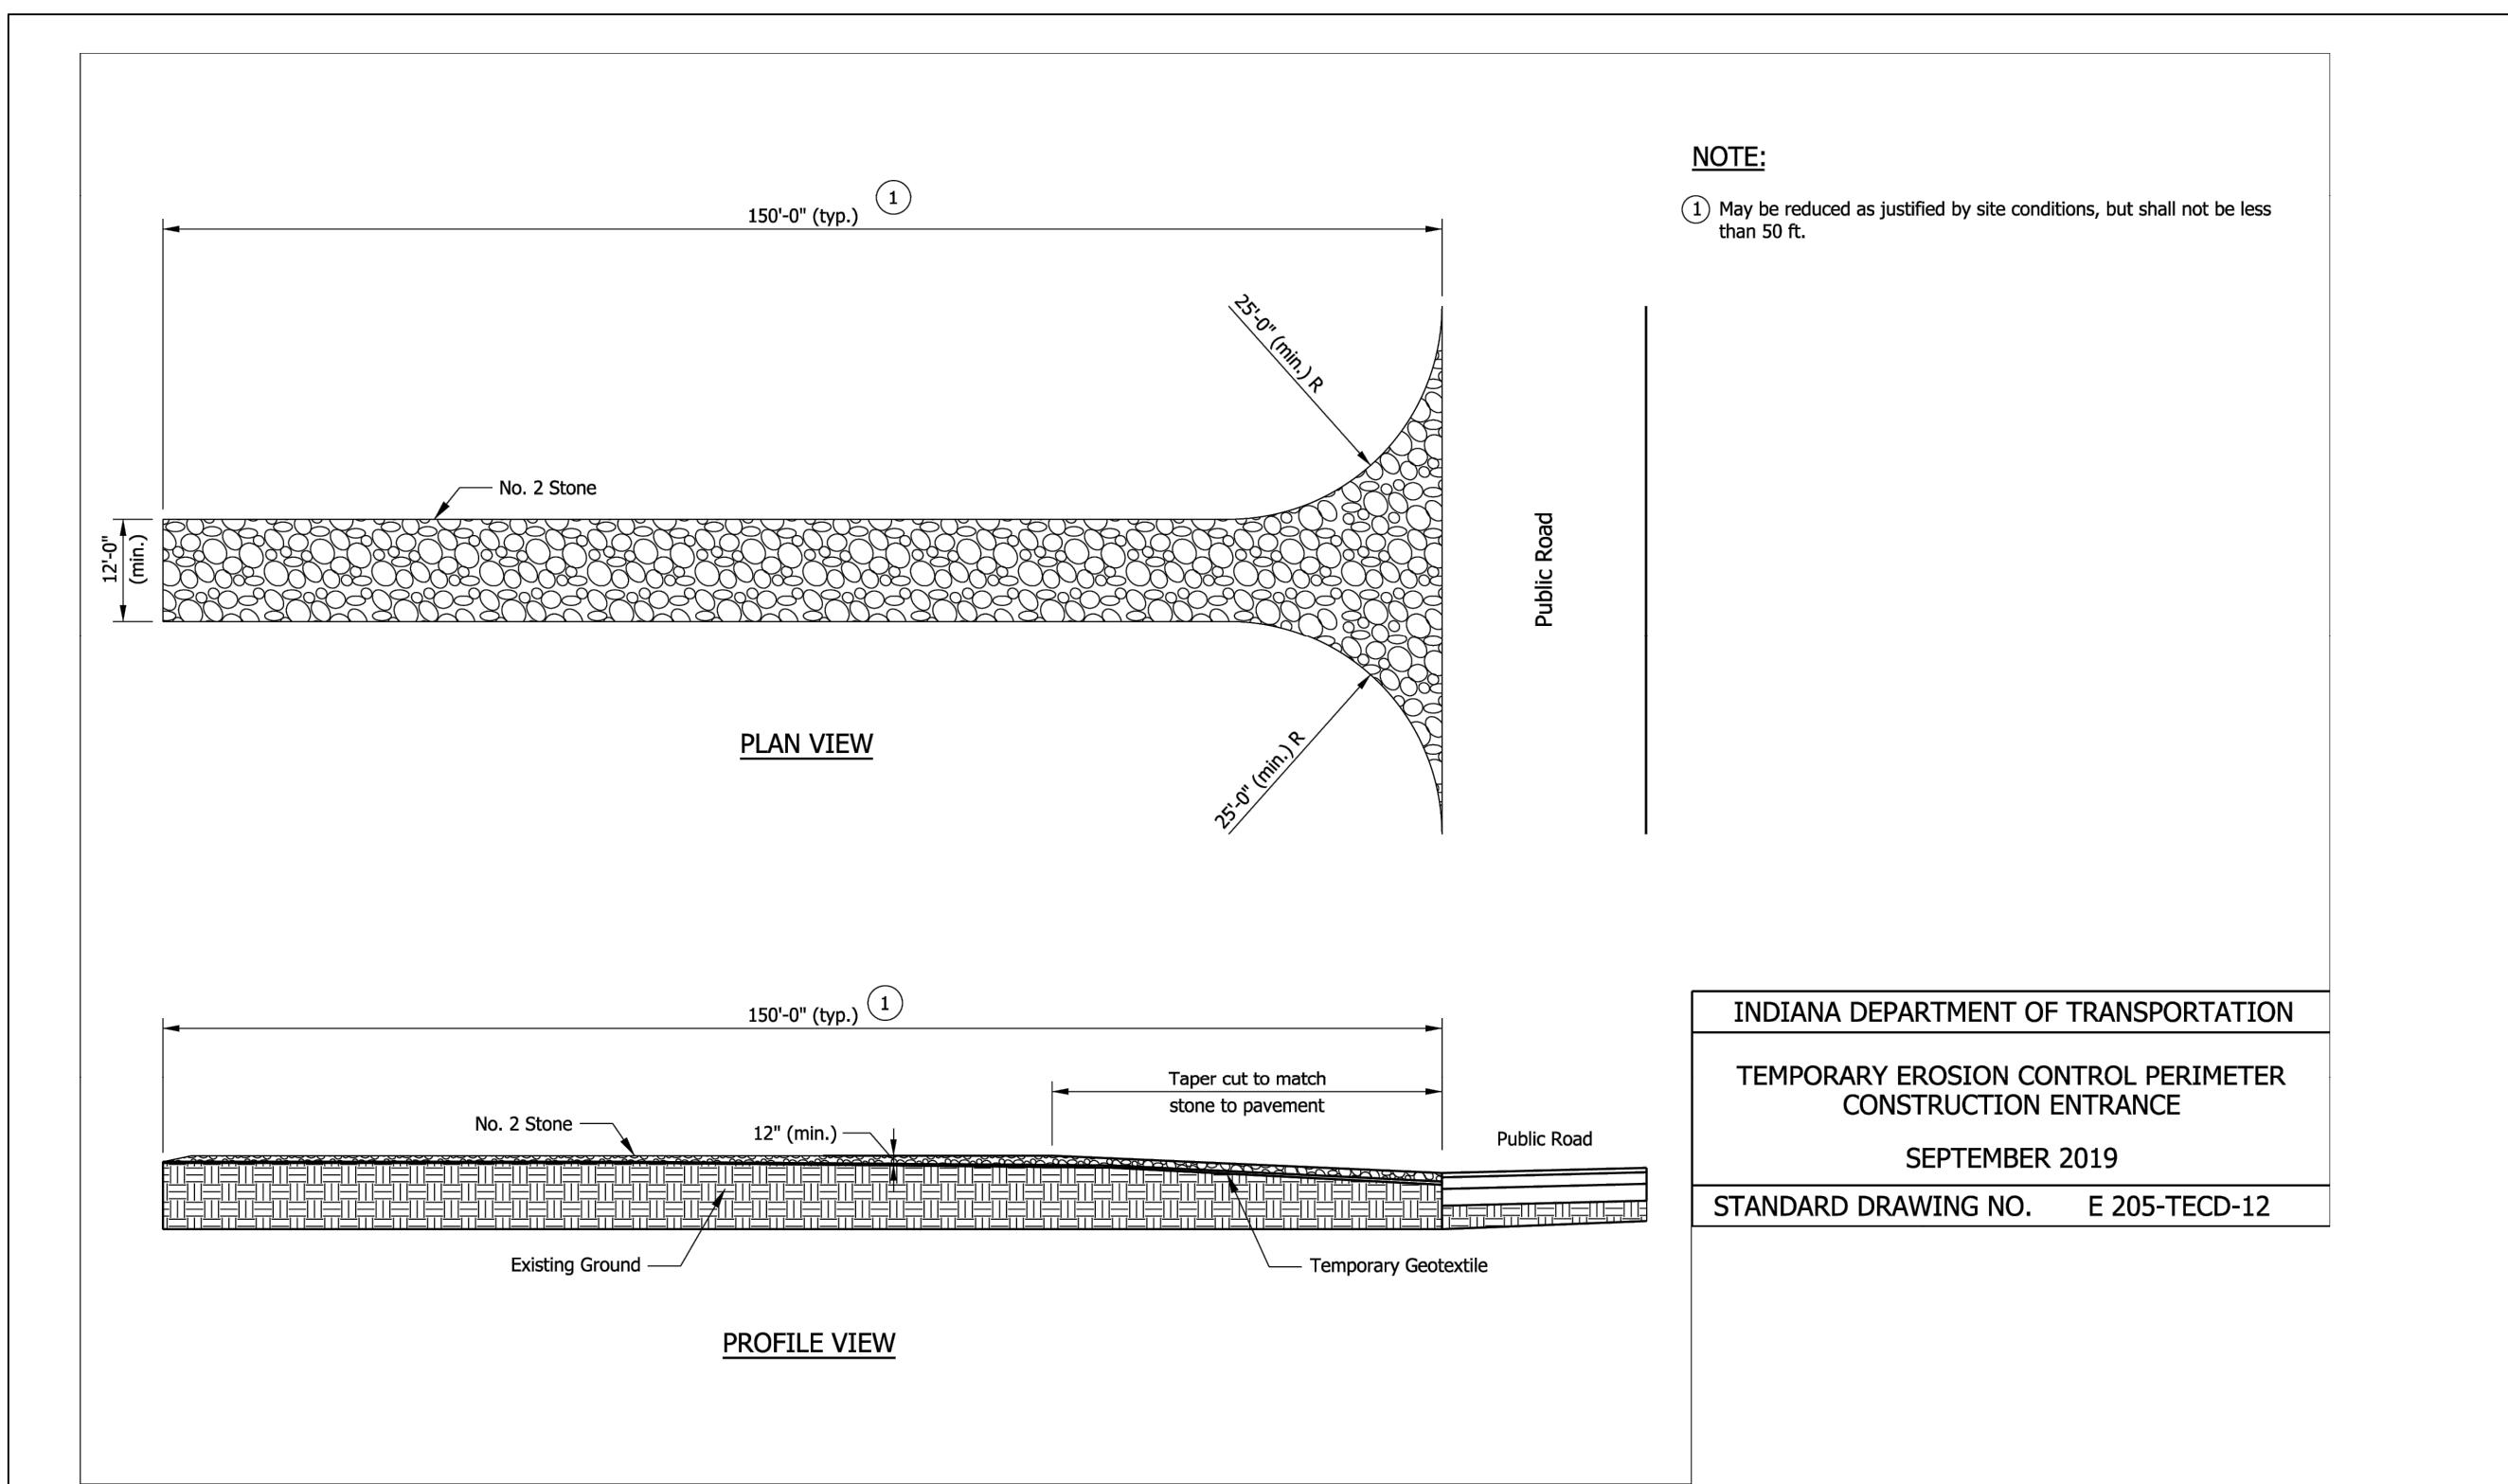


DATE: 1/15/2026
These Drawings and Specifications, and all copies thereof are and shall remain the property and copyright of the Engineer. They shall be used only with respect to this Project and are not to be used on any other Project or Work without prior written permission from the Engineer.



JQOL
QUALITY OF LIFE
8440 Allison Pointe Blvd.
Indianapolis, IN 46250
www.jqolusa.com

CONSTRUCTION DOCUMENT

SHERIDAN PUBLIC LIBRARY
PROJECT: 103 W 1ST ST.
PREPARED FOR: SHERIDAN, IN 46099
7222 N. SHADYLAND AVE. STE. 100
INDIANAPOLIS, IN 46250

ODILE MC GUIRE SHOOK ARCHITECTS
PROJECT NO: 2025.207
SHEET NAME: SWPPP DETAILS
SHEET ISSUE DATE: 15-Jan-26
SCALE: NO SCALE
DESIGNED: SB CHECKED: RS
SHEET NO: C-0.6
SHEET X OF X

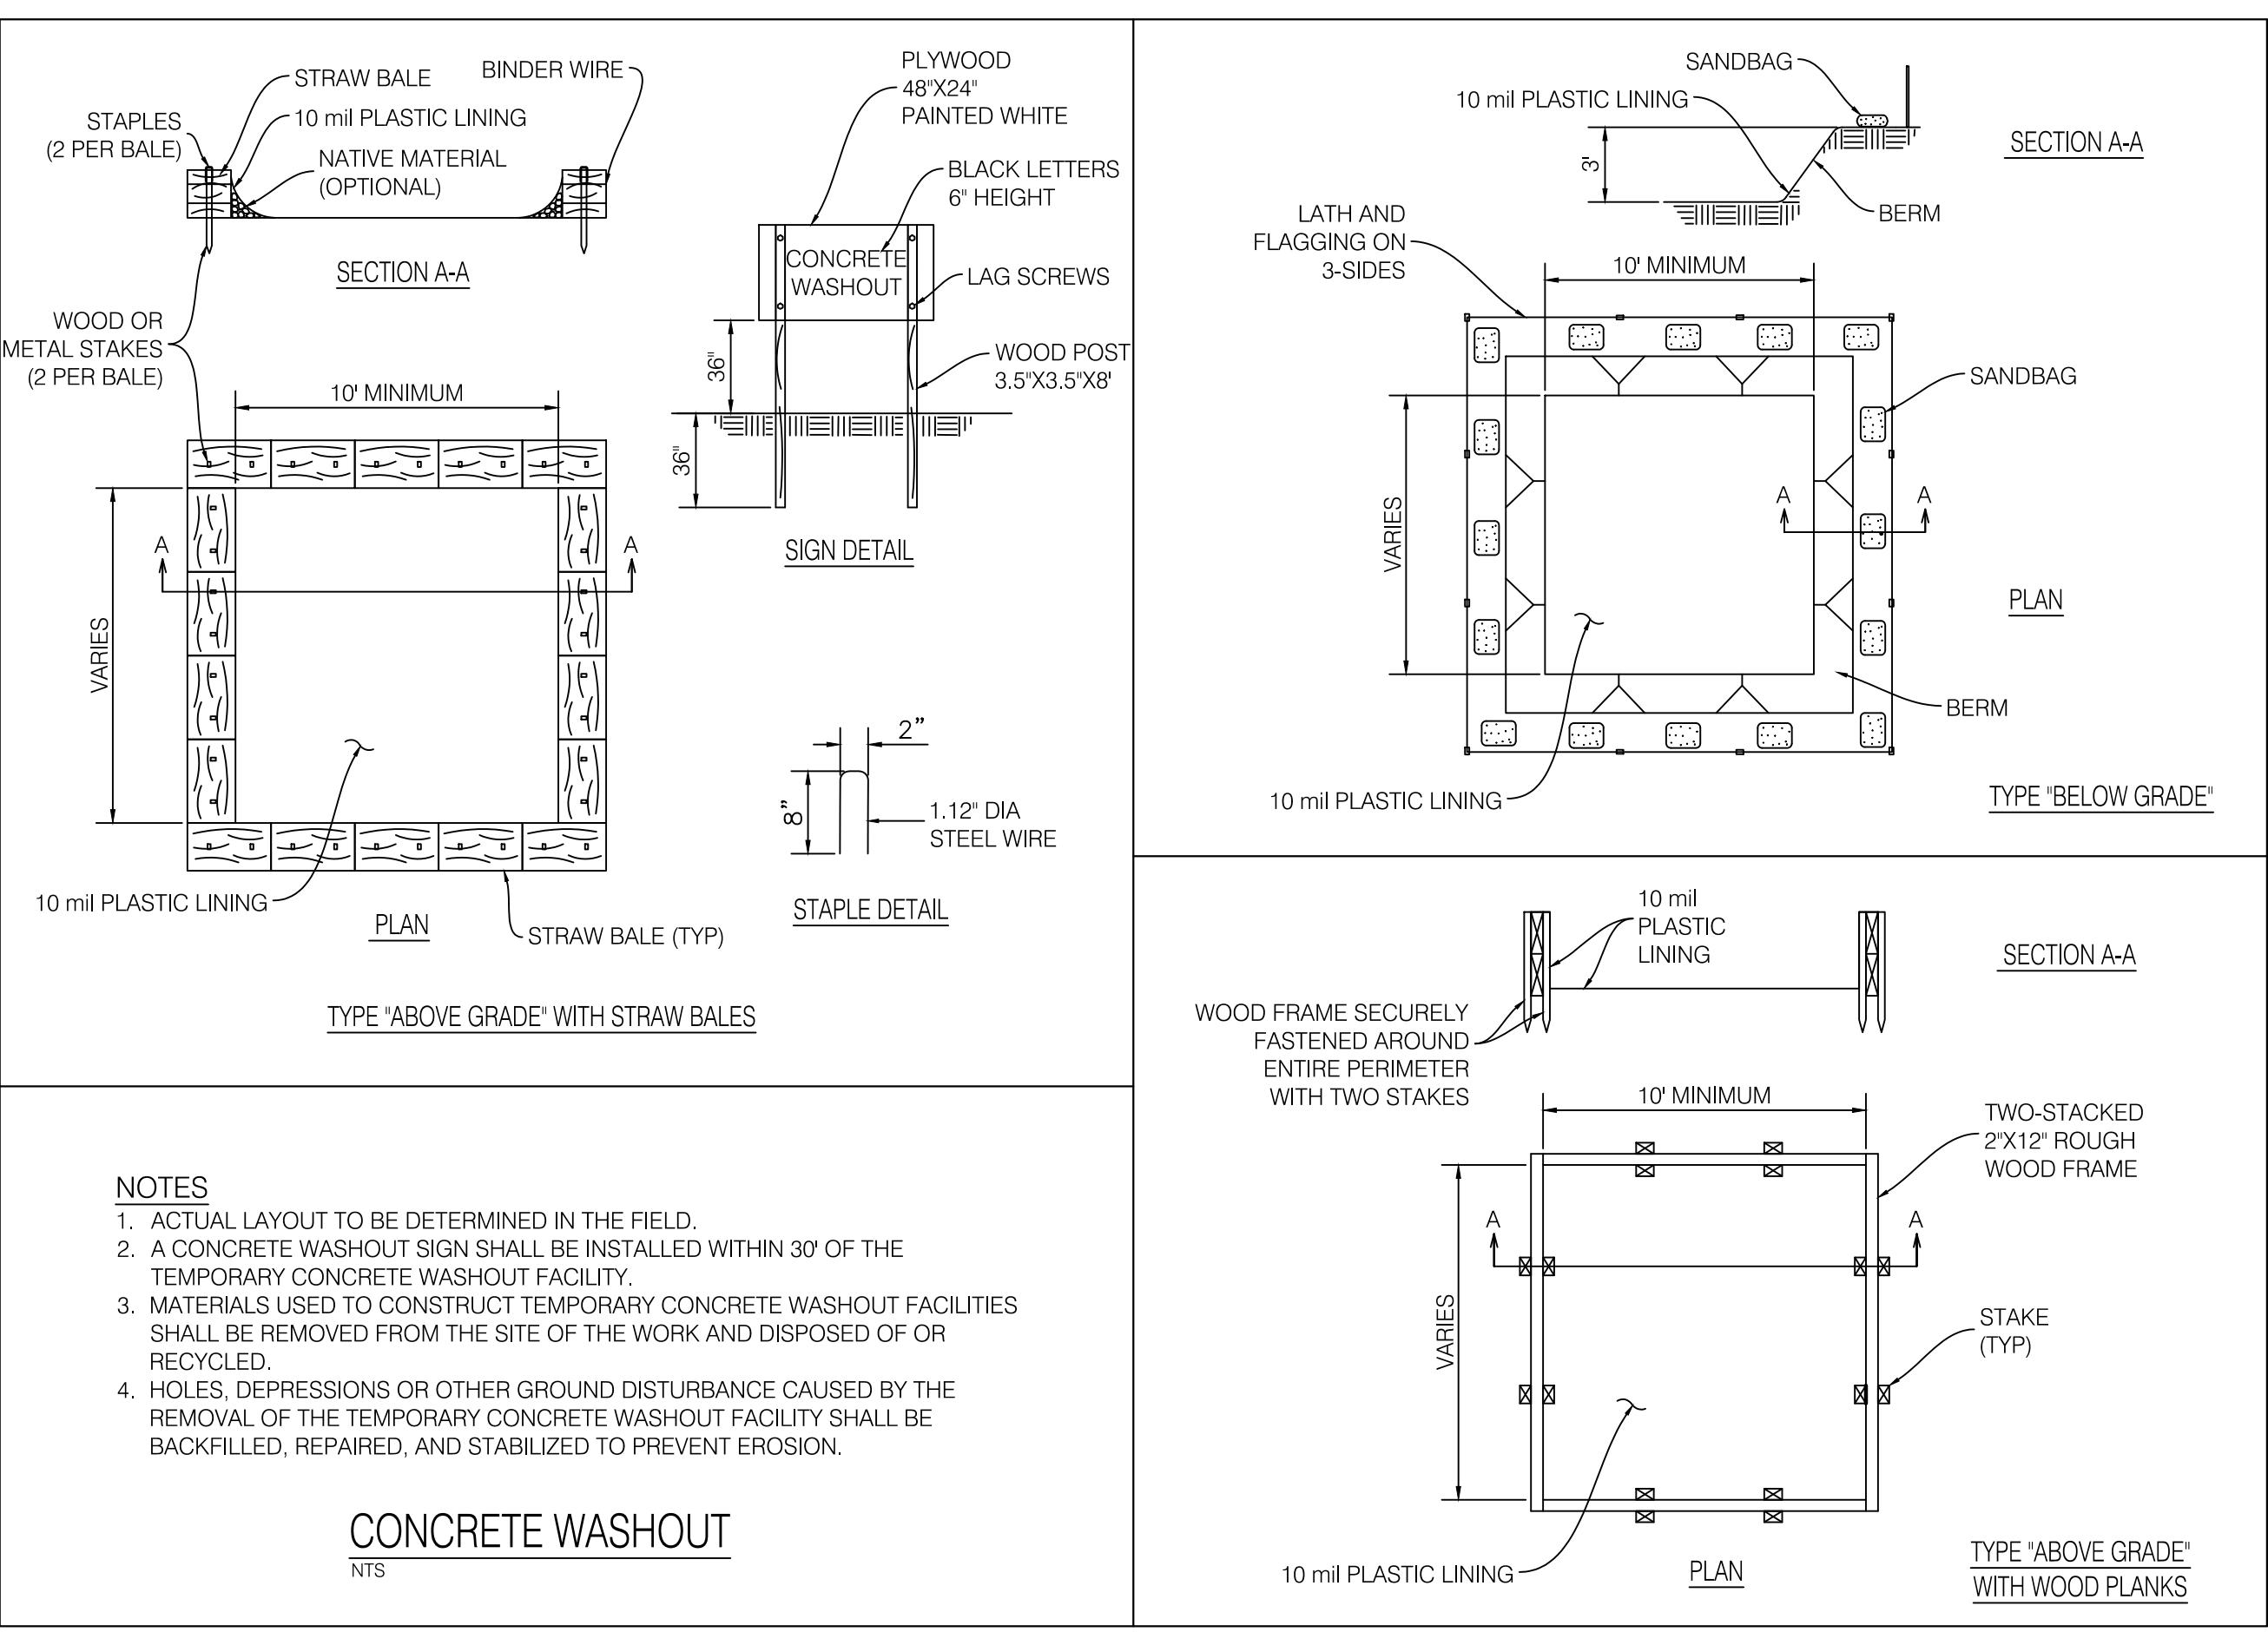

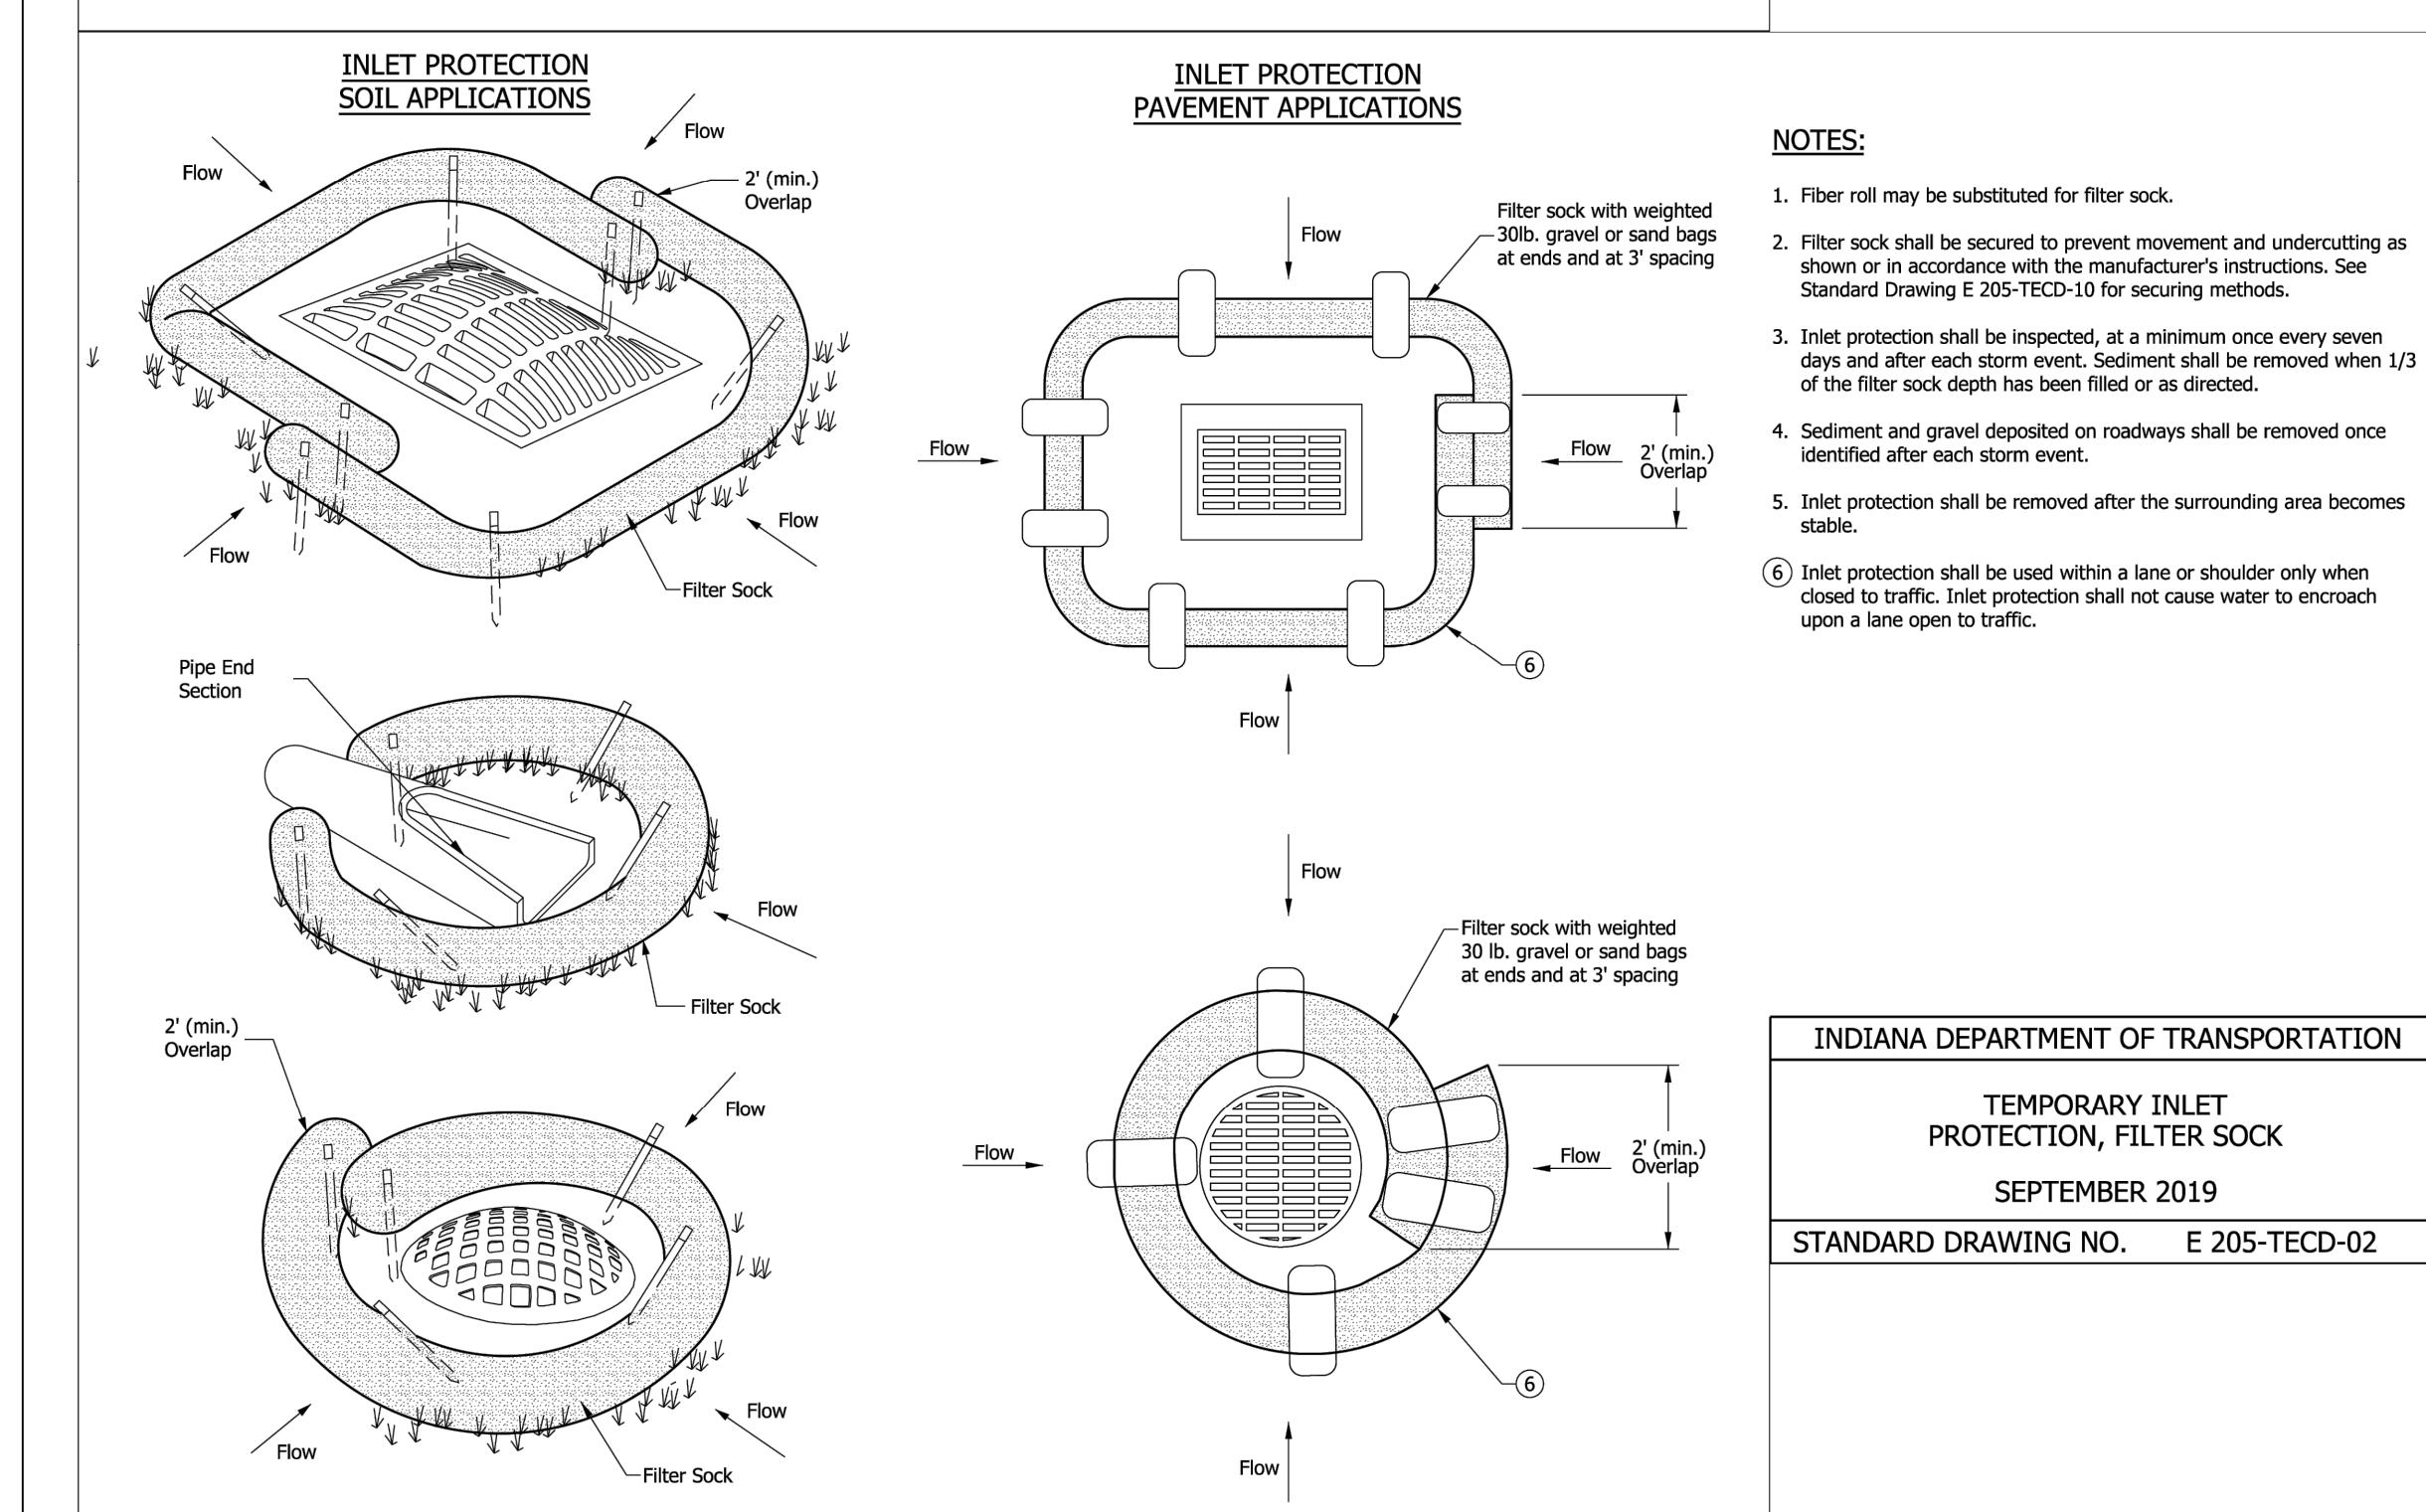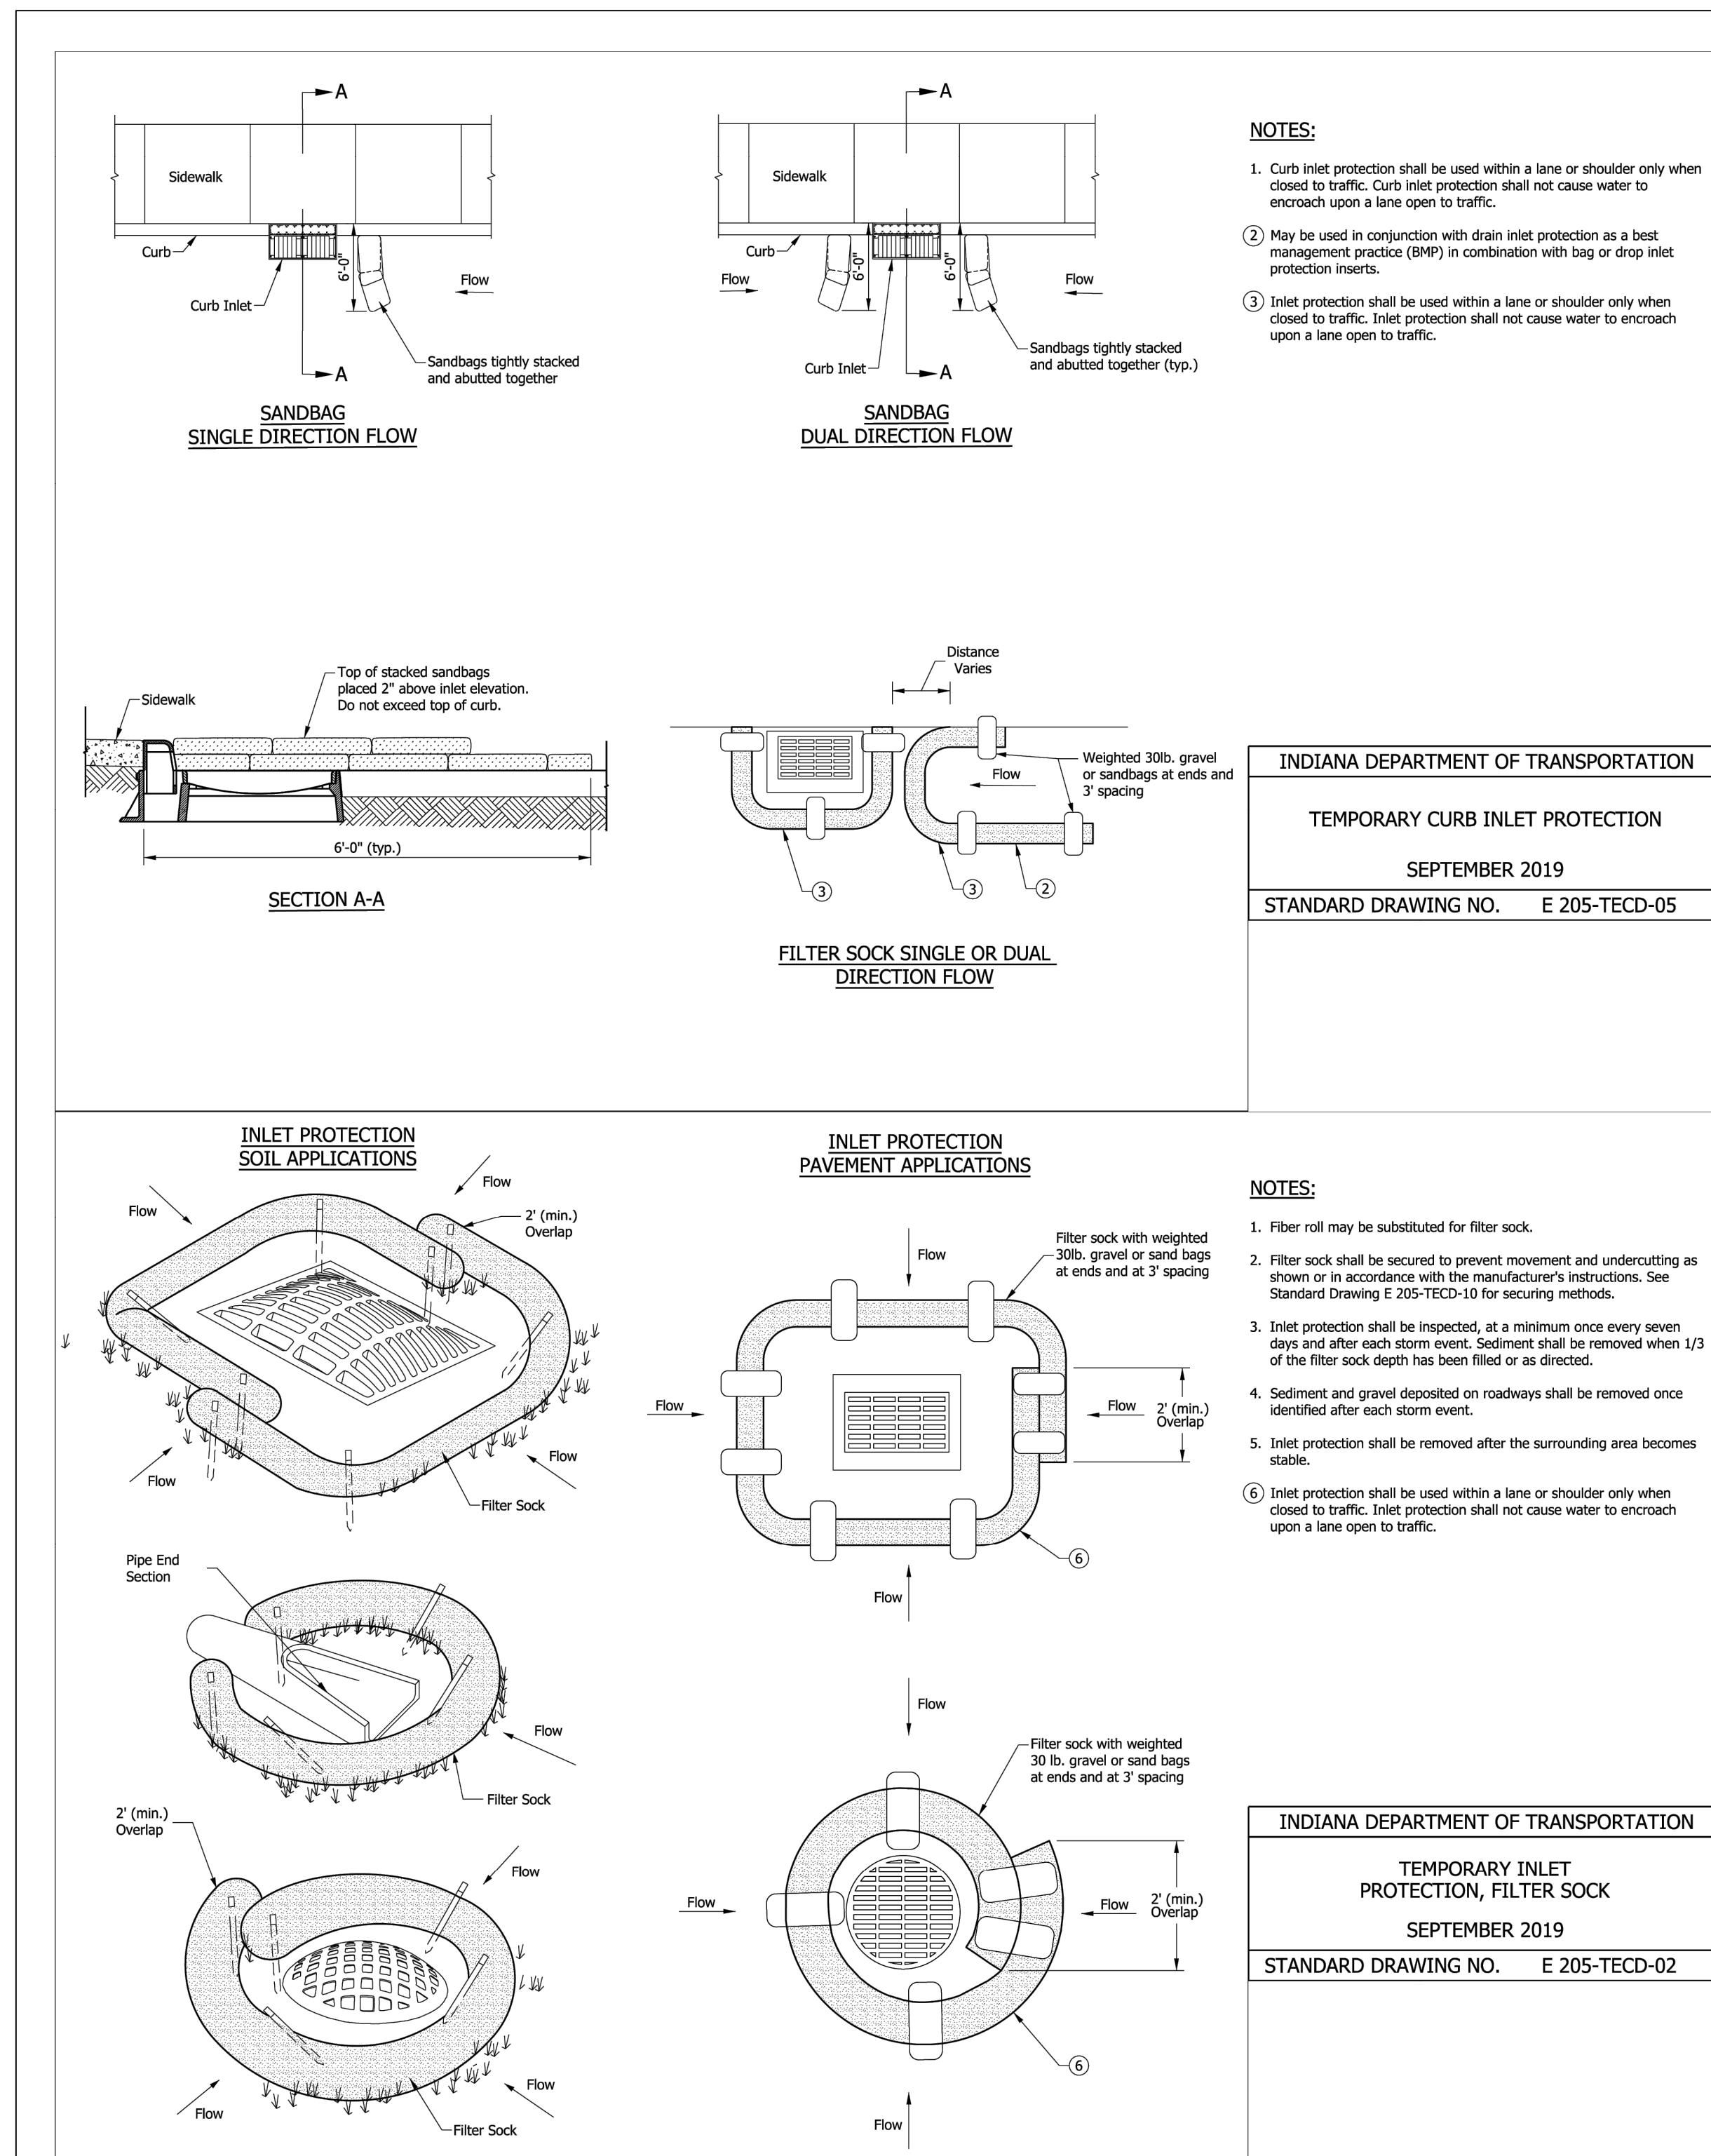


#	Revision	Date
1	ADD-1	01/29/26
2	-	-
3	-	-

PROJECT NO.: 2025.207

SHEET NAME:

SWPPP DETAILS



SHEET ISSUE DATE:	15-Jan-26	
SCALE:	NO SCALE	
DESIGNED:	SB	CHECKED: RS
SHEET NO.:	C-0.7	



Odle McGuire Shook

ARCHITECTURE INTERIOR DESIGN
LANDSCAPE ARCHITECTURE ENGINEERING
“A history of forward thinking...”

www.omscorp.net

7222 N Shadeland Avenue
Suite 100
Indianapolis, Indiana 46250
317.842.0000
Fax 317.917.0616
oms@omscorp.net

100%
CONSTRUCTION
DOCUMENTS



Matthew R. Mayol

<input type="text"/>	<input type="text"/>	<input type="text"/>
No.	Description	Date

REVISIONS

SHERIDAN PUBLIC LIBRARY BUILDING ADDITION, RENOVATIONS AND SITE IMPROVEMENTS


© Copyright 2026
by ODLE McGuire Shook
Copyright includes architectural work, building
design, plans or drawings, and specifications.
Architectural work is the overall form as well as
the arrangement and composition of spaces and
elements in the design. Reproduction without
written permission is prohibited.

Project number	25050
Date	01.15.26
Drawn by	AA
Checked by	MRM
Designed by	MRM

Designed by **MTK**

FIRST FLOOR DEMO PLAN & MEZZANINE DEMO PLAN

PLAN LEGEND

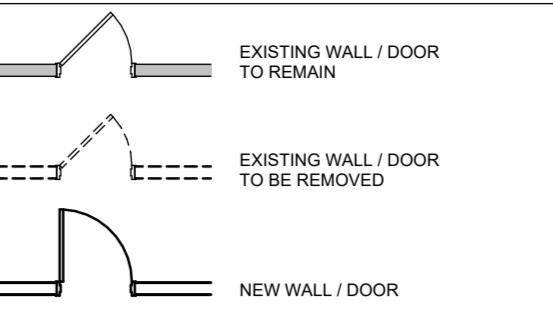

DEMOLITION PLAN GENERAL NOTES

DEMOLITION PLANS ARE INTENDED TO INDICATE GENERAL AREAS OF DEMOLITION. PROVIDE ADDITIONAL DEMOLITION AS REQUIRED TO PERMIT NEW CONSTRUCTION. REFERENCE SITE, STRUCTURAL, MECHANICAL, PLUMBING AND ELECTRICAL DRAWINGS FOR ADDITIONAL ITEMS TO BE DEMOLISHED AND FOR ADDITIONAL INFORMATION REQUIRED TO FULFILL NEW CONSTRUCTION REQUIREMENTS.

ALL CONTRACTORS SHALL VERIFY ALL DIMENSIONS AND EXISTING CONDITIONS AT PROJECT SITE AND REPORT ANY DISCREPANCIES TO ARCHITECT PRIOR TO STARTING THE WORK.

WHERE REMOVAL OF ITEMS LEAVES HOLES AND DAMAGED SURFACES THAT WILL BE EXPOSED IN FINISHED WORK, PATCH AND REPAIR TO MATCH ADJACENT FINISHED SURFACES.

VERIFY DIMENSIONS AND LOCATIONS OF NEW OPENINGS TO BE CUT WITH NEW WORK PLANS AND DOOR SCHEDULES. ALL CUTTING AND PATCHING REQUIRED FOR REMOVAL OF EXISTING MATERIAL AND EQUIPMENT AND INSTALLATION OF NEW WORK SHALL BE EXECUTED BY THE CONTRACTOR PERFORMING THE RESPECTIVE WORK AND SHALL BE PROPERLY COORDINATED BETWEEN ALL TRADES.

ITEMS INDICATED WITH 'DASHED' OR 'BROKEN' LINES SHALL BE REMOVED, EVEN IF NOT SPECIFICALLY NOTED BY KEYNOTE.

SECURE STRUCTURE AND PROVIDE TEMPORARY SUPPORT WHEN REMOVING ITEMS. IMMEDIATELY REPORT ANY STRUCTURAL DAMAGE TO ARCHITECT.

MATERIALS OR ITEMS DESIGNATED TO BE REINSTALLED SHALL BE REMOVED WITH CARE UNDER THE SUPERVISION OF THE TRADE RESPONSIBLE FOR REINSTALLATION. ITEMS SHALL BE CLEANED, PROTECTED AND PLACED IN STORAGE UNTIL ITEMS ARE READY TO BE REINSTALLED. IF ITEM IS DAMAGED, IT SHALL BE RESTORED TO ITS ORIGINAL CONDITION OR REPLACED WITH NEW ITEMS AS APPROVED BY THE ARCHITECT.


ALL CONTRACTORS SHALL COORDINATE THEIR WORK SCHEDULE, SO THAT DEMOLITION AND NEW CONSTRUCTION DOES NOT INTERFERE WITH THE DAILY OPERATION OF THE SITE. ALL WORK SHALL BE COORDINATED WITH THE OWNER'S REPRESENTATIVE AND WITH THE REQUIREMENTS OF SECTION 01040 OF THE SPECIFICATIONS.

ALL CONTRACTORS SHALL CHECK ALL SPECIFICATIONS, SCHEDULES, PLANS, DETAILS SECTIONS, ETC., FOR EXTENT OF REMODEL AND DEMOLITION WORK.

ALL CONTRACTORS SHALL CHECK ALL SPECIFICATIONS, SCHEDULES, PLANS, DETAILS SECTIONS, ETC., FOR EXTENT OF REMODEL AND DEMOLITION WORK. REF. SPECIFICATION SECTION 024119 SELECTIVE DEMOLITION.

DEMO PLAN NOTES

NO WORK THIS AREA
REMOVE CASEWORK COMPLETE.
REMOVE BUILT IN BOOK SHELVES COMPLETE.
CAP & MAKE SAFE POWER REF. 'E' SERIES DWGS.
REMOVE PLUMBING FIXTURES, PARTITIONS & ACCESSORIES COMPLETE. SALVAGE BABY CHANGER IN WOMENS 103.
REMOVE AND RELOCATE GAS METER. REF MEP DWGS.
REMOVE WALL, DOOR & FRAME THIS LOCATION.
REMOVE CASEWORK, APPLIANCES AND OVERHEAD COILING SHUTTER COMPLETE.
REMOVE DOWNSPOUT COMPLETE.
REMOVE DRINKING FOUNTAIN COMPLETE.
REMOVE HARDWARE COMPLETE. PREP FOR NEW WORK.
REMOVE DOOR, FRAME & SIDELITE COMPLETE.
REMOVE BORROWED LIGHT COMPLETE.
REMOVE FLIPPER DOORS COMPLETE.
REMOVE WALL COVERING AND EXISTING 5/8" DRYWALL COMPLETE.
SALVAGE EX. WOOD FLOOR AND WOOD BASE THIS AREA.
REMOVE EX POWER DATA. REF 'E' SERIES DWGS. CONTRACTORS OPTION TO SALVAGE FLOOR BOX TO REINSTALL IN NEW LOCATION. PREP FOR WOOD FLOOR PATCH & REPAIR.
TRENCH CONCRETE FLOOR FOR NEW POWER/DATA THIS LOCATION. REF. 'E' SERIES DWGS.
REMOVE WOOD CIRC. DESK COMPLETE.
REMOVE CEILING COMPLETE.
REMOVE FLOORING AND WALL BASE COMPLETE.
REMOVE CASEWORK COMPLETE. CAP & MAKE SAFE POWER/DATA. REF 'E' SERIES DWGS.
CERAMIC TILE FLOOR TO REMAIN.
PROTECT WOOD FLOOR & BASE THIS AREA DURING CONSTRUCTION.
REMOVE DAMAGED FLOOR TILE THIS AREA.
REMOVE FLOORING COMPLETE. WOOD WALL BASE TO REMAIN COMPLETE THIS AREA.
NOT USED
REMOVE LOCKERS COMPLETE.
REMOVE OUTDOOR BENCH COMPLETE THIS LOCATION.
PROTECT MEMORIAL BENCH DURING PERGOLA SHADE STRUCTURE INSTALL.
REMOVE 12" H OF DRYWALL TO VERIFY SILL PLATE BOLTED CONNECTIONS AND LOCATIONS THIS AREA. PROVIDE IN WRITING WITH PHOTOS BOLT SIZE AND LOCATIONS TO THE ARCHITECT / STRUCTURAL ENGINEER PRIOR TO PROCEEDING WITH NEW WORK.
REMOVE WHITE BOARD.
REMOVE WALL SCONCE OR PENDANT COMPLETE. REF 'E' SERIES DWGS.
REMOVE EXTERIOR WALL MOUNTED LIGHTING FIXTURE COMPLETE. PREP FOR NEW WORK.
REMOVE WALL CASING THIS LOCATION. PREP FOR NEW WORK.
REMOVE REFRIGERATOR.
REMOVE WALL MOUNTED COAT RACK
RELOCATE BUILT IN BOOKSHELF TO CHILDREN'S AREA 120 BY GC.

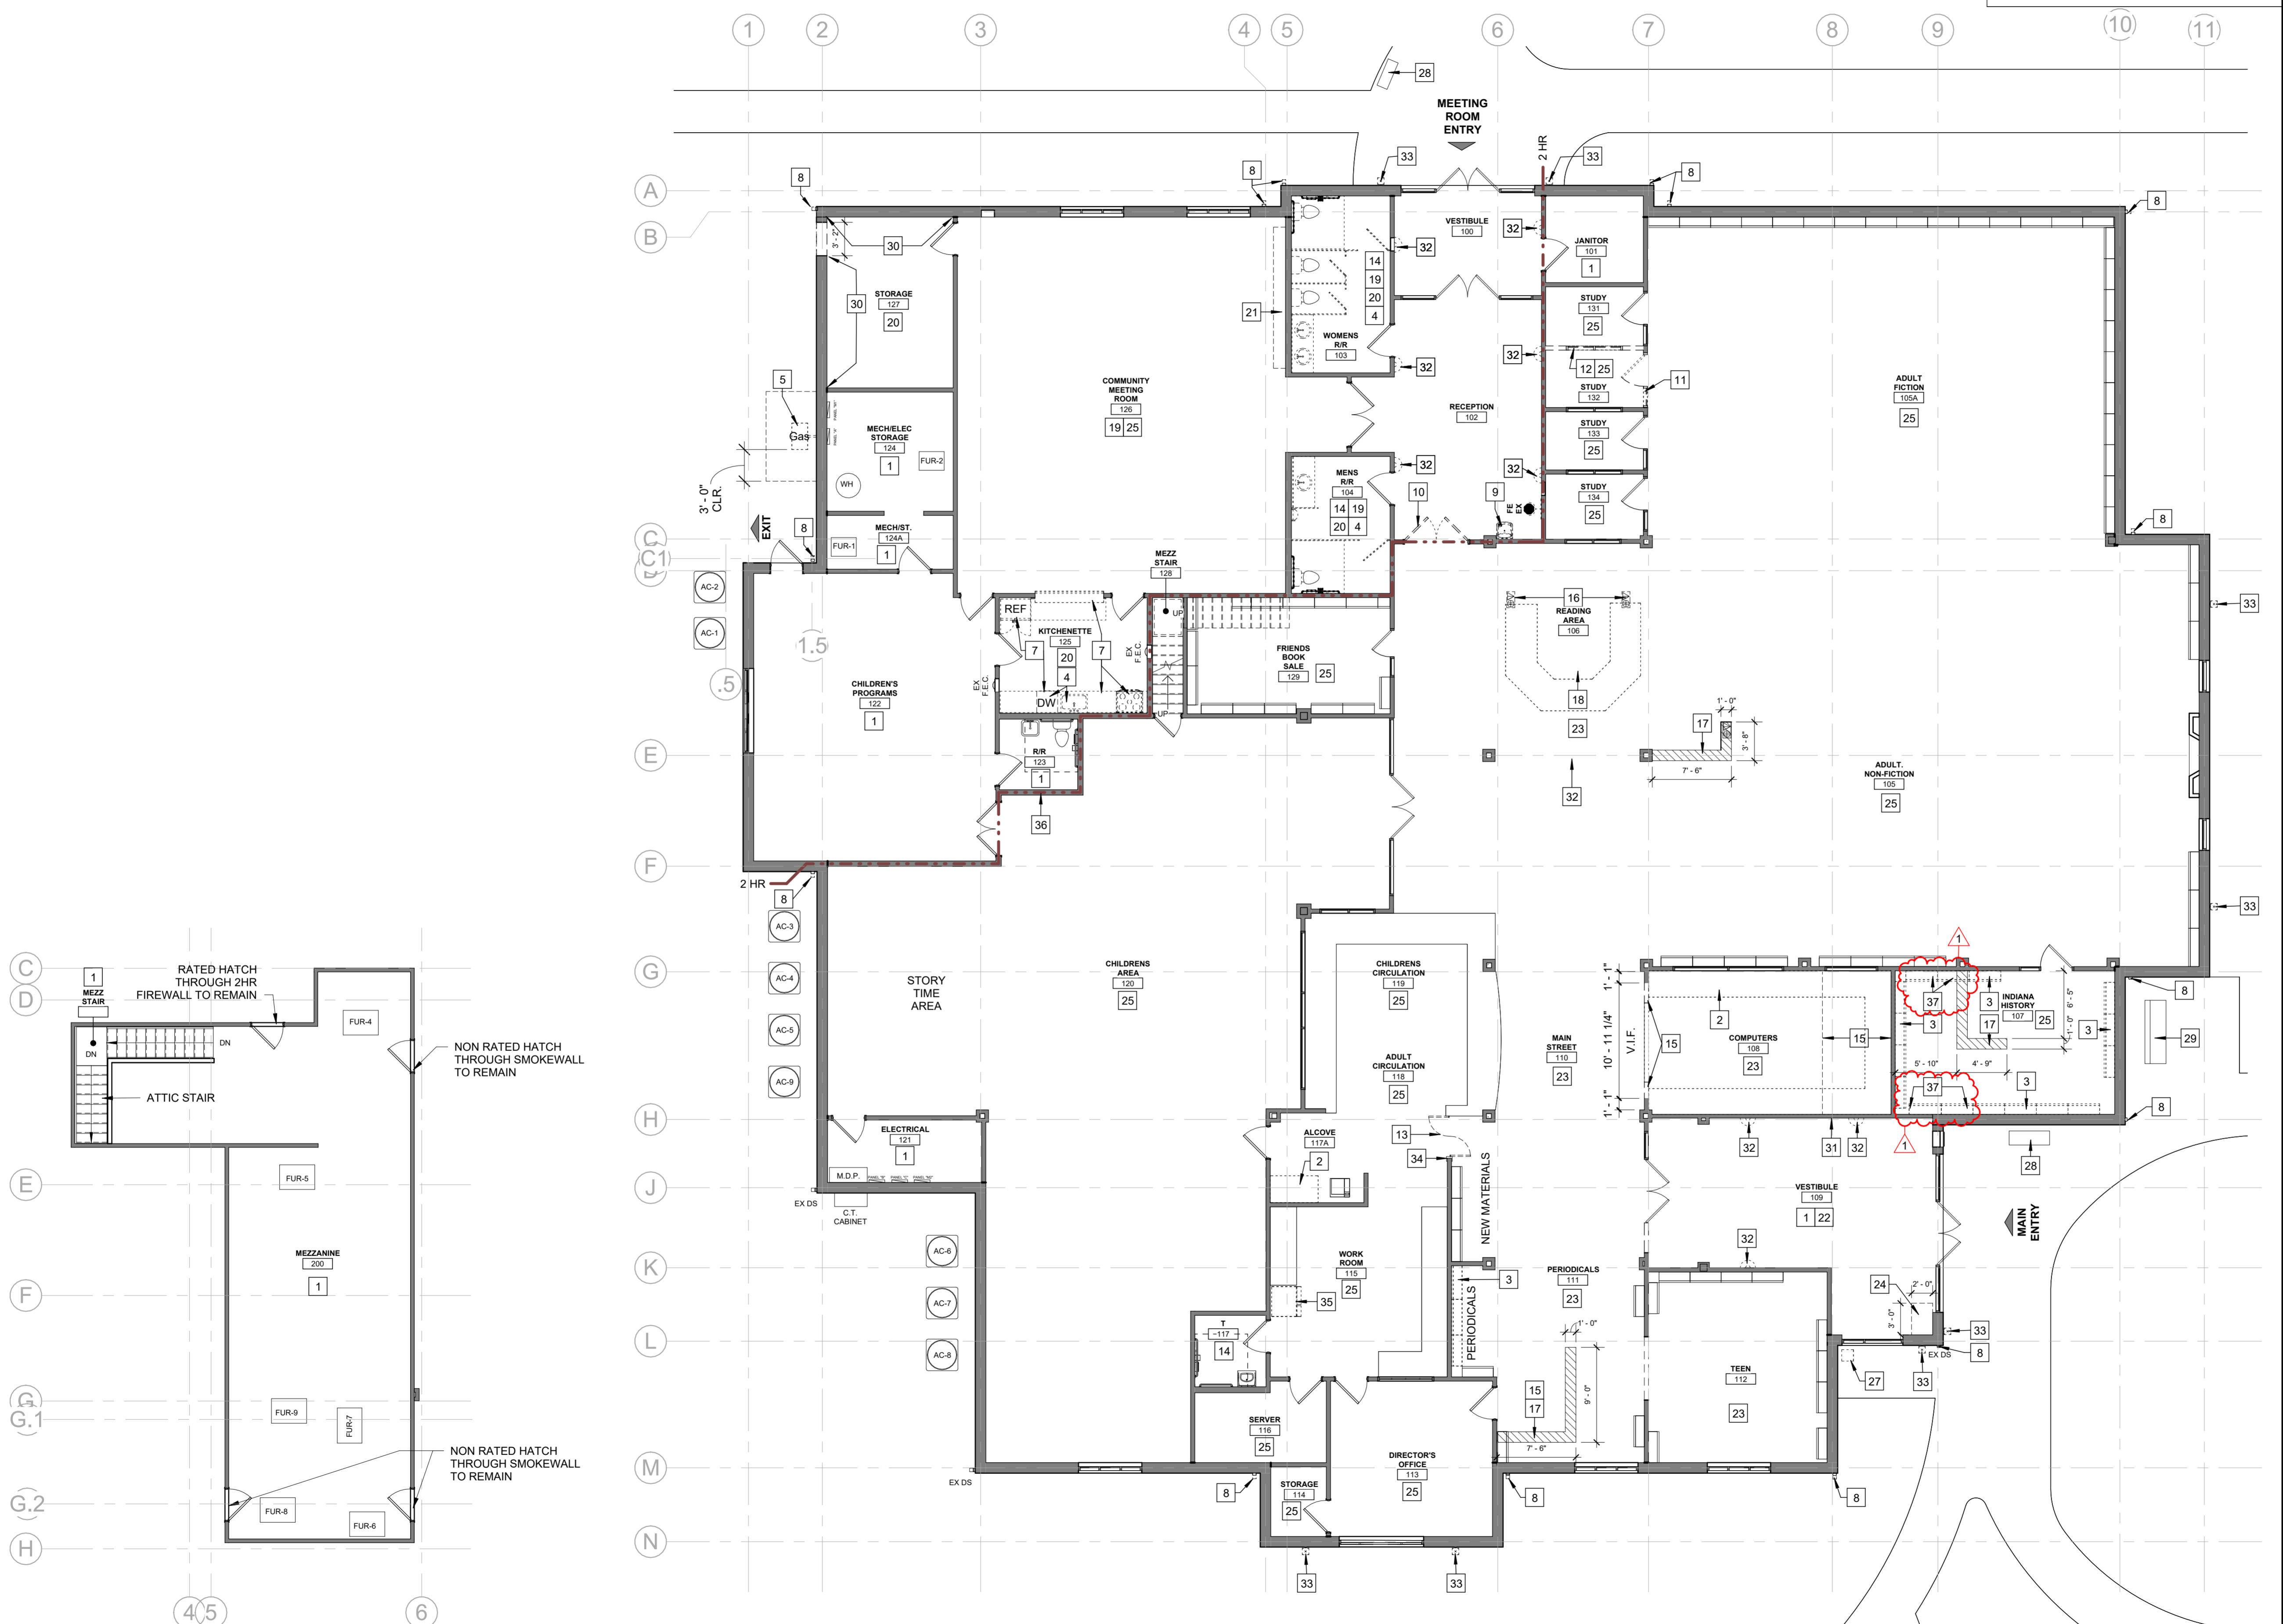

MEZZANINE DEMO PLAN

2

FIRST

FIRST FLOOR DEMO PLAN


1

SCALE: 1/8" = 1'-0"

ALE: $1/8" = 1'-0"$

GENERAL NOTES

- A. FIELD VERIFY ALL DIMENSIONS, EXISTING CONDITIONS AND LOCATIONS PRIOR TO STARTING ANY WORK. REPORT ANY DISCREPANCIES TO ARCHITECT.
- B. DIMENSIONS SHOWN ARE FROM FACE OF FINISHED WALL OR CENTERLINE OF STRUCTURE. DIMENSIONS ARE NOMINAL.
- C. REFER TO STRUCTURAL FOR SCHEDULES REFER TO MECHANICAL, PLUMBING AND ELECTRICAL DRAWINGS FOR SIZE AND LOCATION OF REQUIRED OPENINGS; PROVIDE LINTELS AS REQUIRED.
- D. REFERENCE ROOM FINISH SCHEDULE FOR FINISHES.
- E. REFERENCE REFLECTED CEILING PLANS FOR WALLS TO DECK, FIRE-RATED WALLS AND CEILING HEIGHTS.
- F. CONTRACTOR TO COORDINATE WORK WITH OTHER TRADES PRIOR TO STARTING ANY WORK.
- G. APPLIANCES ARE OWNER PROVIDED, CONTRACTOR INSTALLED. COORDINATE PRIOR TO INSTALLATION. REF APPLIANCE SCHEDULE AND 'P' SERIES SHEETS FOR APPLIANCE SPECIFICATIONS.

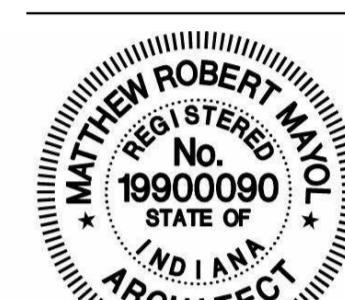 100%
CONSTRUCTION
DOCUMENTS

 Matthew R. Mayol
CERTIFIED

No. Description Date

1 ADD-1 01/29/2026

REVISIONS

SHERIDAN PUBLIC LIBRARY BUILDING ADDITION, RENOVATIONS AND SITE IMPROVEMENTS

103 W 1ST ST, SHERIDAN, IN 46069, HAMILTON COUNTY

 © Copyright 2026
by ODE E. McGuire Shook
Copyright includes architectural work, building design, plans or drawings, and specifications. Architect work in the overall form as well as the arrangement and grouping of parts and elements in the design. Reproduction without written permission is prohibited.

 Project number 25050
Date 01.15.26

 Drawn by AA
Checked by MRM
Designed by MRM

1/29/2026 2:59:39 PM


A101

 FIRST FLOOR PLAN &
MEZZANINE FLOOR PLAN

PLAN NOTES

1. NO WORK THIS AREA
2. RETROFIT ALUM DOORS / FRAMES W/ NEW HANDICAP ACCESSIBLE PUSH BUTTONS THIS LOCATION. COLOR: DARK BRONZE.
3. NOT USED
4. HIGH LOW DRINKING FOUNTAIN W/ BOTTLE FILLER. REF 'P' SERIES DWGS.
5. WOOD POST COLUMN W/ ALUM. CLADDING TO MATCH GUTTERS.
6. INSTALL OWNER PROVIDED ATTIC STOCK CERAMIC WALL TILE 12" A.F.F. W/ SCHLUTER TRIM W/T-1.
7. NEW GATE REF DTLs.
8. PATCH AND REPAIR WOOD FLOOR THIS LOCATION. USE WOOD FLOORING SALVAGED FROM COMPUTERS / LIBRARY OF THINGS 108A.
9. NEW FLOOR POWER & DATA. REF 'E' SERIES DWGS.
10. INFILL CONC. SLAB THIS LOCATION. REF 'E' SERIES DWGS. PREP FOR NEW FLOOR FINISH.
11. PATCH & REPAIR FLOOR, WALL & CEILING THIS LOCATION.
12. REPLACE CERAMIC FLOOR TILE THIS AREA WITH OWNER PROVIDED MATCHING ATTIC STOCK TILES. DWGS.
13. NEW BULKHEAD / SLIDE STRUCTURE. REF SPEC. PROTECT EXISTING MEMORIAL BENCH DURING CONSTRUCTION.
14. NEW DOWNSPOUT. CONTRACTOR OPTION TO TIE INTO EXISTING UNDERGROUND SYSTEM OR DAYLIGHT TO THE WEST.
15. PATCH, REPAIR & PAINT DRYWALL THIS LOCATION DUE TO REMOVAL OF WALL SCONCE.
16. NEW REFRIGERATOR.
17. NEW BULKHEAD. REF DTL. 8/A003.
18. PATCH / REPAIR / CLEAN CONCRETE THIS LOCATION.
19. REINSTALL BOOKSHELF FROM INDIANA HISTORY 107. CONNECT POWER IN SHELF BASE. REF 'E' SERIES DWGS.

PLAN LEGEND

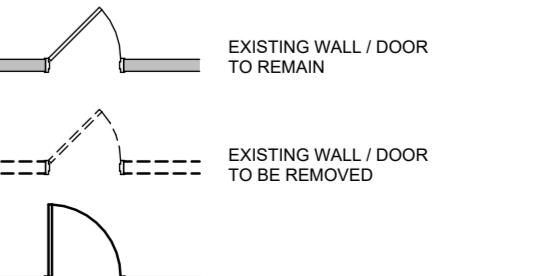

FIRST FLOOR PLAN

SCALE: 1/8" = 1'-0"

1



MEZZANINE PLAN

SCALE: 1/4" = 1'-0"

2





Matthew R. Mayol
CERTIFIED

No.	Description	Date
1	ADD-1	01/29/2026

REVISIONS

	EXISTING SUSPENDED ACOUSTICAL TILE
	NEW SUSPENDED ACOUSTICAL TILE - SEE ROOM FINISH SCHEDULE FOR TYPE
	EXISTING GYPSUM BOARD CEILING
	NEW GYPSUM BOARD CEILING, REFER TO FINISH SCHEDULE
	0'-0" CEILING ELEVATION ABOVE FINISH FLOOR
	REMOVE EXISTING SUPPLY GRILL. REF 'M' SERIES DWGS.
	EXISTING SUPPLY GRILL TO REMAIN. REF 'M' SERIES DWGS.
	NEW SUPPLY GRILL. REF 'M' SERIES DWGS.
	REMOVE EXISTING RETURN GRILL. REF 'M' SERIES DWGS.
	EXISTING RETURN GRILL TO REMAIN. REF 'M' SERIES DWGS.
	NEW RETURN GRILL. REF 'M' SERIES DWGS.
	2x2' FLAT PANEL LED. REF 'E' SERIES DWGS.
	2x4' FLAT PANEL LED. REF 'E' SERIES DWGS.
	STRIP FIXTURE. REF 'E' SERIES DWGS.
	DECORATIVE PENDANT. REF 'E' SERIES DWGS.
	DECORATIVE FIXTURE. REF 'E' SERIES DWGS.
	CAN LIGHT. REF 'E' SERIES DWGS.
	WALL SCONCE. REF 'E' SERIES DWGS.
	SECURITY CAMERA.

SHERIDAN PUBLIC LIBRARY BUILDING
ADDITION, RENOVATIONS AND SITE
IMPROVEMENTS

103 W 1ST ST, SHERIDAN, IN 46069, HAMILTON COUNTY

© Copyright 2026
by ODE McGuire Shook
Copyright includes architectural work, building
design, plans or drawings, and specifications.
Architects work in the overall form as well as the
arrangement and placement of furniture and
elements in the design. Reproduction without
written permission is prohibited.


Project number 25050
Date 01.15.26
Drawn by AA
Checked by MRM
Designed by MRM
A102
FIRST FLOOR RCP



FIRST FLOOR

SCALE: 1/8" = 1'-0"

1

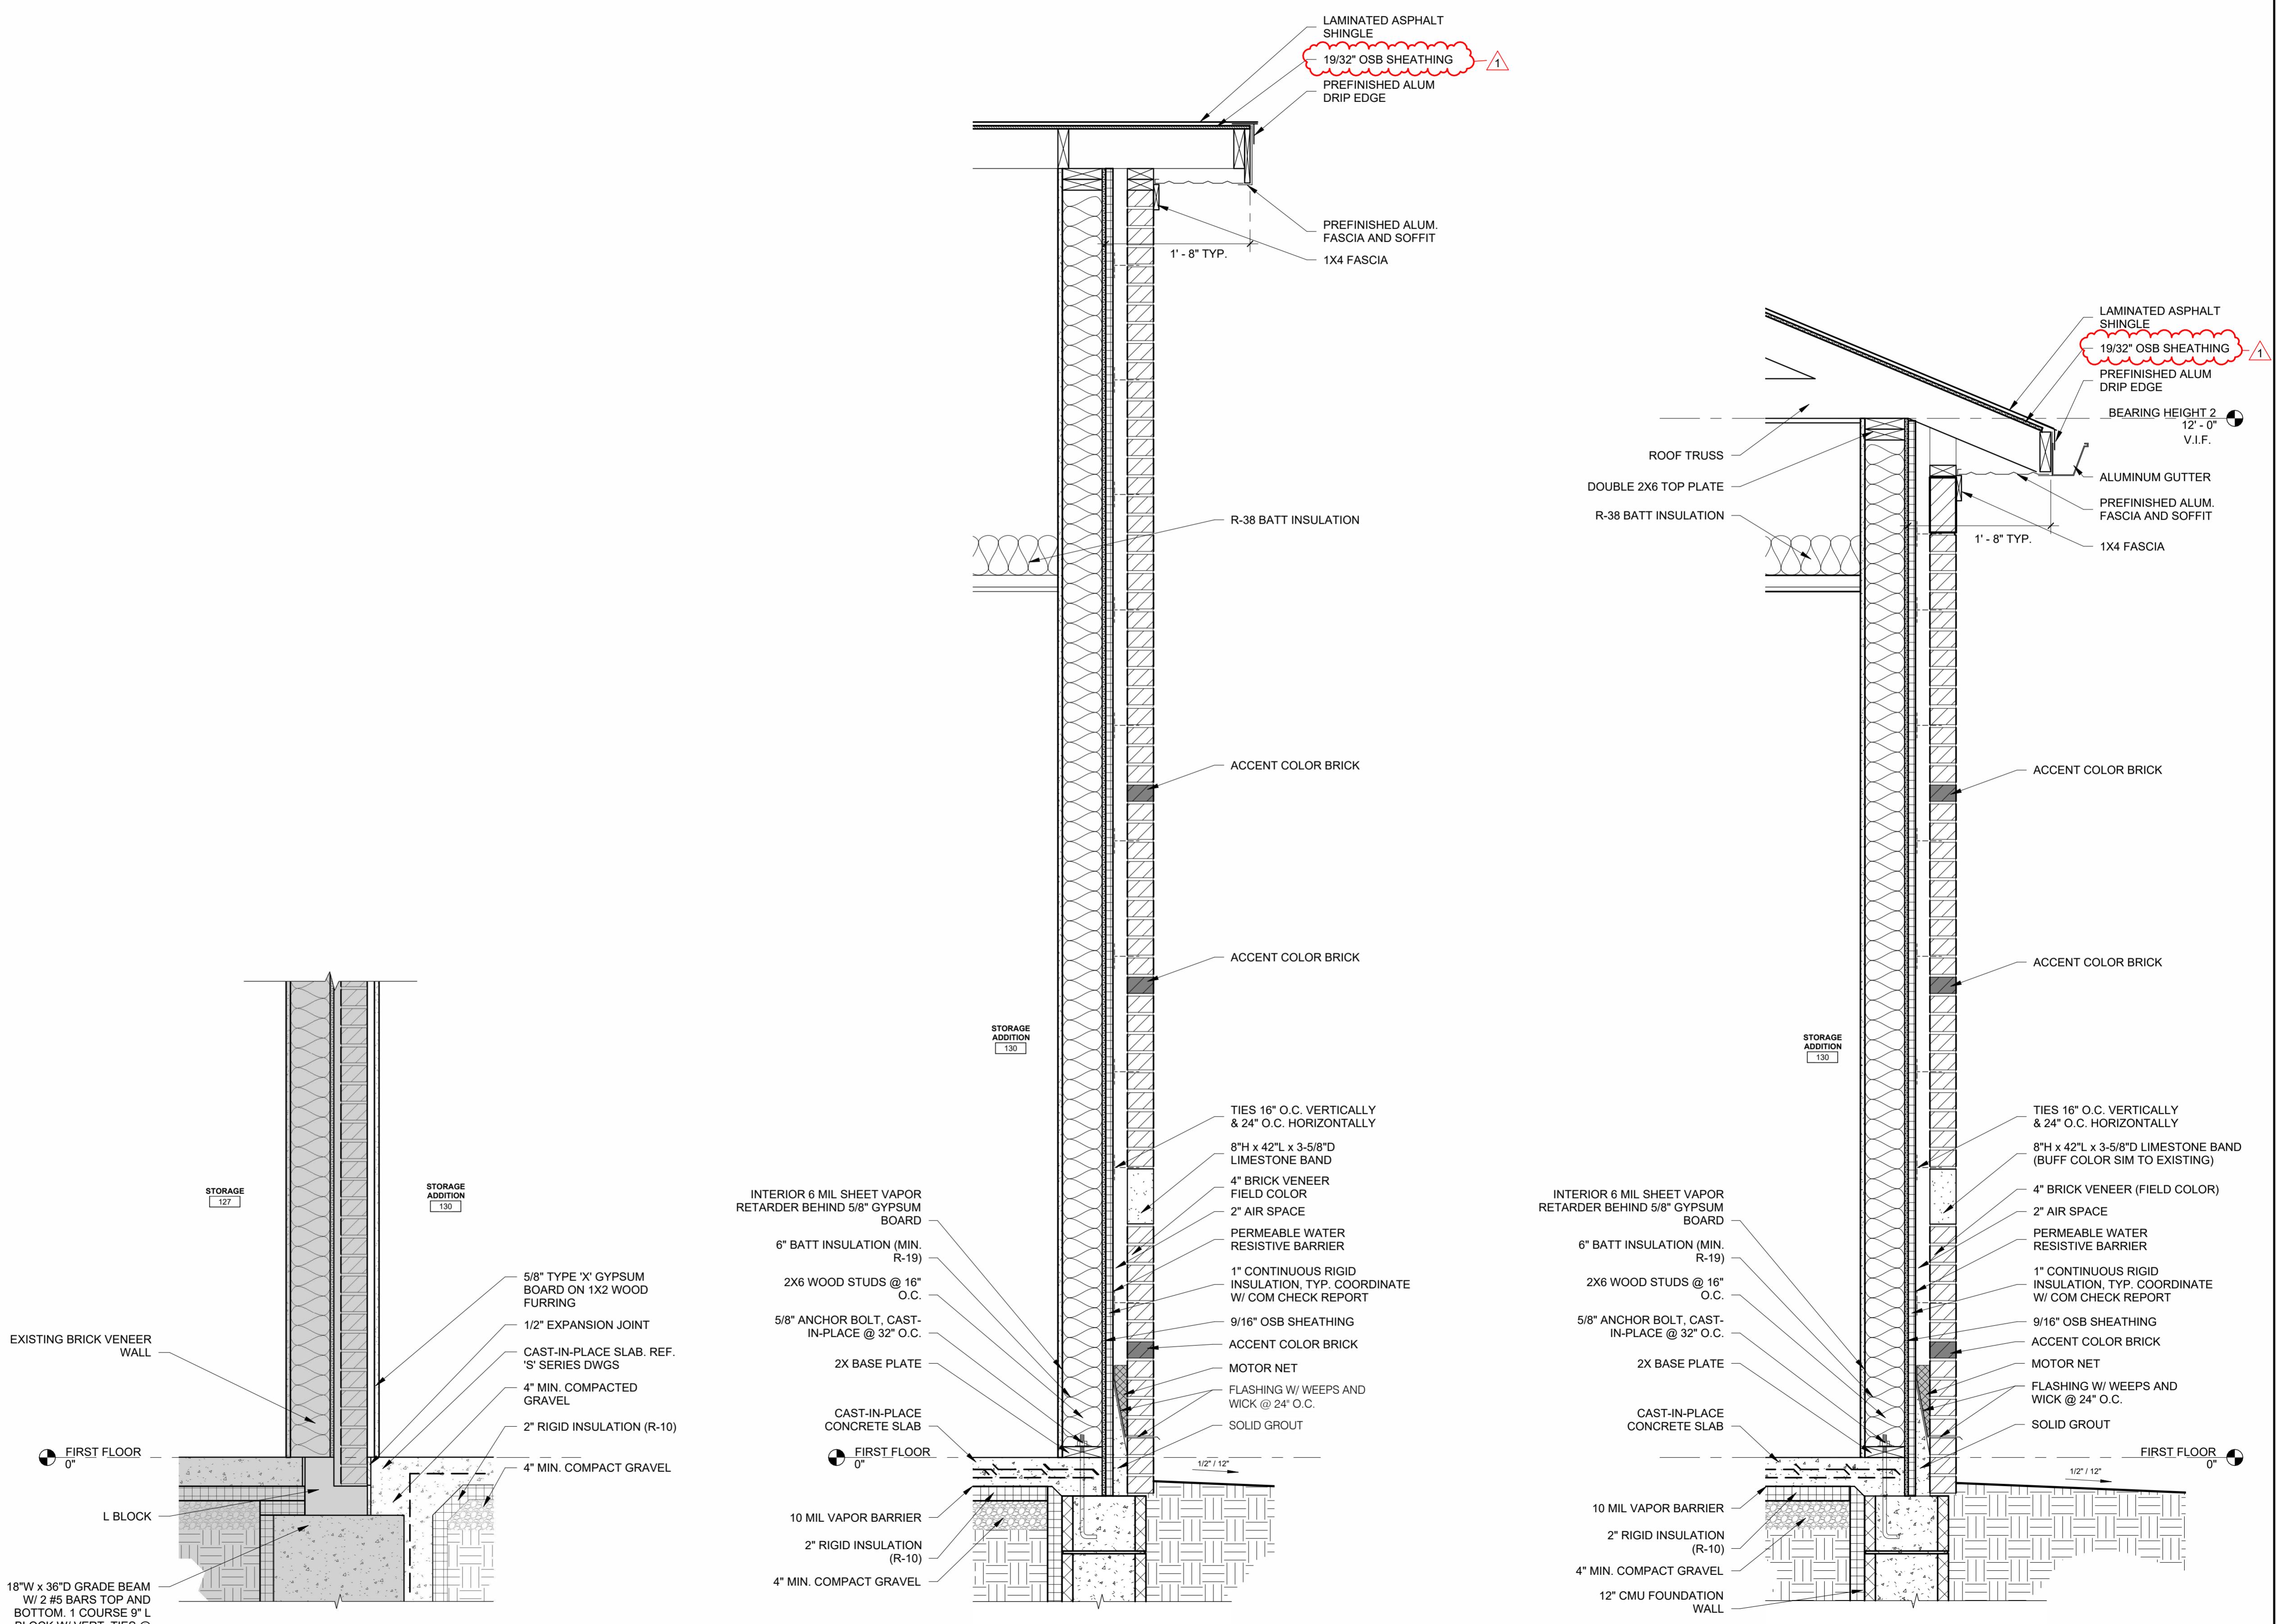

WALL SECTION 3

SCALE 1" = 1'-0"

3 WALL SECTION 2

SCALE: 1" = 1'-0"

WALL SECTION 1

SCALE 1" = 1'-0"

1

INTERIOR GENERAL NOTES

A. MATERIALS SHOWN. FINAL COLOR SELECTIONS DETERMINED WITH SUBMITTAL APPROVAL.

B. REFERENCE EACH FLOOR PLAN, REFLECTED CEILING PLAN AND INTERIOR ELEVATION FOR EXTENT AND LOCATION OF MATERIALS & FINISHES.

C. SUBMITTALS: PROVIDE PRODUCT DATA, SAMPLES FOR VERIFICATION AND SELECTION OF ALL MATERIALS SPECIFIED IN THESE DRAWINGS AND SUBSEQUENT ADDENDA.

D. STORE MATERIALS IN DRY CONDITIONS PROTECTED FROM THE WEATHER IN AMBIENT TEMPERATURE RANGE RECOMMENDED BY MANUFACTURERS.

E. PRIOR TO INSTALLATION VERIFY ALL SUBSTRATES ARE DRY AND FREE OF CURING COMPOUNDS, SEALERS AND HARDENERS. REMOVE SUBSTANCES INCOMPATIBLE WITH ADHESIVES.

F. EXTRA MATERIALS - ALL EXTRA AND INSTALLED MATERIALS SHALL BE FROM THE SAME PRODUCTION RUN. PACKAGE ALL EXTRA MATERIALS IN PROTECTIVE COVERING FOR STORAGE, WITH LABELS DESCRIBING CONTENTS FOR THE FOLLOWING MATERIALS:

G. PAINT - PROVIDE (1) FULL GALLON MINIMUM OF EACH TYPE AND COLOR SPECIFIED. CARPETING, VINYL FLOORING, RESILIENT BASE ACCESSORIES, AND TILE - PROVIDE ONE FULL CONTAINER OR ROLL OF EACH COLOR AND PATTERN SPECIFIED, BUT NOT LESS THAN 5% OF AMOUNT INSTALLED OF EACH PRODUCT. PROVIDE FULL SIZE TILES AND VINYL PLANKS.

H. FLOORING CONTRACTOR RESPONSIBLE FOR PROVIDING ALL FLOORING TRANSITIONS INCLUDING ADAPTER AND REDUCER ACCESSORIES COMPATIBLE WITH ADJACENT FLOORING MATERIALS. DESIGNER TO APPROVE ALL TRANSITIONS.

I. WHERE FLOORING TRANSITIONS OCCUR AT DOOR OPENINGS, CENTER TRANSITION LINE OF MATERIALS UNDER CENTERLINE OF DOOR IN ITS CLOSED POSITION.

J. CONSULT ARCHITECT REGARDING ANY DISCREPANCIES BETWEEN DRAWINGS, NOTES AND SCHEDULES.

K. PAINT ALL EXISTING METAL DOOR FRAMES THE CORRESPONDING FIELD COLOR IN SEMI-GLOSS (EP-2 FOR RESTROOMS AND KITCHEN, EP-1 FOR ALL OTHER DOORS).

L. CLEAN AND REPAIR ALL EXISTING WOOD DOORS THAT ARE TO BE REUSED.

M. PROVIDE NEW RECEPTACLE, SWITCHES AND DATA COVER PLATES THROUGHOUT. COLOR: WHITE. REF 'E' SERIES DWGS FOR QUANTITY, TYPE AND LOCATION.

N. ALL GYP. BD. CEILINGS AND BULKHEADS ARE TO BE PAINTED P-1 U.N.O.; REF FINISH LEGEND.


PLAN NOTES

- 1 NO WORK THIS AREA.
- 2 EXISTING WALL MURAL TO REMAIN.
- 3 REUSE SALVAGED EXISTING WOOD BASE THIS LOCATION.
- 4 REMOVE DAMAGED TILE AND GROUT. LEVEL SURFACE. REINSTALL TILE FROM OWNER PROVIDED ATTIC STOCK AND GROUT TO MATCH.
- 5 PATCH/REPAIR WOOD FLOOR THIS LOCATION W/ SALVAGED FLOORING & BASE. REF 'A' SERIES DWGS.
- 6 REPLACE EXISTING COUNTER TOP WITH SS-1 THIS LOCATION.
- 7 PROVIDE ADD ALTERNATE COST TO REPLACE COUNTER TOP WITH LAMINATE WILSONART NATURAL COTTON 4946-38 (OR APPROVAL EQUAL) THIS LOCATION.
- 8 NEW RUG 10'X12' (42 TILES) FLOR, DAPPLED DAYLIGHT COBALT (R-1).
- 9 PROVIDE 48"X48"X1/4" THICK SOLID SURFACE (SS-2) BACK FOR DRINKING FOUNTAIN, CENTER TO DRINKING FOUNTAIN. EASED EDGE. TRANSLUCENT SEALANT AROUND PERIMETER.

ROOM FINISH TAG LEGEND

ROOM NAME	ROOM #
FLOOR - F	N - NORTH WALL
BASE - B	E - EAST WALL
CEILING - C	S - SOUTH WALL
REMARKS - R	W - WEST WALL
	FINISH ABBREV.
	WALL LOCATION
	FINISH LOCATION/REMARKS
	FINISH ABBREV.

PLAN LEGEND

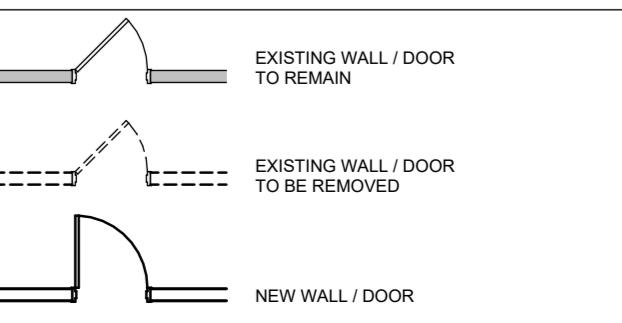



Odile McGuire Shook

ARCHITECTURE INTERIOR DESIGN
LANDSCAPE ARCHITECTURE ENGINEERING

"A history of forward thinking..."

www.omscorp.net

7222 N Shadeland Avenue
Suite 100
Indianapolis, Indiana 46250
317.842.0000
Fax 317.917.0616
oms@omscorp.net

100%
CONSTRUCTION
DOCUMENTS



Matthew R. Mayol

CERTIFIED

No.	Description	Date
1	ADD-1	01/26/2026

REVISIONS

SHERIDAN PUBLIC LIBRARY BUILDING
ADDITION, RENOVATIONS AND SITE
IMPROVEMENTS

103 W 1ST ST, SHERIDAN, IN 46069, HAMILTON COUNTY

© Copyright 2026
by Odile McGuire Shook
Copyright includes architectural work, building
design, plans or drawings, and specifications.
Architect work in the overall form as well as
the arrangement and grouping of the parts and
elements in the design. Reproduction without
written permission is prohibited.

Project number 25050

Date 01.15.26

Drawn by GRB

Checked by MRM

Designed by MRM


AI102

FINISH LEGEND

FINISH LEGEND

CODE	DESCRIPTION	MANUFACTURER	PATTERN	COLOR	SIZE	COMMENTS
ACT-1	ACOUSTICAL CEILING TILE	ARMSTRONG	DUNE - 5/8" SQUARE TEGULAR EDGE - MATCH EXISTING	WHITE	24" x 24"	ACOUSTICAL CEILING TILE
ACT-2	ACOUSTICAL CEILING TILE	ARMSTRONG	CLEAN ROOM VL NON - PERFORATED WITH HUMIGARD PLUS #868	WHITE	24" x 24"	ACOUSTICAL CEILING TILE
ACT-3	ACOUSTICAL CEILING TILE	ARMSTRONG	ULTIMA HIGH NRC TEGULAR	WHITE	24" x 24"	ACOUSTICAL CEILING TILE
AT-1	ALUMINUM TRIM	KOROSEAL	HORIZONTAL TRIM - JC12	SMSJC00001 SATIN ALUMINUM	-	REFERENCE MANUFACTURER INSTALLATION GUIDE. CONTACT KATHY ZINGRAF kzingraf@koroseal.com 317.443.8985
AT-2	ALUMINUM TRIM	KOROSEAL	INSIDE CORNER - IC12	SMSIC00001 SATIN ALUMINUM	-	REFERENCE MANUFACTURER INSTALLATION GUIDE. CONTACT KATHY ZINGRAF kzingraf@koroseal.com 317.443.8985
AT-3	ALUMINUM TRIM	KOROSEAL	OUTSIDE CORNER - OC12	SMSOC00001 SATIN ALUMINUM	-	REFERENCE MANUFACTURER INSTALLATION GUIDE. CONTACT KATHY ZINGRAF kzingraf@koroseal.com 317.443.8985
CPT-1	CARPET	INTERFACE	QUARTER-TURN INSTALL	KNITSTITCH_103339 LINEN/LAPIS	50CM X 50CM	REFERENCE MANUFACTURER INSTALLATION GUIDE. CONTACT JAE PARK JAE.PARK@INTERFACE.COM 317.459.8762
CPT-2	CARPET	MANNINGTON	STAGGER INSTALL	TIMESTAMP, POLARIZED, COMPOSITE 13823	12" X 36"	REFERENCE MANUFACTURER INSTALLATION GUIDE. CONTACT LISA ADERS LISA _ADERS@MANNINGTON.COM 317.374.7323
EP-1	EPOXY PAINT - FIELD	SHERWIN WILLIAMS	EGGSHELL	SW7030 ANEW GRAY	-	
EP-2	EPOXY PAINT - FIELD	SHERWIN WILLIAMS	SEMI-GLOSS	SW7632 MODERN GRAY	-	
EP-4	EPOXY PAINT - ACCENT	SHERWIN WILLIAMS	EGGSHELL	SW7593 RUSTIC RED	-	
EP-5	EPOXY PAINT - ACCENT	BENJAMIN MOORE	EGGSHELL	CSP-565 INDI GO-GO	-	
EP-6	EPOXY PAINT - TRIM	SHERWIN WILLIAMS	SEMI-GLOSS	SW7030 ANEW GRAY	-	TO PAINT ALL EXISTING PAINTED TRIM TO MATCH FIELD PAINT COLOR
ETR	EXISTING TO REMAIN	-	-	-	-	CLEAN & REPAIR AS REQUIRED, REFERENCE SPECIFICATIONS
LVT-1	LUXURY VINYL TILE	MANNINGTON	BRICK ASHLAR INSTALL	AMTICO, ABSTRACT, LINEAR GRAPHITE AROALA33	18" X 18"	REFERENCE MANUFACTURER INSTALLATION GUIDE. CONTACT LISA ADERS LISA _ADERS@MANNINGTON.COM 317.374.7323
LVT-2	LUXURY VINYL TILE	MANNINGTON	BRICK ASHLAR INSTALL	SPACIA, WOOD, WINDSOR OAK ASHEN SS5W12372	6" X 36"	REFERENCE MANUFACTURER INSTALLATION GUIDE. CONTACT LISA ADERS LISA _ADERS@MANNINGTON.COM 317.374.7323
P-1	PAINT - CEILING	SHERWIN WILLIAMS	FLAT	SW7005 PURE WHITE	-	
PL-1	LAMINATE	FORMICA	OILED WOOD TEXTURE	5488-26 SMOKEY BROWN PEAR	-	
SC-1	SEALED CONCRETE	RESUPRIME™ 3579 PIGMENTED PRIMER	MULTI-COMPONENT, POLYAMIDE, EPOXY PRIMER WITH PIGMENTED PRIMER	LIGHT GRAY FROM MFGR STANDARD COLORS	8MILS MINIMUM COATING THICKNESS (OR AS OTHERWISE DIRECTED BY MANUFACTURER).	OR APPROVED EQUALS BY: A.) FLOROCK: FLOROPXY 4700/ FLOROTHANE CR250 (PIGMENTED) B) GENERAL POLYMERS: 3504, EPOXY PRIMER/4618 C) MAB-PLY-TILE S20 PRIMER/ MONOTHANE
SS-1	SOLID SURFACE	WILSONART	-	CASHMERE MIRAGE 9135MG	1/2" THICK	EDGE 90 DEGREES U.N.O.
SS-2	SOLID SURFACE	WILSONART	-	ANTIQUE WHITE 1572SL	1/4" THICK	
TP-1	SOLID PLASTIC TOILET PARTITION	HADRIAN	-	239 GRAY	-	OR APPROVED EQUAL
TW-1	TACKABLE WALLCOVERING	KOROSEAL	WALLTALKERS TAC-WALL	PEWTER (62)	-	REFERENCE MANUFACTURER INSTALLATION GUIDE. CONTACT KATHY ZINGRAF kzingraf@koroseal.com 317.443.8985
R-1	RUG	INTERFACE / FLOR	QUARTER-TURN INSTALL	DAPPLED DAYLIGHT - COBALT	50CM X 50CM	REFERENCE MANUFACTURER INSTALLATION GUIDE. CONTACT JAE PARK JAE.PARK@INTERFACE.COM 317.459.8762
RB-1	RESILIENT BASE	JOHNSONITE	COVE	48 GREY	4" H	OUTSIDE CORNERS MOLDED; INSIDE CORNERS TO BE FORMED. REFERENCE MANUFACTURER INSTALLATION GUIDE FOR ALL CORNERS.
WP-1	WALL PROTECTION	KOROSEAL	KOROGARD WALL PROTECTION SYSTEMS	TAN (72) P1 DUNE	.040" THICK	REFERENCE MANUFACTURER INSTALLATION GUIDE. CONTACT KATHY ZINGRAF kzingraf@koroseal.com 317.443.8985
WP-2	WALL PROTECTION	KOROSEAL	FLEX DECORATIVE WALL PROTECTION	THATCH EARNEST THAI-10	-	REFERENCE MANUFACTURER INSTALLATION GUIDE. CONTACT KATHY ZINGRAF kzingraf@koroseal.com 317.443.8985
WT-1	WALL TILE	DALTILE	CHEVRON MOSAIC	ARTICULO FEATURE BEIGE	2"X5"	REFERENCE MANUFACTURER INSTALLATION GUIDE. CONTACT ROBIN BRADFORD ROBIN.BRADFORD@DAL TILE.COM 317.946.0823 GROUT MAPEI BISCUIT 14
WT-2	WALL TILE	-	-	-	13"X13"	EXISTING TILE FROM OWNER PROVIDED ATTIC STOCK
WTT-1	WALL TILE TRIM	SCHLUTER SYSTEMS	-	RONDEC-DB SATIN ANODIZED ALUMINUM (AE)	-	

1

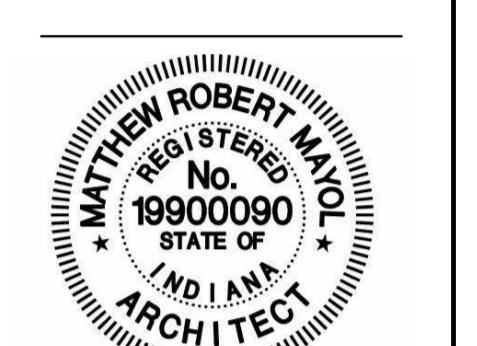

Matthew R. Mayol
CERTIFIED

No. Description Date

1 ADD-1 01/29/2026

REVISIONS

**SHERIDAN PUBLIC LIBRARY BUILDING
ADDITION, RENOVATIONS AND SITE
IMPROVEMENTS**


103 W 1ST ST, SHERIDAN, IN 46069, HAMILTON COUNTY

© Copyright 2026
by Odile McGuire Shook
Copyright includes architectural work, building design, plans or drawings, and specifications. Architectural work is the overall form as well as the arrangement and relationship of lines, shapes and elements in the design. Reproduction without written permission is prohibited.

Project number 25050
Date 01.15.26
Drawn by GRB
Checked by MRM
Designed by MRM

F101


EXISTING FURNITURE &
SHELVING PLAN

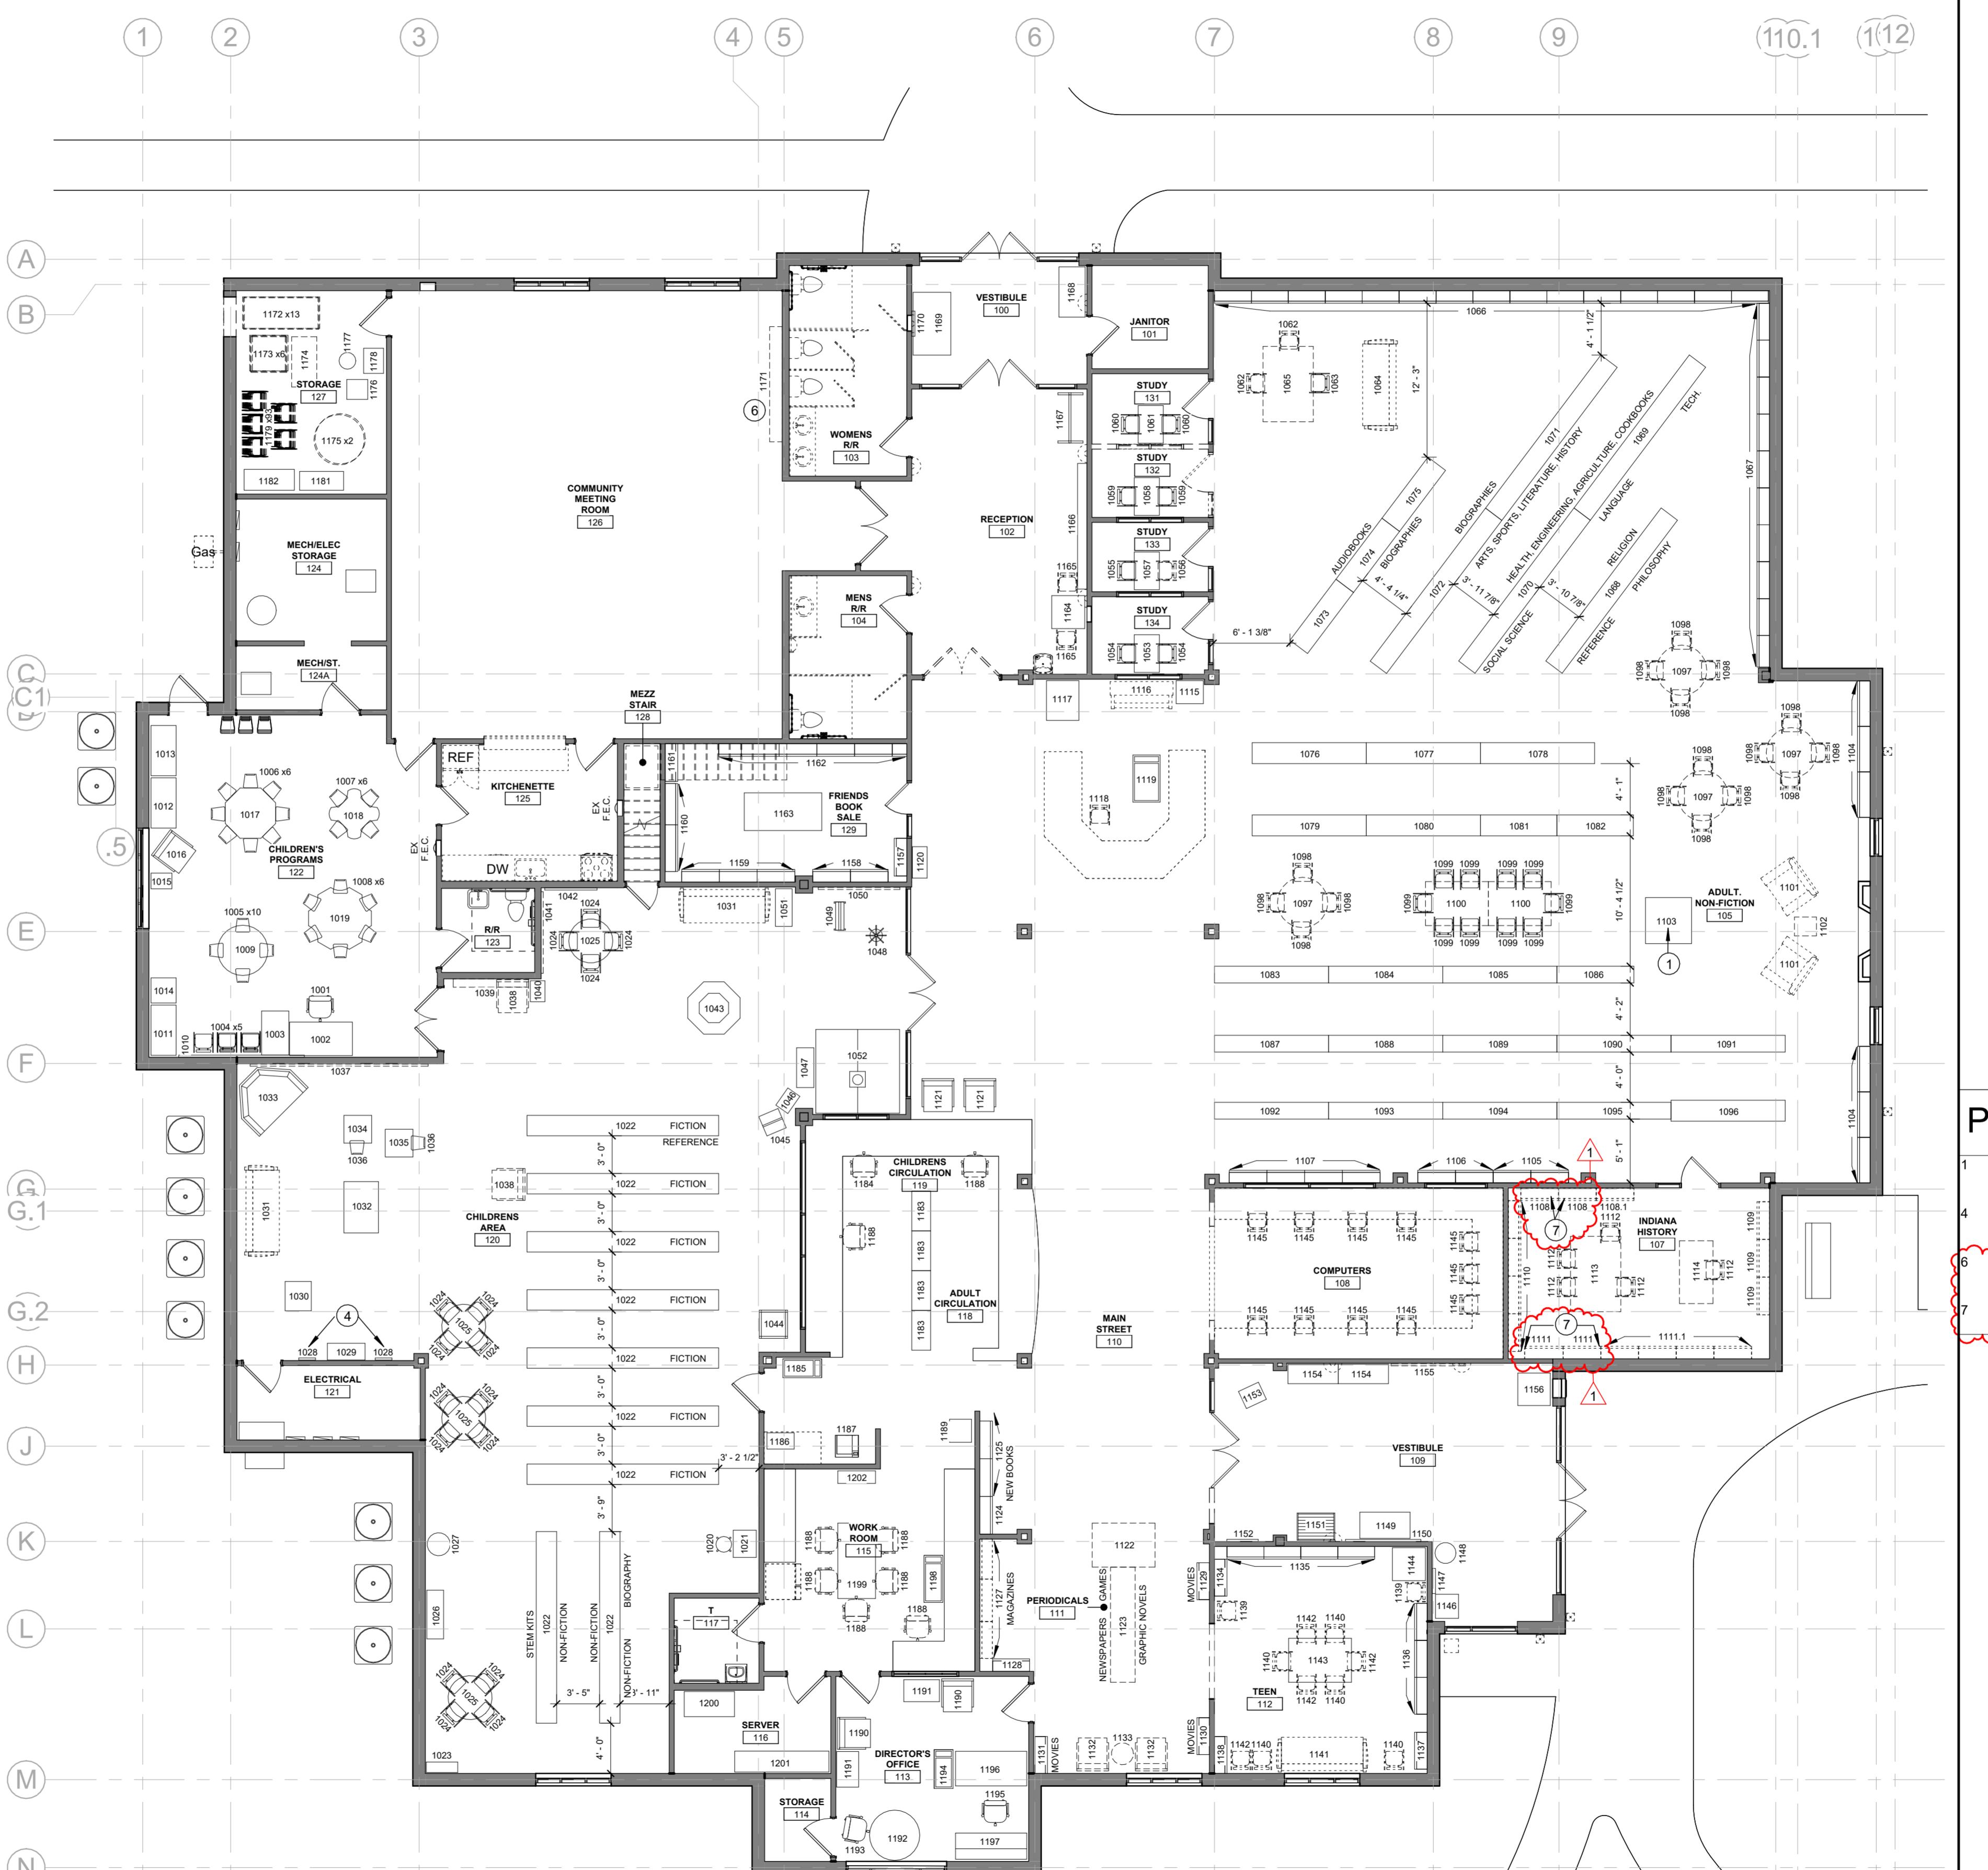

FIRST FLOOR EXISTING FURNITURE PLAN

SCALE: 1/8" = 1'-0"

1

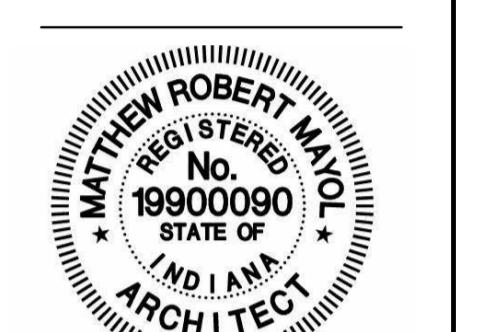

Matthew R. Mayol
CERTIFIED

No. Description Date

1 ADD-1 01/29/2026


REVISIONS


SHERIDAN PUBLIC LIBRARY BUILDING ADDITION, RENOVATIONS AND SITE IMPROVEMENTS

103 W 1ST ST, SHERIDAN, IN 46069, HAMILTON COUNTY

PLAN NOTES

- CONTRACTOR TO PROVIDE PRICE TO INSTALL HEAVY DUTY CASTORS ON EXISTING STONE AND METAL COFFEE TABLE.
- CONTRACTOR TO INSTALL EXISTING ACTIVITY BOARD ON WALL THIS LOCATION.
- CONTRACTOR TO INSTALL EXISTING ROUND ACTIVITY BOARD/BOARD ON WALL THIS LOCATION. WALL REQUIRES BLOCKING FOR SUPPORT.
- CONTRACTOR TO INSTALL OWNER PROVIDED SENSORY WALL PANEL 34"X4" THIS LOCATION.
- ASSEMBLE BOOKSHELF FROM OWNER PROVIDED SURPLUS SHELVING LOCATED IN MEZZANINE 200.
- REINSTALL BOOKSHELF FROM INDIANA HISTORY 107 CONNECT POWER IN SHELF BASE REF E'S SERIES DWGS.

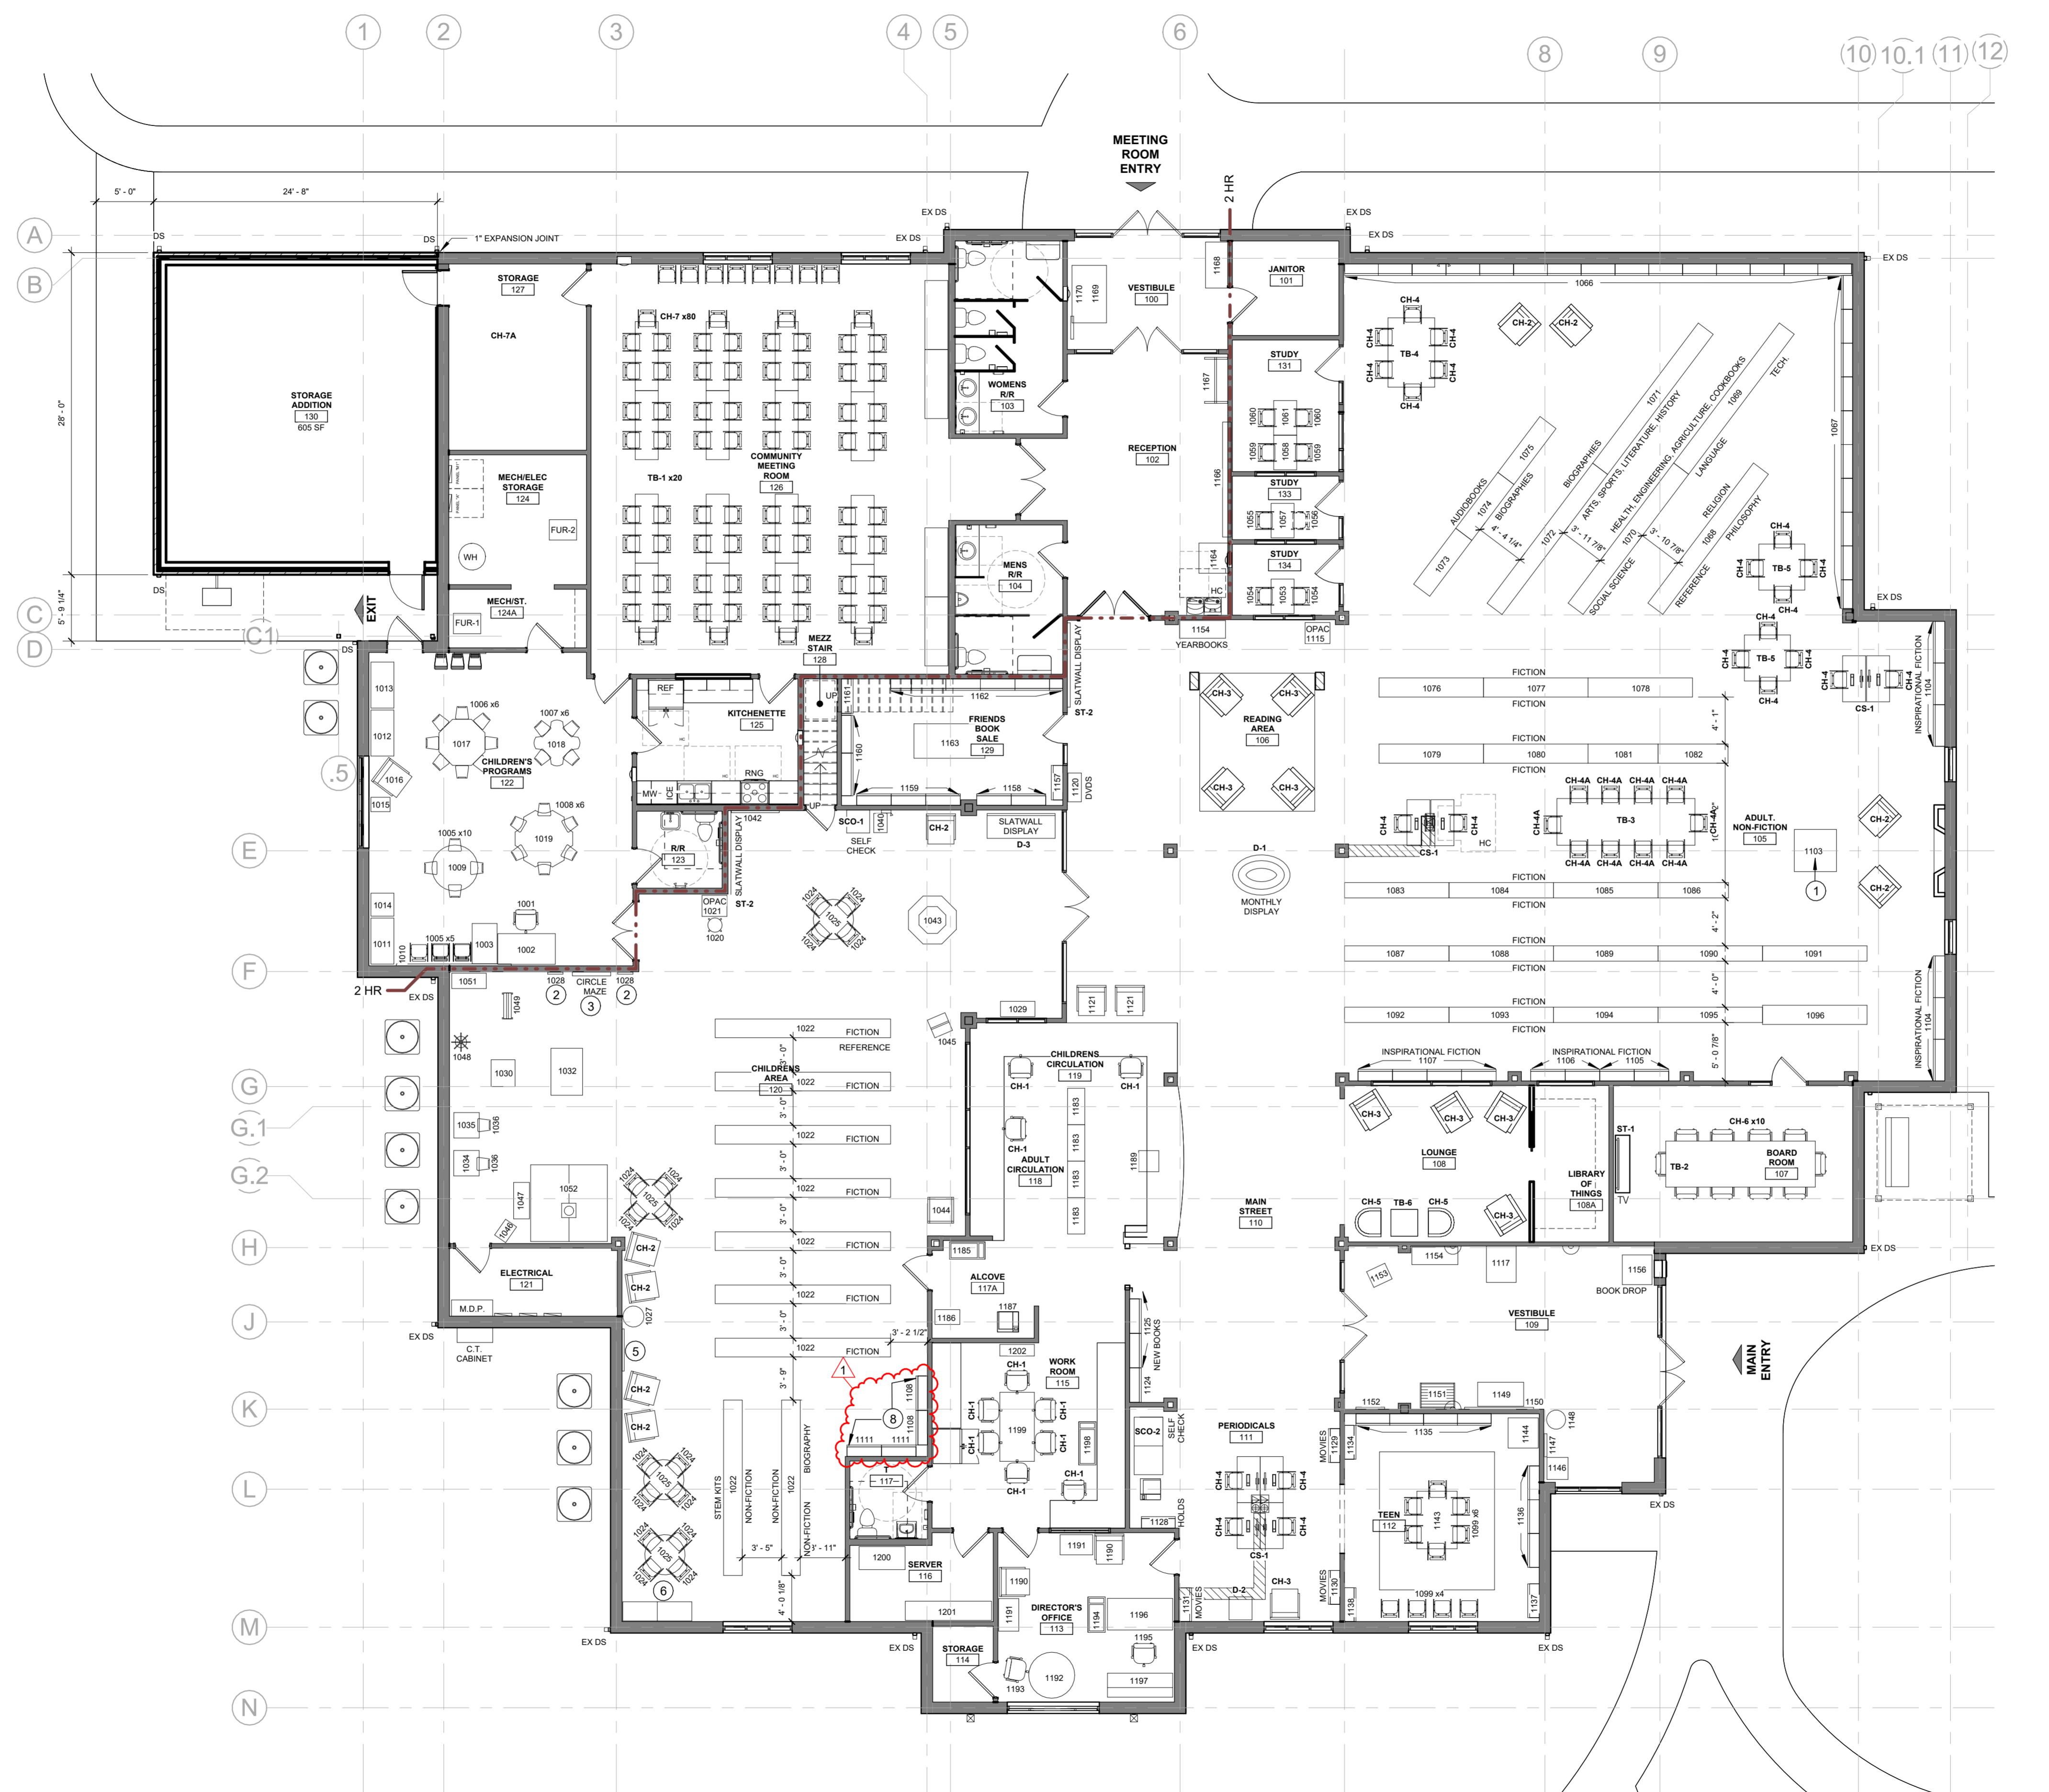

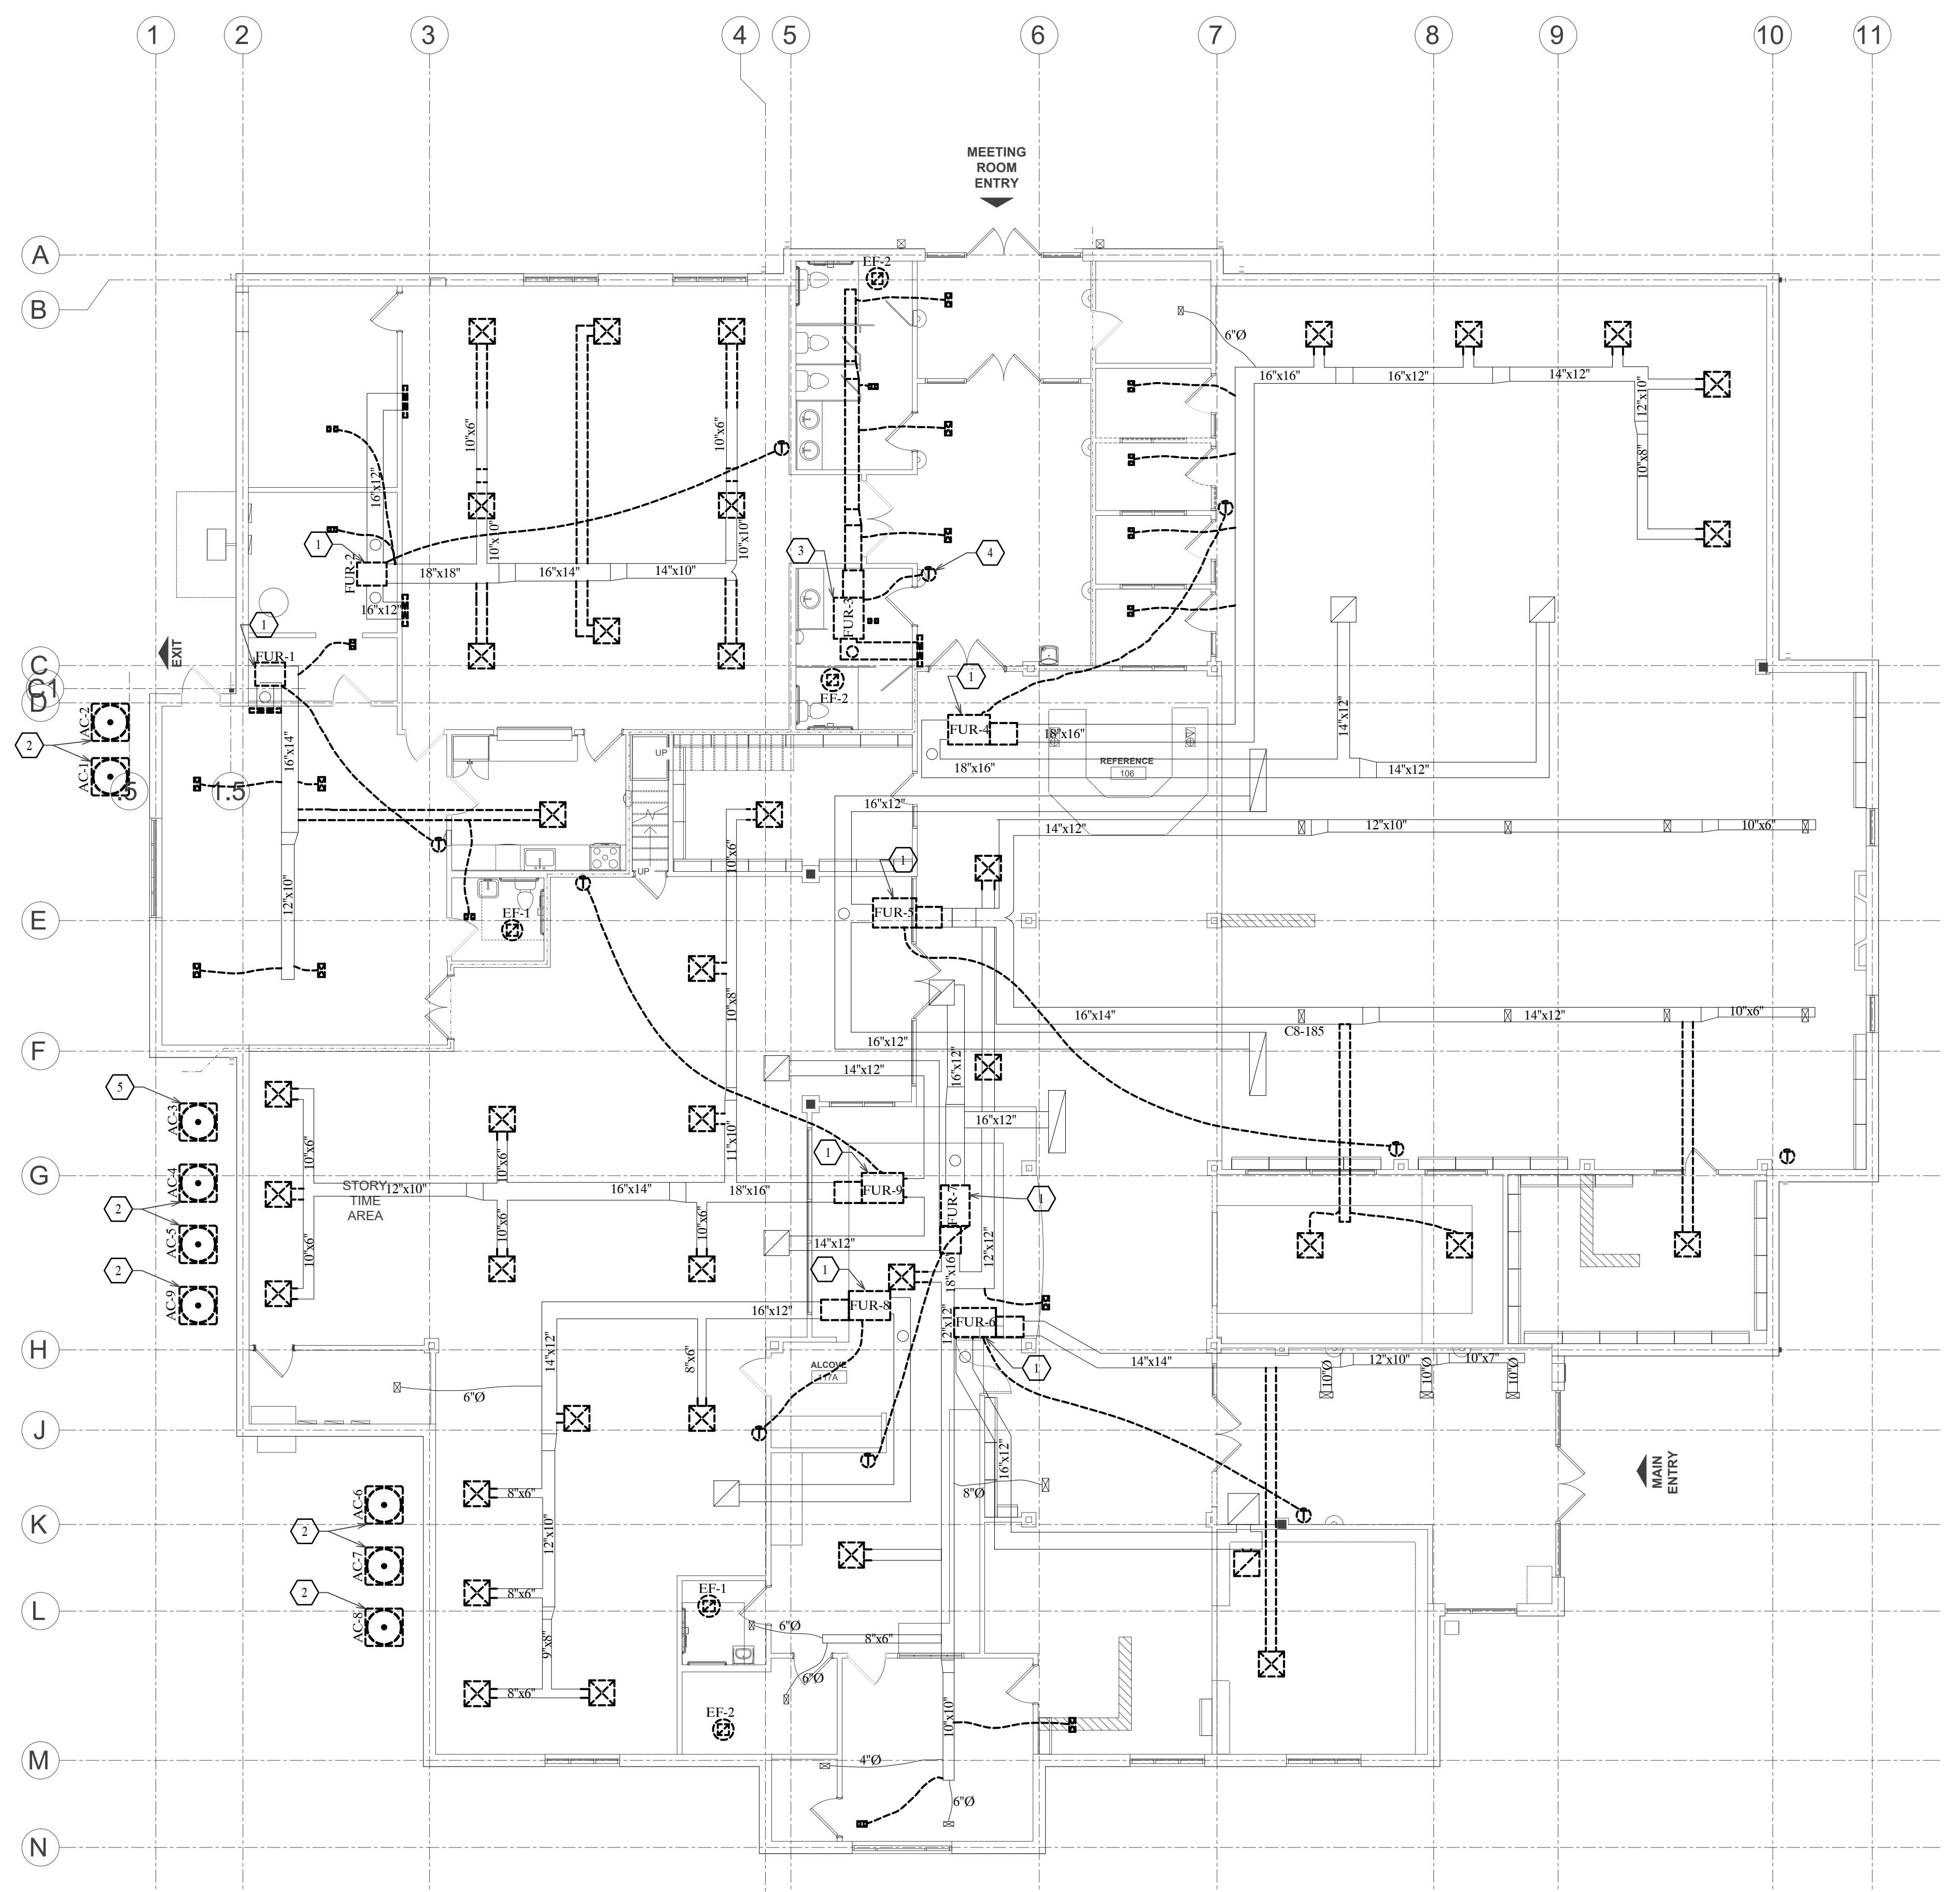

MECHANICAL FIRST FLOOR DEMOLITION PLAN
SCALE: 1/8" = 1'-0"

GENERAL DEMOLITION NOTES:

- A. EXISTING SUPPLY AND RETURN DUCTWORK SHALL REMAIN WHERE SHOWN WITH SOLID LINE.
- B. REMOVE EXISTING EXHAUST FAN COMPLETELY.
- C. REMOVE EXISTING AIR DUCTS FROM THE WALL COMPLETELY.
- D. REMOVE ALL FLEXIBLE AIR DUCT CONNECTORS COMPLETELY.
- E. REMOVE EXISTING SUPPLY DIFFUSERS AND GRILLS WHERE SHOWN WITH DASHED LINE.
- F. REMOVE EXISTING RETURN GRILLS WHERE SHOWN WITH DASHED LINE.
- G. REMOVE EXISTING SUPPLY DUCT WHERE SHOWN WITH DASHED LINE.
- H. REMOVE EXISTING RETURN DUCT WHERE SHOWN WITH DASHED LINE.

DEMOLITION PLAN NOTES:

- 1. REMOVE EXISTING FURNACES BY FOLLOWING DETAIL 'S' SHOWN ON SHEET M002.
- 2. REMOVE EXISTING CONDENSING UNITS AND ACCESSORIES, INCLUDING EQUIPMENT PADS.
- 3. REMOVE EXISTING FUR-3 AND ACCESSORIES COMPLETELY FROM CEILING SPACE.
- 4. REMOVE EXISTING THERMOSTAT ASSOCIATED WITH FUR-3 FROM THE WALL COMPLETELY.
- 5. REMOVE EXISTING AC-3 AND ACCESSORIES, INCLUDING EQUIPMENT PAD COMPLETELY.

BUILDING ADDITION & RENOVATION TO SHERIDAN PUBLIC LIBRARY

103 W. 1ST ST., SHERIDAN, INDIANA 46069

DAE
DESIGN-AIRE ENGINEERING, INC.
2707 RAND ROAD
INDIANAPOLIS, INDIANA 46241
voice (317) 644-9690
fax (317) 644-9339
www.designaireengineering.com
Mechanical, Electrical, and Energy Engineering


100% CONSTRUCTION DOCUMENTS

WILLIAM J. SNOGRASS
REGISTERED
No. 17006
STATE OF INDIANA
PROFESSIONAL ENGINEER
William J. Snograss
CERTIFIED

No. Description Date

1 ADDENDUM 1 1/26/2026

REVISIONS

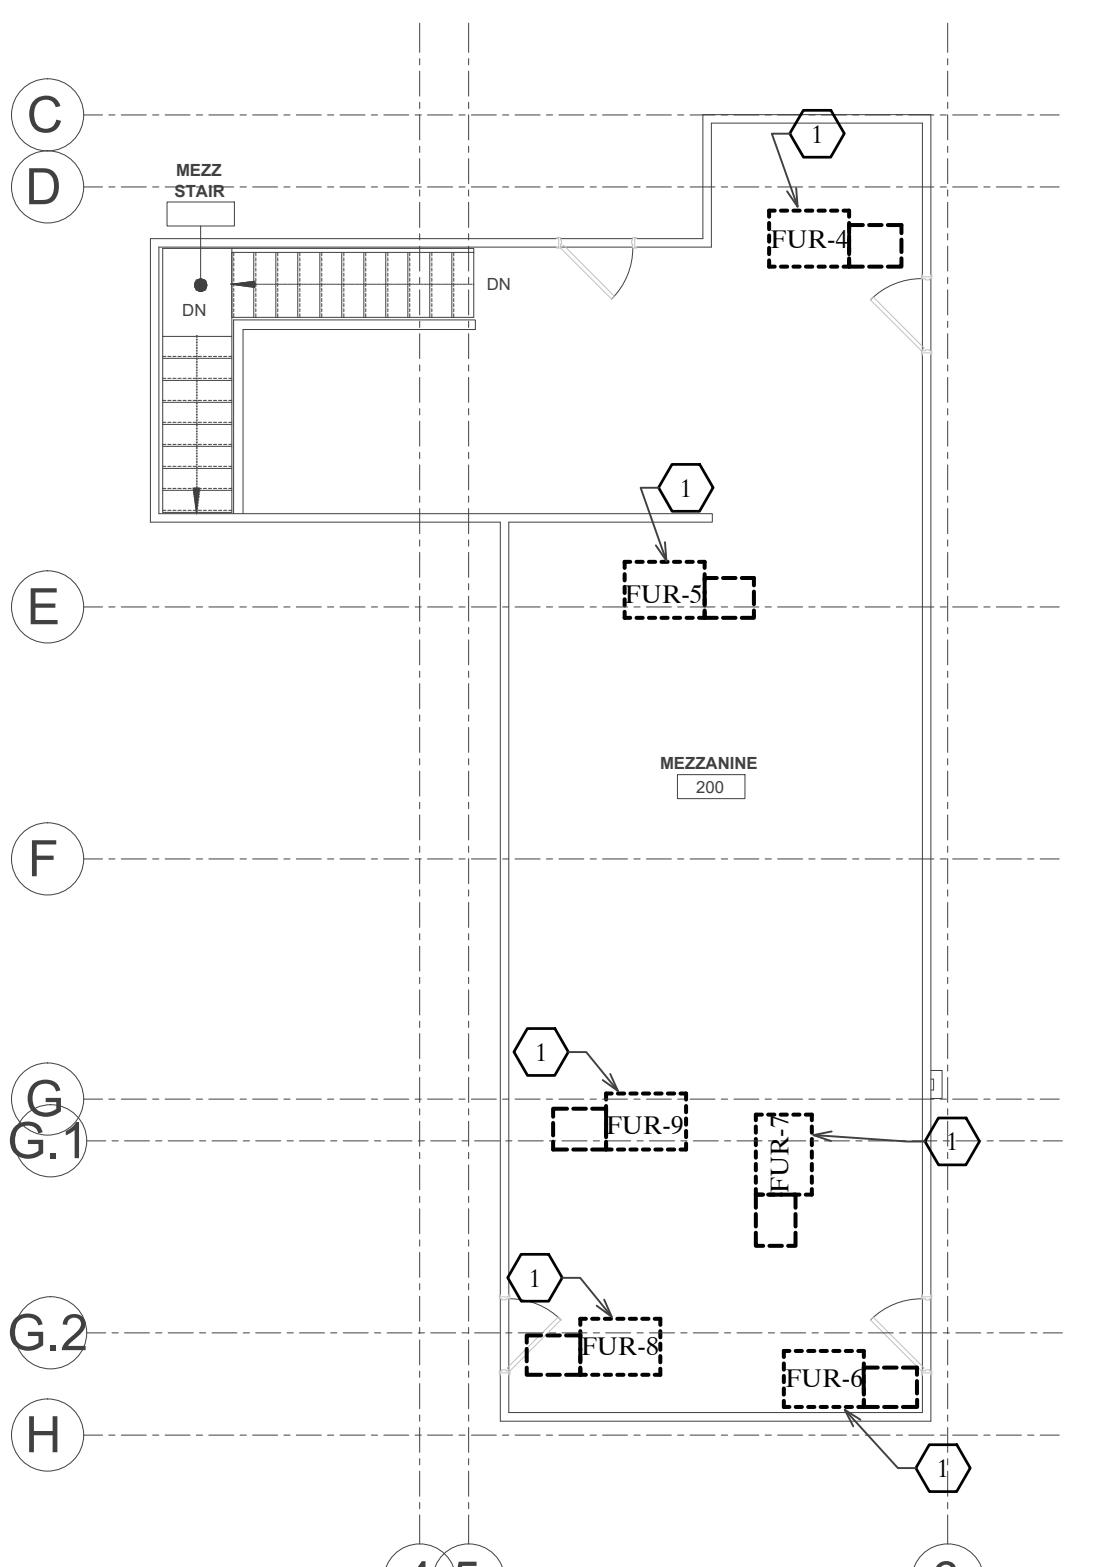

MECHANICAL MEZZANINE
DEMOLITION PLAN

SCALE: 1/8" = 1'-0"

THIS DRAWING AND THE IDEAS, DESIGNS, AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF DESIGN-AIRE ENGINEERING, INC., AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF DESIGN-AIRE ENGINEERING, INC.

©COPRIGHT 2006, DESIGN-AIRE ENGINEERING, INC.

Project number 25138

Date 01.15.26

Drawn by DAE

Checked by WJS

Designed by DAE

MD101

MECHANICAL
DEMOLITION PLANS

**BUILDING ADDITION & RENOVATION TO
SHERIDAN PUBLIC LIBRARY**

103 W. 1ST ST., SHERIDAN, INDIANA 46069

THIS DRAWING CONTAINS THE IDEAS, DESIGNS AND CONCEPTS OF DESIGN-AIRE ENGINEERING, INC. AND ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF DESIGN-AIRE ENGINEERING, INC. AND ARE NOT TO BE USED OR REPRODUCED IN WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF DESIGN-AIRE ENGINEERING, INC.

©COPRIGHT 2006, DESIGN-AIRE ENGINEERING, INC.

Project number 25138

Date 01.15.26

Drawn by DAE

Checked by WJS

Designed by DAE

M101

MECHANICAL PLANS

GENERAL NOTES:

- A. PROVIDED ALL LOW PRESSURE DROP DUCTWORK FITTINGS.
- B. ALL EXISTING TO REMAIN DUCTS MUST BE CLEANED BY ACR NADCA STANDARD 2021 EDITION AND SEALED BY SIMILAR TO AEROSOLE DUCT SEAL SYSTEM.
- C. INSTALL NEW FLEXIBLE AIR DUCT CONNECTOR, LENGTHS SHALL NOT BE MORE THAN 5 FEET.

KEYED PLAN NOTES:

1. INSTALL NEW FURNACES WITH ASSOCIATED TAG NUMBER FROM SCHEDULE BY FOLLOWING DETAIL'S SHOWN ON SHEET M002.
2. INSTALL NEW CONDENSING UNITS WITH ASSOCIATED TAG NUMBER IN SCHEDULE.
3. INSTALL NEW FURNACE FGF-3 FROM SCHEDULE BY FOLLOWING DETAIL'S SHOWN ON SHEET M002.
4. INSTALL NEW EXHAUST FAN EF-2 FROM SCHEDULE.
5. INSTALL NEW EXHAUST FAN EF-2 FROM SCHEDULE.
6. INSTALL NEW SUPPLY DUCTWORK WITH TAG A SQUARE PLAQUE DIFFUSER (SPD, ASPD) FROM SCHEDULE AND REBALANCE AIRFLOW (CFM).
7. INSTALL NEW EXHAUST FAN EF-3 ABOVE CEILING.
8. FOR INSTALLING AC-2, CEILING MUST BE 18" LOWER THAN CEILING OF THE COMMUNITY MEETING ROOM.
10. MANUAL BALANCING DAMPER.
11. PROVIDE EQUIPMENT PADS WITH SUBBASES FOR TWO NEW HEAT PUMPS (HP-1, HP-2) AND 3 NEW CONDENSING UNITS.
12. WALL-MOUNTED INDOOR UNIT MINI SPLIT WITH REMOTE CONTROLLER.
13. PROVIDE 30' DUCTLESS RECIRCULATING RANGE HOOD WITH CHARCOAL FILTER SIMILAR TO BROAN MODEL # 41305F.
14. RETURN DUCT SHALL BE INSULATED FOR RELIEF AIR.
15. 3/4" SANITARY (CONDENSATE) DRAIN PIPE RUN THROUGH THE WALL AND CONNECT FROM ABOVE THE SANITARY TRAP OF LAVATORY IN RESTROOM.
16. 1" SANITARY (CONDENSATE) DRAIN PIPE RUN THROUGH THE WALL AND CONNECT FROM ABOVE THE SANITARY TRAP OF LAVATORY IN RESTROOM.
17. SUPPORT REFRIGERATOR PIPING WITH PRE-MADE PIPE SUPPORTS.
18. REFRIGERATOR PIPING UP INSIDE THE SHEET METAL BRACKET FROM INNER SURFACE OF THE WALL TO THE CEILING SPACE AND ROUTE TO FURNACES AND AC-2. SEE DETAILS OF SHEET M002.
19. 12" O.D. TOILET EXHAUST DUCT TERMINATE WITH ROOF CAP.
20. 6" O.D. TOILET EXHAUST DUCT TERMINATE WITH ROOF CAP.
21. PROVIDE 2-HOUR FIRE DAMPER WITH ACCESS DOOR.

100%
CONSTRUCTION
DOCUMENTS

WILLIAM J. SNOOK
REGISTERED
No. 17006
STATE OF
INDIANA
PROFESSIONAL
ENGINEER
Signature

CERTIFIED

No. Description Date

1 ADDENDUM 1 1/26/2026

REVISIONS

C
D

E
F

G
G.1

G.2
H

J


K

L

M

N

4
5
6

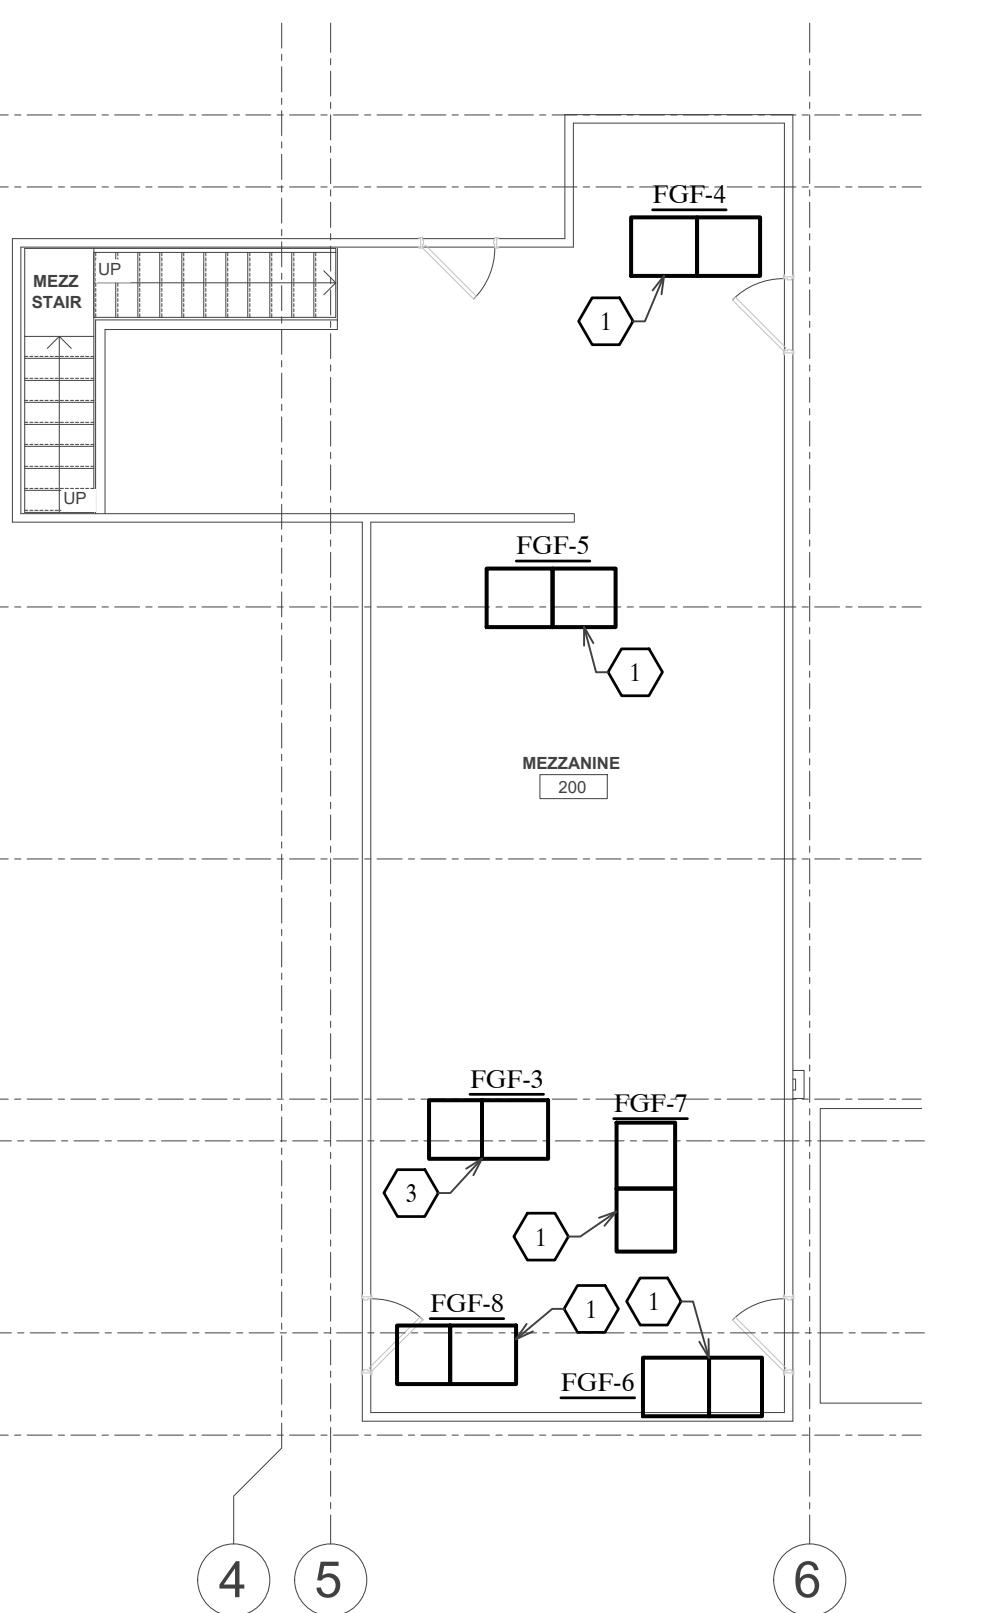


MECHANICAL MEZZANINE PLAN

SCALE: 1/8" = 1'-0"

MECHANICAL FIRST FLOOR PLAN



SCALE: 1/8" = 1'-0"

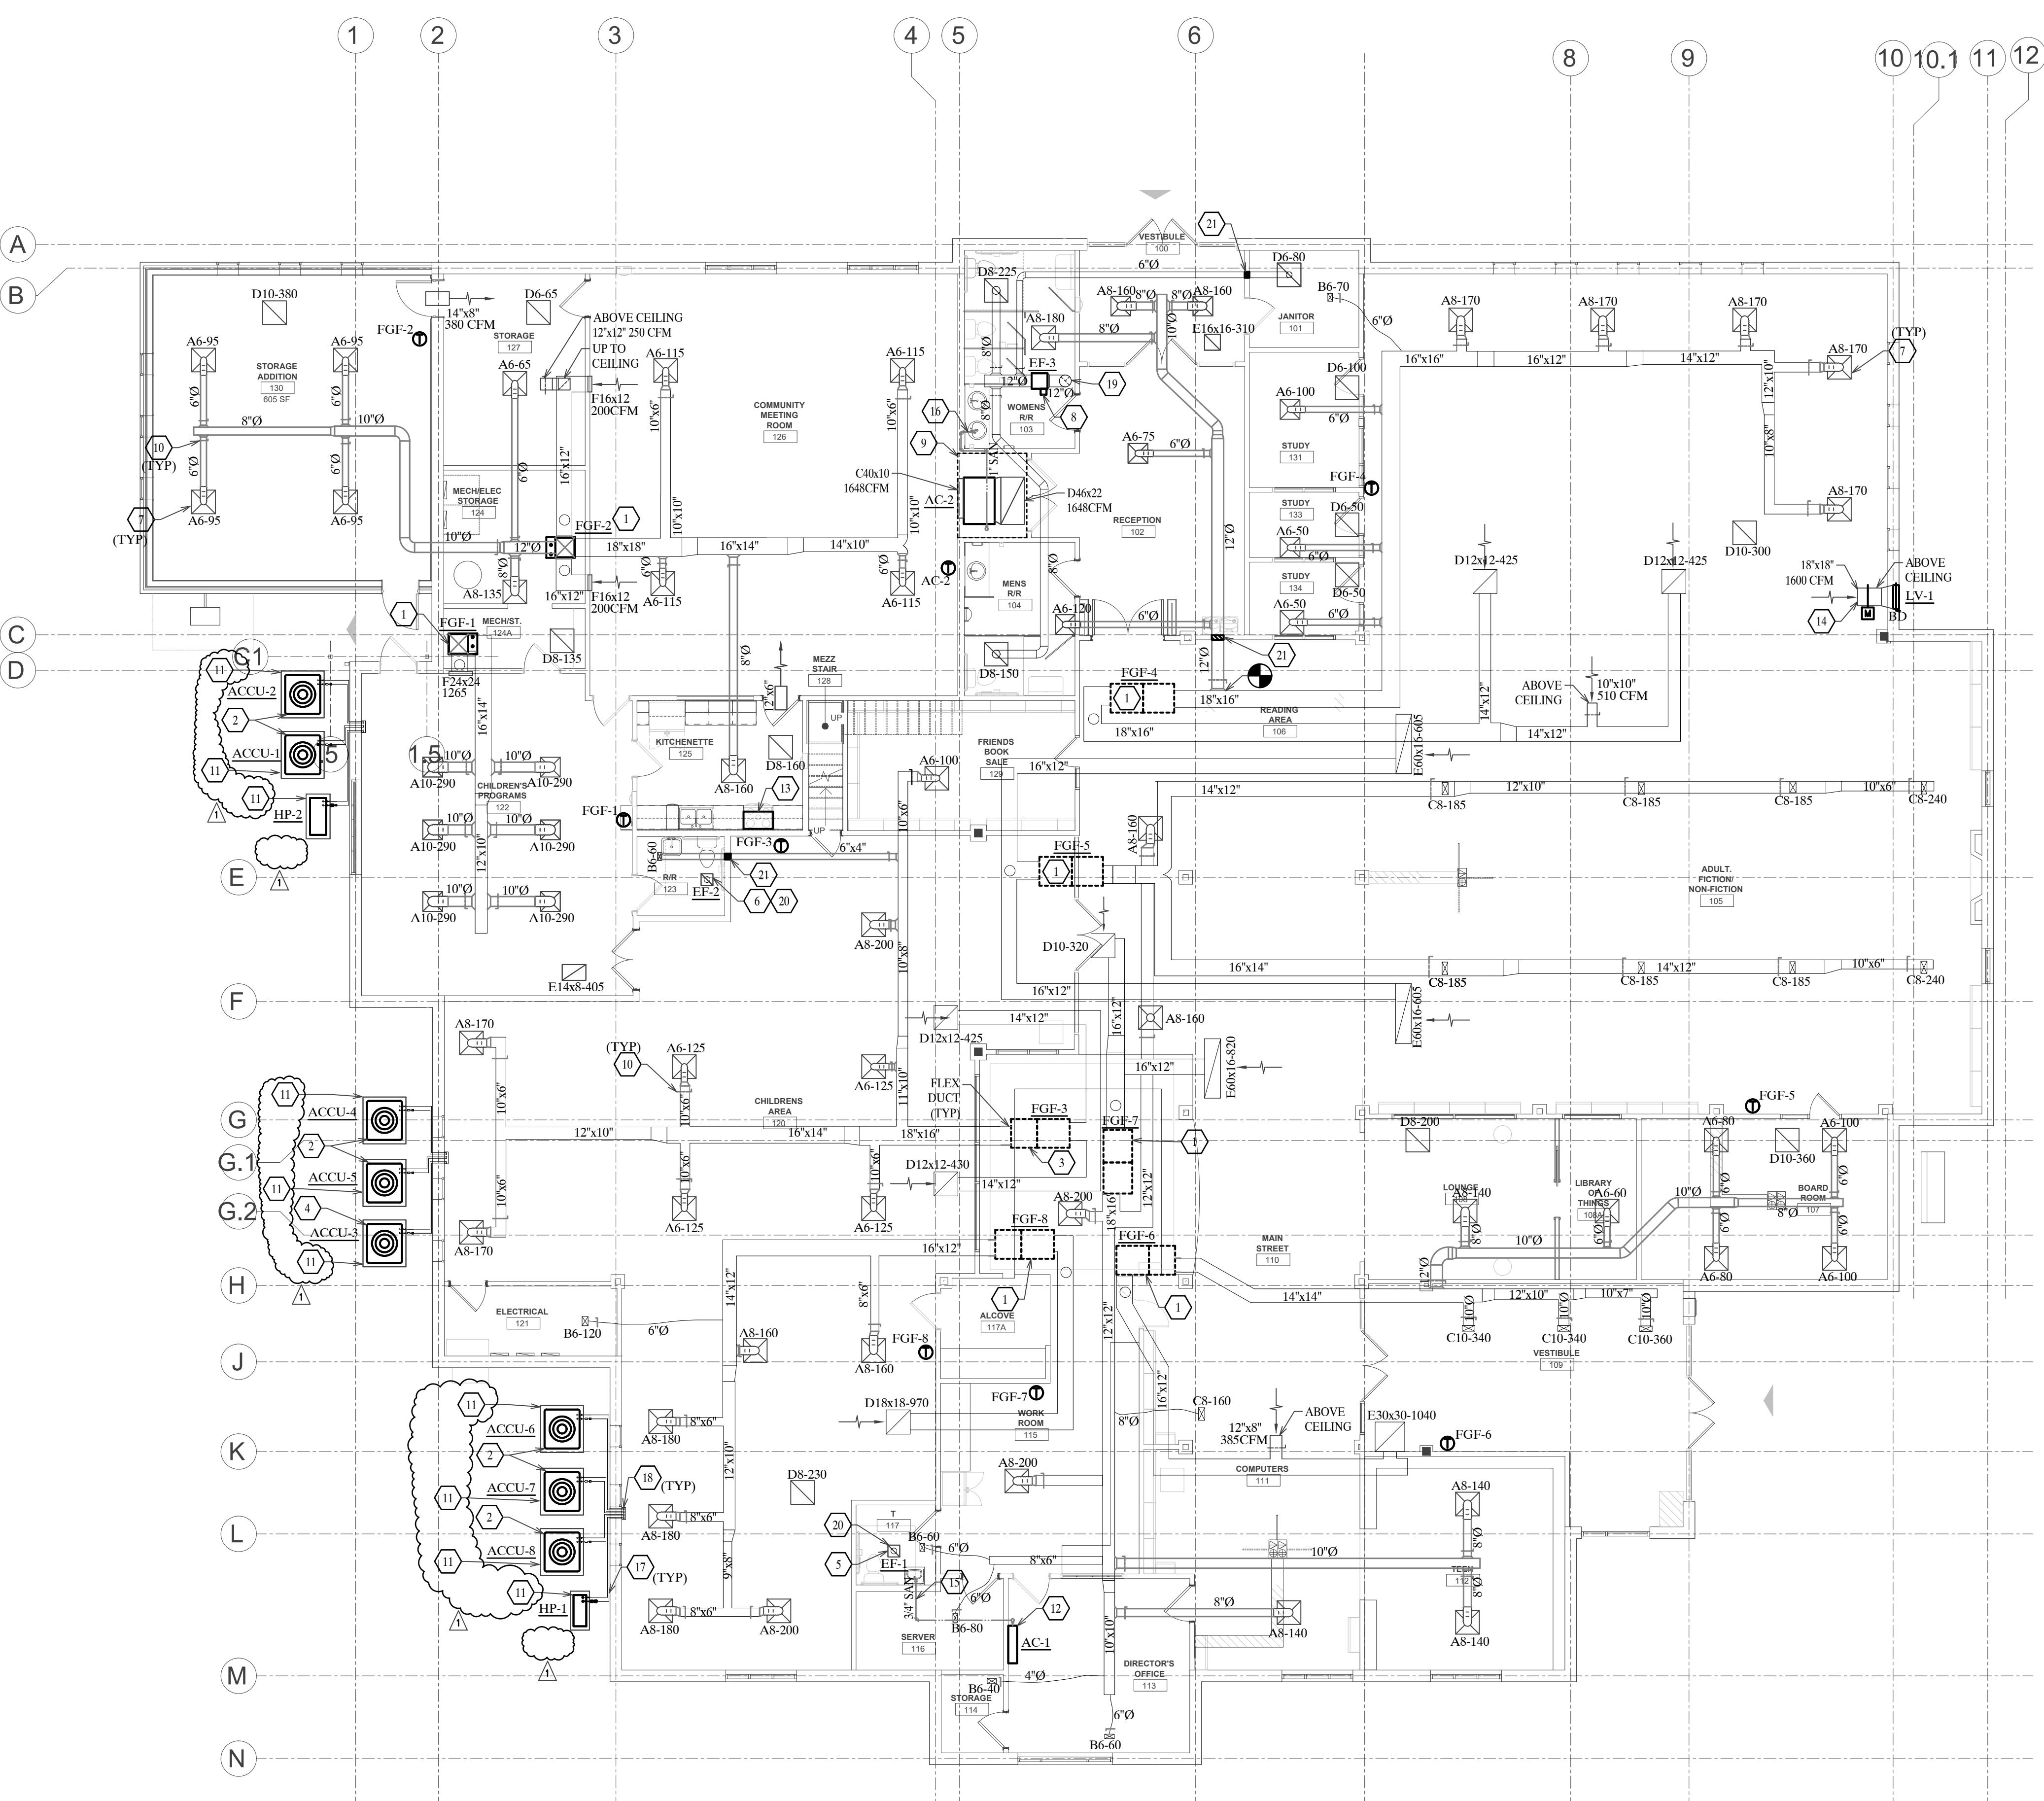

GENERAL NOTES

1. INSTALLATION SHALL COMPLY WITH 2008 INDIANA ELECTRIC CODE. ALL ITEMS/ EQUIPMENT INSTALLED EITHER IN PART OR ASSEMBLY SHALL BE UL/ NRTL LISTED PER CODE.
2. SUBMIT SUBMITTALS ON ALL EQUIPMENT, DEVICES AND MATERIALS.
3. COORDINATE WITH OTHER DISCIPLINES AND OWNER TO VERIFY FINAL LOCATIONS OF DEVICES AND CONNECTIONS.
4. SLOPED PIPING HAS RIGHT OF WAY OVER CONDUIT.
5. INSTALL PENETRATION FIRESTOPPING AS INDICATED AND REQUIRED.
6. HEIGHTS OF SUSPENDED EQUIPMENT SHALL BE TO THE BOTTOM OF THE UNIT.
7. HEIGHTS OF WALL MOUNTED EQUIPMENT SHALL BE TO THE CENTER OF THE UNIT.
8. IF MOUNTING HEIGHT IS NOT INDICATED, INSTALL AS HIGH AS POSSIBLE.
9. INSTALL SLEEVES AS NECESSARY:
 - a. SLEEVES FOR RACEWAYS AND CABLES SHALL BE SCHEDULE 40 GALVANIZED STEEL PIPE SLEEVES, ASTM A53/ A53M TYPE E, GRADE B WITH PLAIN ENDS.
 - b. FOR RECTANGULAR OPENINGS USE GALVANIZED SHEET STEEL WITH A THICKNESS OF 0.052 INCHES FOR OPENINGS SMALLER THAN 50 INCHES IN PERIMETER AND 0.138 INCHES FOR THOSE LARGER.
 - c. SLEEVES SHALL BE FLUSH WITH WALLS.
 - d. EXTEND FLOOR SLEEVES 2" ABOVE FINISHED FLOOR LEVEL.
 - e. IF NECESSARY GROUT SPACE OUTSIDE OF SLEEVE IN CONCRETE AND MASONRY WALLS AND FLOOR.
 - f. IN NON RATED FIRE WALLS AND FLOORS SEAL ANNULAR SPACE WITH JOINT SEALANT.
 - g. ALWAYS MAINTAIN FIRE RATING OF ASSEMBLY.
10. IF REQUIRED FOR HYDROSTATIC PRESSURE REASONS, INSTALL EPDM SEALING ELEMENTS WITH TWO PLASTIC PRESSURE PLATES AND STAINLESS STEEL CONNECTING BOLTS AND NUTS.
11. GROUT SHALL BE NONMETALLIC SHRINK-RESISTANT TYPE THAT IS NONSTAINING AND NON CORROSIVE.
12. EXTEND FLOOR SLEEVES 2" ABOVE FINISHED FLOOR.
13. MAINTAIN FIRE RATING OF FIRE-RATED ASSEMBLIES.
14. SEAL PENETRATION OF INDIVIDUAL RACEWAYS AND CABLES WITH FLEXIBLE BOOT-TYPE FLASHING.

REFERENCE SYMBOLS AND INFORMATION

<u>GENERAL NOTES (ON THIS SHEET):</u>	GENERAL INFORMATION OR REQUIREMENTS WHICH PERTAIN TO ALL SHEETS OF THE DISCIPLINE IT IS LOCATED ON.
<u>GENERAL NOTES:</u>	GENERAL INFORMATION OR REQUIREMENTS WHICH PERTAIN ONLY TO THE SHEET IT APPEARS ON.
<u>KEYED DEMOLITION NOTES/KEYED PLAN NOTES:</u>	KEYED NOTES WHICH ARE SPECIFIC ONLY TO THE SHEET IT APPEARS ON. KEYED NOTES ARE NUMBERED TO CORRESPOND WITH THE NUMBER INDICATED BY THE APPROPRIATE PLAN NOTE SYMBOL.
 _____	REVISION NUMBER
 _____	KEYED DEMOLITION NOTE
 _____	KEYED PLAN NOTE
 _____	CONNECTION POINT OF NEW TO EXISTING
 _____	DEMOLITION OF EXISTING TO THIS POINT
<u>DETAIL REFERENCE:</u>	INDICATES LOCATION OF DETAIL USED FOR CLARIFICATION OF INSTALLATION.
 ← ←	DETAIL NUMBER SHEET WHERE DETAIL IS LOCATED
<u>SECTION REFERENCE:</u>	INDICATES LOCATION OF SECTION OR ELEVATION THROUGH AREA INDICATED.
 ← ←	SECTION/ELEVATION NUMBER SHEET WHERE SECTION/ELEVATION IS LOCATED
<u>PHASING LINETYPES:</u>	INDICATES THE PHASE IN WHICH AN ELEMENT IS CREATED AND/OR DEMOLISHED.
— — — — —	DEMOLITION
_____	EXISTING TO REMAIN
— BY LAYER —	NEW WORK
_____	GENERAL CONSTRUCTION TO REMAIN

POWER

	DUPLEX RECEPTACLE
	RECEPTACLE SPECIAL, NEMA CONFIGURATION
	FLUSH FLOOR OUTLET
	FLUSH FLOOR BOX, THREE GANG
	EMERGENCY BATTERY UNIT
	RECEPTACLE, SINGLE
	RECEPTACLE, DUPLEX
	RECEPTACLE CEILING MOUNTED, DUPLEX
	RECEPTACLE, QUADRUPLEX
	RECEPTACLE, DUPLEX WEATHERPROOF ('WHILE-IN-USE' TYPE)
	RECEPTACLE ON EMERGENCY CIRCUIT, RECEPTACLE AND PLATE SHALL BE RED
	RECEPTACLE, DUPLEX, EMERGENCY RED TWIST LOCK
	RECEPTACLE, DUPLEX, GROUND FAULT CIRCUIT INTERRUPTER
	USB-A & C RECEPTACLE
	DOORBELL PUSH BUTTON
	DOOR BELL CHIME
	TRANSFORMER, 120V TO LOW VOLTAGE
	SECURITY ALARM POINT DOOR SWITCH
	SECURITY DOOR LOCK RELEASE - ELECTRIC STRIKE
	SECURITY MOTION DETECTOR
	SECURITY ALARM BELL
	CLOCK OUTLET
	CLOCK OUTLET WITH CONTROL STATION
	TELEVISION OUTLET (RG6)
	JUNCTION BOX 4 11/16 x 4 11/16 x 2 1/8" UNLESS NOTED OTHERWISE
	MAIN DISTRIBUTION OR POWER PANELBOARDS
	FLUSH OR SURFACE MOUNTED BRANCH PANELBOARDS 120/280V
	ELECTRICAL MOTOR CONNECTION - VERIFY HP, AND PHASE
	DISCONNECT SWITCH
	EXHAUST FAN CONNECTION
	MOTOR CONTROLLER WITH AUX CONTACTS HOA, PB, PILOT AND CONTROL TRANSFORMER.
	TELEVISION OUTLET (RG6 AND 2-CAT6)
	FUSED DISCONNECT SWITCH
	ELECTRICAL TRANSFORMER
	NON-FUSED DISCONNECT SWITCH RATING AS NOTED
	CIRCUIT POWER TRANSFORMER 480V PRIMARY, 120V SECONDARY
	CIRCUIT BREAKER
	FUSE
	GROUND

LIGHTS

- SURFACE MOUNTED OR RECESSED LED FIXTURE
- ☛ WALL MOUNTED LED FIXTURE
- SURFACE/RECESSED 1 x 4 LED LIGHT FIXTURE
- SURFACE/RECESSED 2 x 4 LED LIGHT FIXTURE
- ✖ PHOTOCELL
- ⊗ EXIT LIGHT FIXTURE CEILING MOUNTED
- ☛ EXIT LIGHT FIXTURE WALL MOUNTED
- ▨ LIGHT FIXTURE CONNECTED TO EMERGENCY POWER
- ↔ BATTERY OPERATED EMERGENCY LIGHT - WALL MOUNTED
- POLE MOUNTED LIGHT FIXTURE - SINGLE HEAD
- SURFACE / RECESSED LED FIXTURE
- ☛ WALL MOUNTED LED FIXTURE
- BOLLARD LIGHT FIXTURE
- ◑ FLOOD LIGHT GROUND MOUNTED

WIRE

- 弓 HOMERUN
- 弓 or WIRING CONCEALED IN CEILING OR WALL
- WIRING CONCEALED UNDER OR IN FLOOR
- WIRING EMERGENCY
- A • | C A= GROUND; B= NEUTRAL; C= HOT
- o WIRING TURNED UP
- • WIRING TURNED DOWN
- WIREMOLD; APPENDED NOTE DENOTES TYPE
- — CABLE TRAY
- H — HEAT TRACE CABLE
- K — CARD KEY ACCESS CONTROL
- F — CEILING MOUNTED FIRE ALARM HORN / STROBE

WIRE

 HOMERUN

or  WIRING CONCEALED IN CEILING OR WALL

 WIRING CONCEALED UNDER OR IN FLOOR

 WIRING EMERGENCY

 A = GROUND; B = NEUTRAL; C = HOT

 WIRING TURNED UP

 WIRING TURNED DOWN

 WIREMOLD; APPENDED NOTE DENOTES TYPE

 CABLE TRAY

 HEAT TRACE CABLE

 CARD KEY ACCESS CONTROL

 CEILING MOUNTED FIRE ALARM HORN / STROBE

FIRE

- (I) IONIZATION SMOKE
- (H) THERMAL DETECTOR 135° FIXED
- (P) PHOTO DETECTOR PHOTO ELECTRIC
- (F) PULL STATION
- STROBE UNIT 30CD
-  FIRE ALARM, IONIZATION DUCT DETECTOR
- (P)_{CO} COMBINATION SMOKE DETECTOR & CARBON MONOXIDE DETECTOR
-  FIRE ALARM CONTROL PANEL
-  FIRE ALARM ANNUNCIATOR PANEL
-  FIRE ALARM, TAMPER SWITCH
-  FIRE ALARM, FLOW SWITCH
-  HORN STROBE
-  FIRE ALARM, SPEAKER
-  FIRE ALARM, SPEAKER STROBE

SWITCHES

\$	SWITCH, SINGLE POLE
\$ ₃	SWITCH, THREE-WAY
\$ ₄	SWITCH, FOUR-WAY
\$ _{DS}	SWITCH, DIMMER
\$ _{DS}	SWITCH, DOOR SECURITY
\$ _K	SWITCH, KEYED
\$ _P	SWITCH, PILOT LIGHT
\$ _a	SWITCH, CONTROLLING FIXTURES MARKED WITH a
\$ _T	SWITCH, MANUAL TIMER
\$ _{TT}	TT SWITCH FOR MOTORS 1/2HP OR SMALLER
	PUSH BUTTON CONTROL STATION
	PUSH BUTTON "UP-DOWN-DN"
	PANIC BUTTON
	MOTION DETECTOR
	SECURITY GLASS BREAK DETECTOR
	SINGLE CIRCUIT PIR WALL SENSOR 'SCHNEIDER ELECTRIC' #SLSPWS1277UX(COLOR).
	DUAL CIRCUIT PIR WALL SENSOR 'SCHNEIDER ELECTRIC' #SLSPWD1277UX(COLOR).
	LOW VOLTAGE ULTRASONIC CEILING SENSOR 'SCHNEIDER ELECTRIC' #SLSCUS2000 (SENSOR); 'SCHNEIDER ELECTRIC' #SLSPP1277 (POWER PACK).
	LOW VOLTAGE CEILING MOUNT PIR OCCUPANCY SENSOR 'SCHNEIDER ELECTRIC' #SLSCI2000 (SENSOR); 'SCHNEIDER ELECTRIC' #SLSPP1277 (POWER PACK).
	LOW VOLTAGE CEILING MOUNT DUAL-TECHNOLOGY OCCUPANCY SENSOR 'SCHNEIDER ELECTRIC' #SLSCDT2000 (SENSOR); 'SCHNEIDER ELECTRIC' #SLSPP1277 (POWER PACK).

COMMUNICATION / SECURITY

- ▲ TELEPHONE OUTLET BOX AND COVER PLATE
- ▲ P TELEPHONE OUTLET BOX, AND COVER PLATE, PUBLIC
- ▲ TELEPHONE OUTLET FLOOR BOX WITH COVER PLATE
- ▲ TELEDATA OUTLET
- ▲ TELEDATA OUTLET FLOOR BOX WITH COVER PLATE
- ▲ DATA OUTLET
- S SPEAKER, FLUSH CEILING MOUNTED
- HS SPEAKER, WALL MOUNTED
- SK SPEAKER HORN TYPE, WALL MOUNTED
- PA SOUND SYSTEM AMPLIFIER
- IC INTERCOM HANDSET
- IC_M INTERCOM MASTER PANEL
- ICPS INTERCOM SYSTEM POWER SUPPLY
- CAM SECURITY CAMERA
- CAM_(360°) SECURITY CAMERA (360°)
- IR AUDIO/VISUAL WALL DEVICE
- II AUDIO/VISUAL WALL DEVICE

RAWING INDEX

DRAWING No.	DRAWING TITLE
E001	ELECTRICAL GENERAL INFORMATION
E002	ELECTRICAL DETAILS
E003	ELECTRICAL SPECIFICATIONS
E004	ELECTRICAL SPECIFICATIONS
E005	ELECTRICAL SCHEDULES
ED101	ELECTRICAL DEMOLITION PLAN
E101	ELECTRICAL LIGHTING PLANS
E102	ELECTRICAL LIGHTING CONTROL PLAN
E103	ELECTRICAL LIGHTING CONTROL RISER DIAGRAM
E201	ELECTRICAL POWER PLANS
E301	SITE LIGHTING PLAN
E302	SITE POWER PLAN

BUILDING ADDITION & RENOVATION TO SHERIDAN PUBLIC LIBRARY

卷之三

D E S I G N - A I R E E N G I N E E R I N G , I N C .
2707 RAND ROAD
voice (317) 464-9090
www.daengineering.com
Mechanical, Electrical, and Energy Engineering

THIS DRAWING AND THE IDEAS, DESIGN
AND CONCEPTS CONTAINED HEREIN ARE
EXCLUSIVE INTELLECTUAL PROPERTY OF
SIGN-AIRE ENGINEERING, INC., AND
MAY NOT BE USED OR REPRODUCED, WHOL-
LY OR IN PART, WITHOUT THE WRITTEN
CONSENT OF DESIGN-AIRE ENGINEERING,
INC. © 2004 DESIGN-AIRE ENGINEERING, INC.

ject number	2513
e	01.15.2
own by	DA
checked by	WJ

ELECTRICAL GENERAL INFORMATION

**BUILDING ADDITION & RENOVATION TO
SHERIDAN PUBLIC LIBRARY**

103 W. 1ST ST., SHERIDAN, INDIANA 46069

THIS DRAWING CONTAINS THE IDEAS, DESIGNS AND CONCEPTS OF DESIGN-AIRE ENGINEERING, INC. THESE IDEAS, DESIGNS AND CONCEPTS ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF DESIGN-AIRE ENGINEERING, INC. AND ARE NOT TO BE USED OR REPRODUCED, IN WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF DESIGN-AIRE ENGINEERING, INC.

© Copyright 2006, SHERIDAN ENGINEERING, INC.

Project number 25138

Date 01.15.26

Drawn by DAE


Checked by WJS

Designed by DAE


E002

ELECTRICAL
DETAILS


CONDUCTOR INSULATION AND MULTICONDUCTOR SCHEDULE TABLE							
	THHN-THWN	XHHW	MI	NM	MC	UF	AC
SERVICE ENTRANCE	●						
EXPOSED FEEDERS	●						
CONCEALED FEEDERS	●			●			●
FEEDERS BELOW CONCRETE		●					
FEEDERS UNDERGROUND	●						
FEEDERS BELOW RAISED FLOORING	●						
FEEDERS IN CABLE TRAY	●			●			●
EXPOSED BRANCH CIRCUITS	●						
CONCEALED BRANCH CIRCUITS	●			●			●
BRANCH CIRCUITS BELOW CONCRETE	●						
BRANCH CIRCUITS UNDERGROUND		●					
BRANCH CIRCUITS BELOW RAISED FLOORING	●						
BRANCH CIRCUITS IN CABLE TRAY	●						
CLASS 1 CONTROL CIRCUITS	●						
CLASS 2 CONTROL CIRCUITS	●						

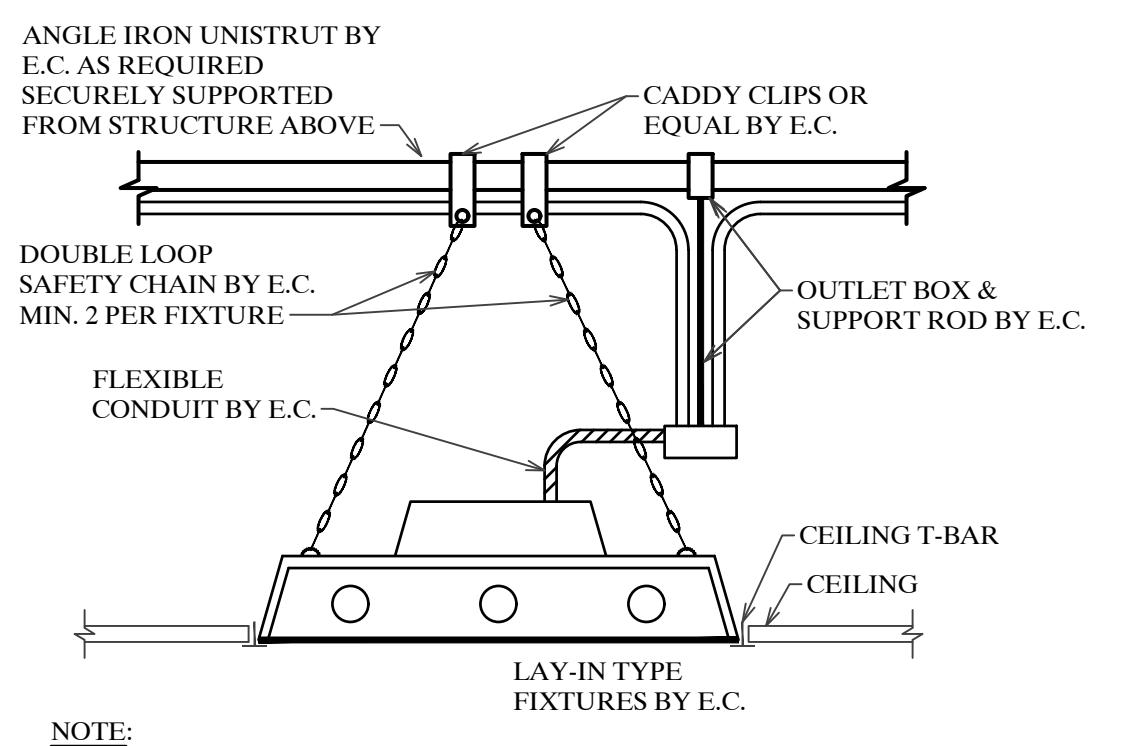

NOTE:
LIGHTING FIXTURES MUST BE SUPPORTED INDEPENDENTLY OF
CEILING SYSTEM. UPON WRITTEN REQUEST TO THE ENGINEER,
OTHER MEANS OF SUPPORT WILL BE CONSIDERED FOR APPROVAL.

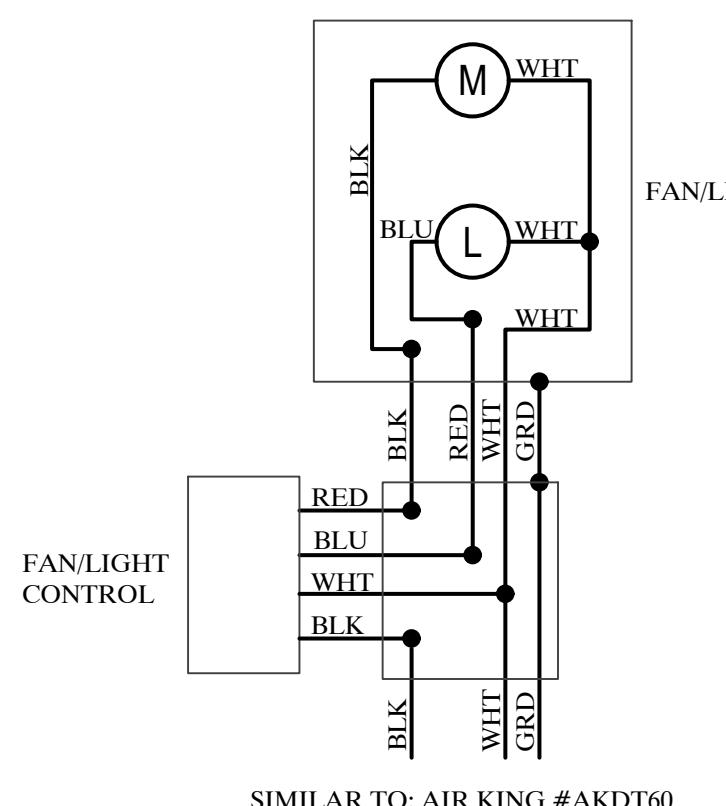

SIMILAR TO: AIR KING #AKDT60

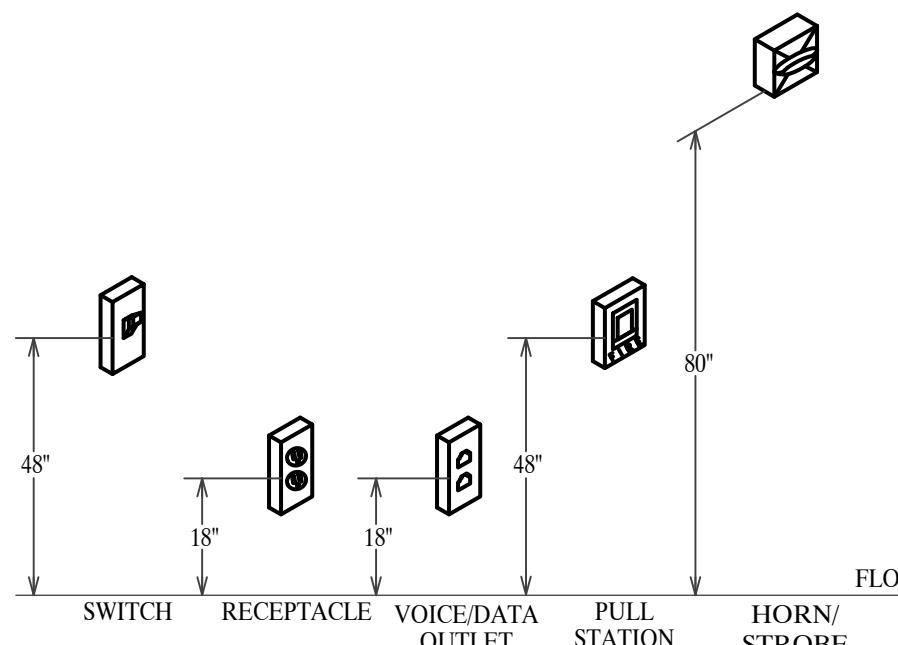


NOTE: ALL DIMENSIONS ARE TYPICAL FOR GIVEN
DEVICE UNLESS OTHERWISE NOTED ON PLANS.

SCHEDULE OF CONDUIT APPLICATIONS							
CONDUIT LOCATION OR APPLICATION	CONDUIT TYPE						
	RIGID	INTERMEDIATE	E.M.T.	FLEXIBLE	FLEXIBLE W/ WIRE JACKET	PVC SCHED 40	A.C. CABLE
IN CONCRETE SLAB (NOT LARGER THAN 1")	(3)						
BELLOW LOWEST FLOOR SLAB	(3)			(2)			
CONCEALED IN WALLS, ABOVE CEILINGS AND IN FURRED SPACES	(3)	(1)					
INSIDE, ABOVE BOTTOM OF ROOF STEEL							
FEEDER, POWER AND SIGNAL CIRCUITS RUN EXPOSED	(3)	(3)					
FINAL CONNECTION TO EQUIP. SUBJECT TO VIBRATION							
FINAL CONNECTION TO EQUIP. IN DAMP LOCATIONS							
SHOT CONNECTIONS WHERE NON-FLEXIBLE CONDUIT IS IMPRACTICAL							
NOTE:							
(1) - TYPE OF CONDUIT TO BE USED.							
(1) - E.M.T. SHALL NOT BE USED IN SIZES LARGER THAN 2 INCH.							
(2) - CONVERT TO RIGID OR INTER. THROUGH SLAB.							
(3) - USE THREADED FITTINGS ONLY.							

D LAY-IN FIXTURE SUPPORT DETAIL

E002 SCALE: NTS

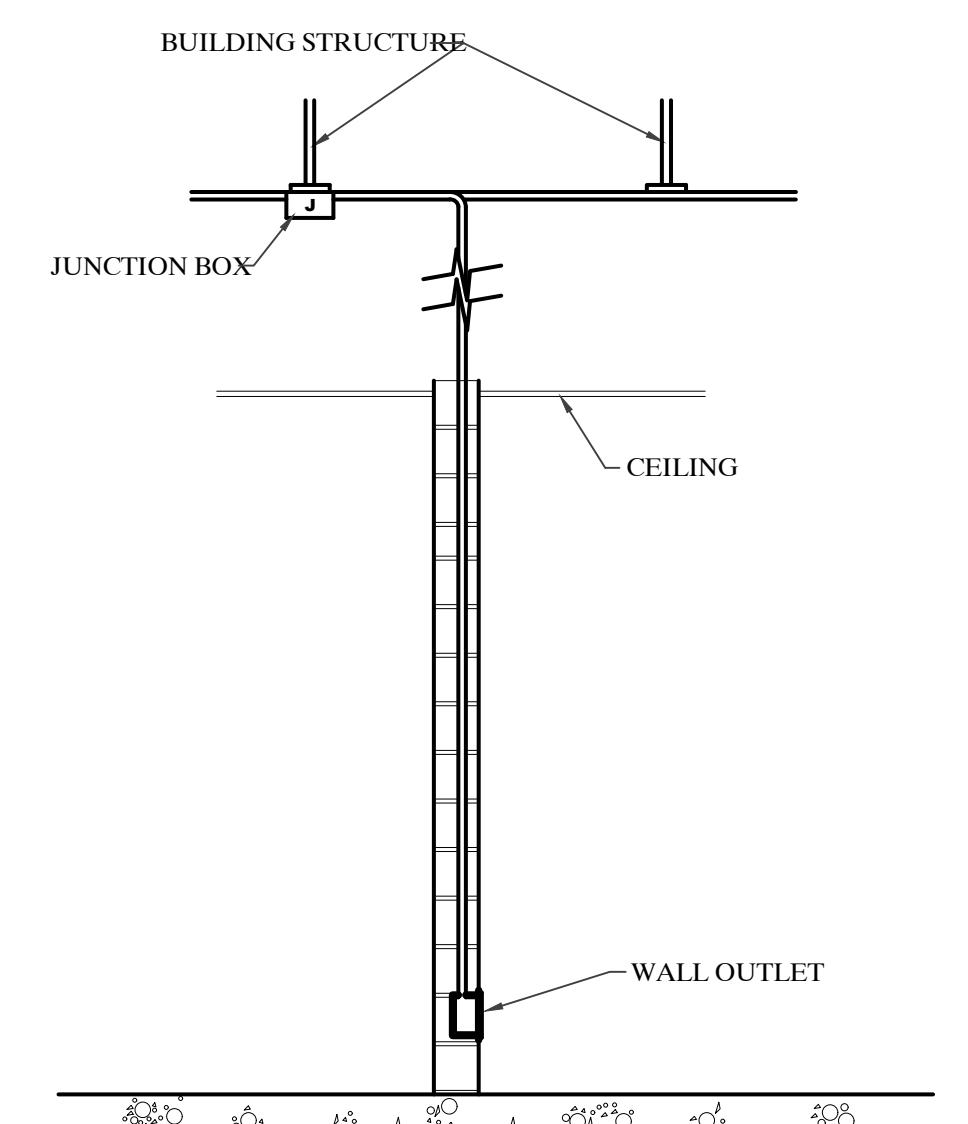

D TYPICAL DETAIL FOR OVERHEAD FEED TO INTERIOR WALL OUTLET


E002 SCALE: NTS

MINIMUM SIZE EQUIPMENT GROUNDING CONDUCTORS FOR GROUNDING RACEWAY AND EQUIPMENT		
CONDUCTOR SIZING FOR RHW, THHW, THW, THWN, XHHW, USE, ZW AT 167°F		
SIZE (AWG OR KCMIL)	COPPER	ALUMINUM OR COPPER CLAD ALUMINUM
	15	14
20	12	10
60	10	8
100	8	6
200	6	4
300	4	2
400	3	1
500	2	1.0
600	1	2.0
800	1.0	3.0
1000	2.0	4.0
1200	3.0	5.0
1600	4.0	350
2000	250	400
2500	350	400
3000	400	600
4000	500	600
5000	700	750
6000	800	1200

CONDUCTOR SIZING FOR RHW, THHW, THW, THWN, XHHW, USE, ZW AT 167°F		
SIZE (AWG OR KCMIL)		
KCMIL	COPPER	ALUMINUM OR COPPER CLAD ALUMINUM
10	35	30
8	50	40
6	65	50
4	85	65
3	100	75
2	115	90
1	130	100
1/0	150	120
2/0	175	135
3/0	200	155
4/0	230	180
5/0	255	205
6/0	285	220
8/0	310	250
10/0	335	270
12/0	380	310
14/0	420	340
16/0	460	375
18/0	475	385
20/0	490	395
22/0	520	425
24/0	545	445
26/0	560	455
28/0	625	520
30/0	650	545
32/0	665	560

F TYPICAL ROOF PENETRATION

E002 SCALE: NTS

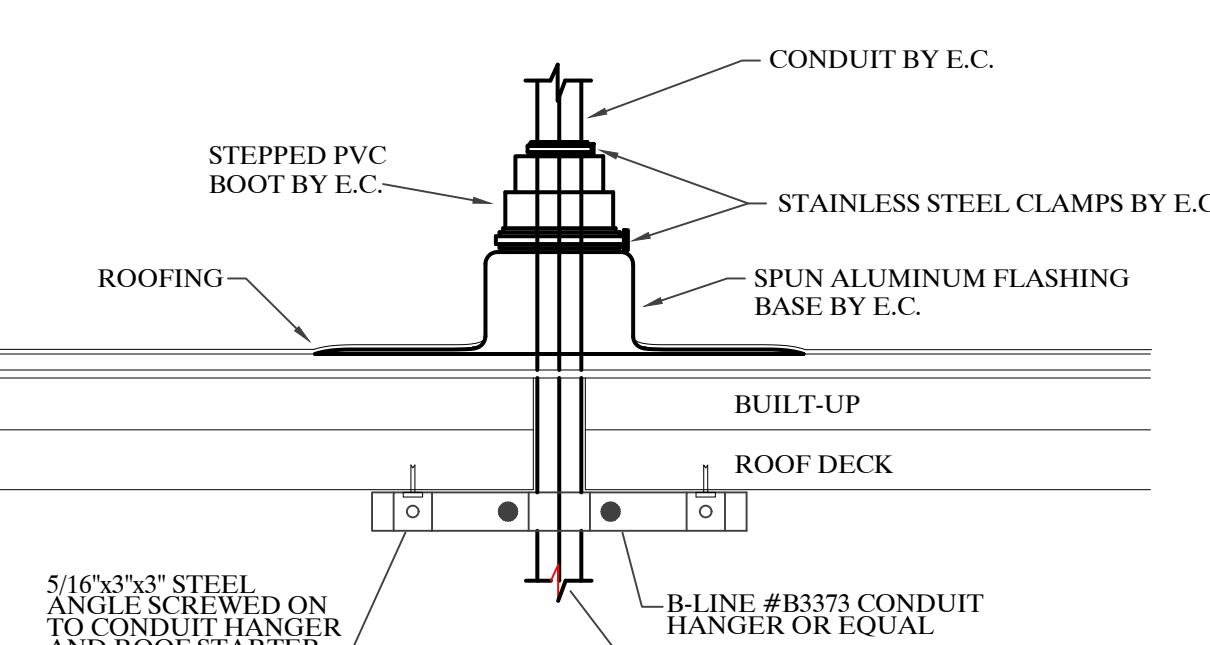

G TYPICAL ROOF PENETRATION

E002 SCALE: NTS

G TYPICAL TV OUTLET ROUGH-IN DETAIL

E002 SCALE: NTS

H TYPICAL DATA OUTLET ROUGH-IN DETAIL


E002 SCALE: NTS

I TYPICAL DATA OUTLET ROUGH-IN DETAIL

E002 SCALE: NTS

J TYPICAL DATA OUTLET ROUGH-IN DETAIL

E002 SCALE: NTS

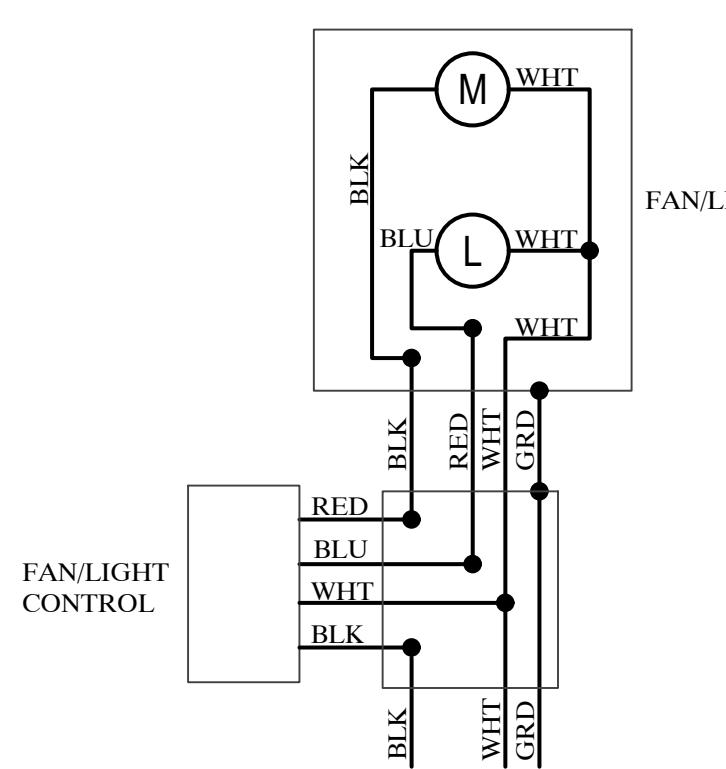

SIMILAR TO: AIR KING #AKDT60

B FAN/LIGHT SWITCH SCHEMATIC

E002 SCALE: NTS

REVISIONS

1

ADDENDUM 1

1/26/2026

REVISIONS

1

ADDENDUM 2

1/26/2026

REVISIONS

1

ADDENDUM 3

1/26/2026

REVISIONS

1

ADDENDUM 4

1/26/2026

REVISIONS

1



ADDENDUM 5

1/26/202

LIGHT FIXTURE SCHEDULE-BASIS OF DESIGN

TYPE	MOUNTING	LAMPS	WATTS	NOMINAL DIMENSION	MFGR & CAT NO. OR ACCEPTABLE EQUIVALENT	REMARKS
A	LAY-IN	LED	46.6W	2'x4'	LITHONIA STAKS 2X4 AL06 SWW7	2'x4' LED CENTER ELEMENT LAY-IN
A2	SURFACE	LED	46.6W	2'x4'	LITHONIA STAKS 2X4 AL06 SWW7	2'x4' LED CENTER ELEMENT SURFACE MOUNT
A3	LAY-IN	LED	33.1W	2'x2'	LITHONIA STAKS 2X2 AL03 SWW7	2'x2' LED CENTER ELEMENT LAY-IN
B	LAY-IN	LED	35.6W	2'x4'	LITHONIA CPX 2X4 AL08 SWW7 M2	2'x4' LED PANEL LAY-IN
E	RECESSED	LED	15W	6" ROUND	ACUITY IVO6S D 15LM40K80CRI	6" ROUND SHALLOW RECESSED DOWNLIGHT
G	WALL	LED	24.4	-	ANP LIGHTING LA844 FR CPS30W18	EXTERIOR WALL MOUNT
J2	SURFACE	LED	27.2	4' LINEAR	EDGE EX3D AN840HO UFSD10W	SURFACE MOUNT
K2	PENDANT	LED	27.2	4' LINEAR	EDGE EX3D AN840HO UFSD10W	
R	SURFACE	LED	13	18"	LITHONIA UCES 18IN-SWW5-90CRI-WH-M6	18" UNDERCABINET LED
S	SURFACE	LED	34.2	48"	LITHONIA CSS-L48-AL03-MVOLT-SWW3	48" LED STRIP LIGHT
T	WALL	LED	24.4	-	LITHONIA WPX1-LED-P2-40K-MVOLT-DDBXD	-
S1	POLE	LED	24.4	-	LITHONIA RSX2-LED-P3-40K-R5-MVOLT	-
FL	WALL	LED	24.4	-	LITHONIA ESXF-AL0-SWW2-KY-DDB	-
CL	SURFACE	LED	34	-	LITHONIA CNY-LED-AL0-SWW2-UVOLT	CANOPY LED LIGHT
EM	UNIV	LED	4	-	ENERGYWISE SOLUTIONS #EWCU SERIES	REMOTE HEAD EMERGENCY LIGHT 90 MINUTE BATTERY BACKUP
EX	UNIV	LED	4	-	ENERGYWISE SOLUTIONS #EWCE SERIES	EMERGENCY LIGHT 90 MINUTE BATTERY BACKUP

SPECIFIED LIGHT FIXTURE SCHEDULE

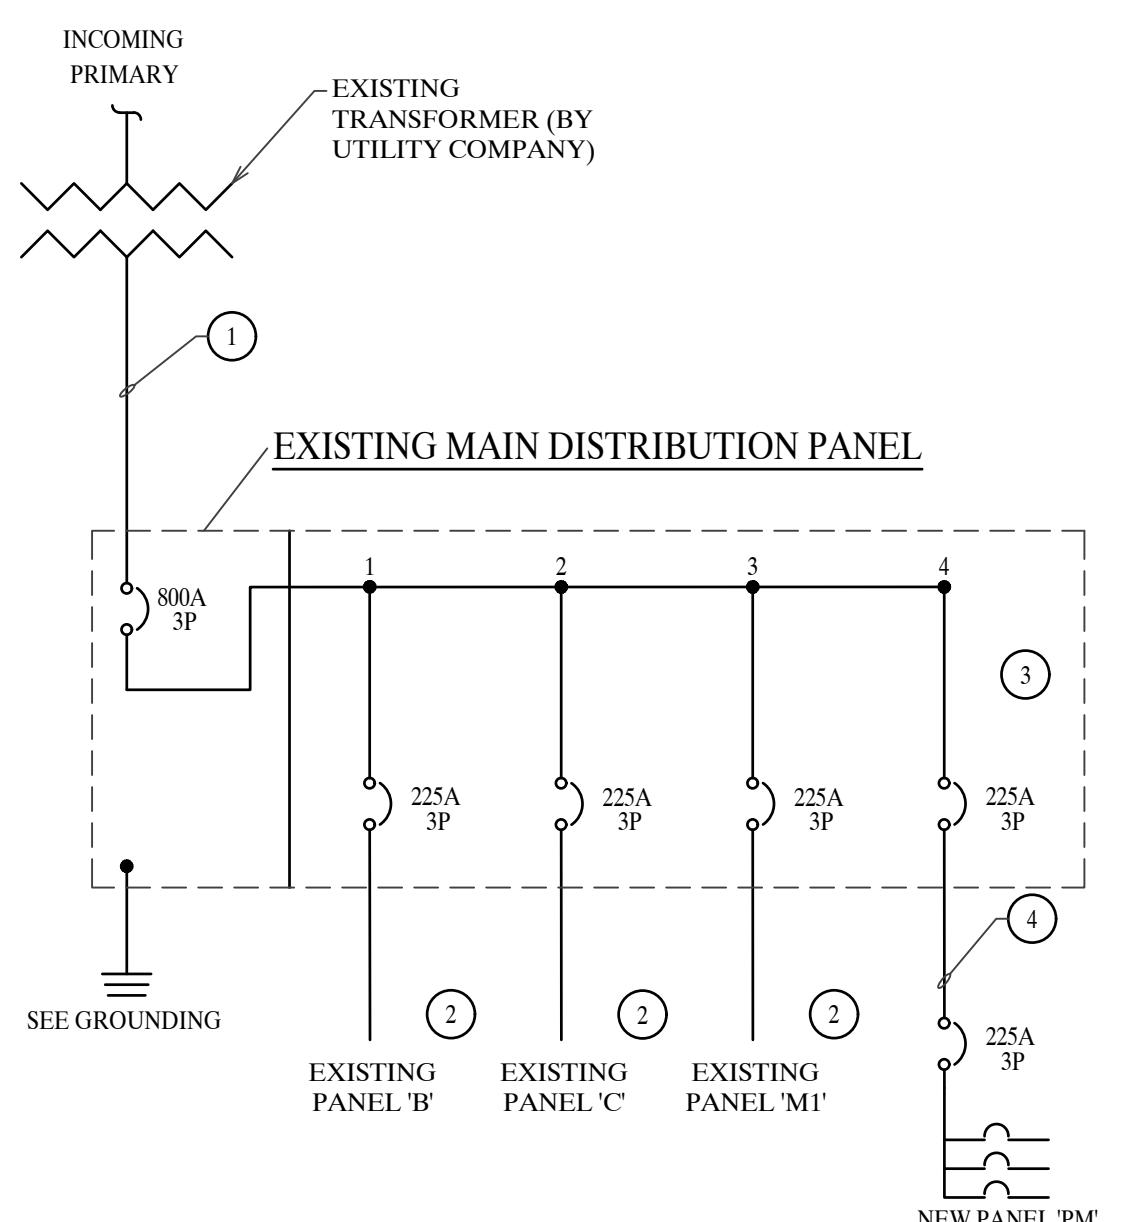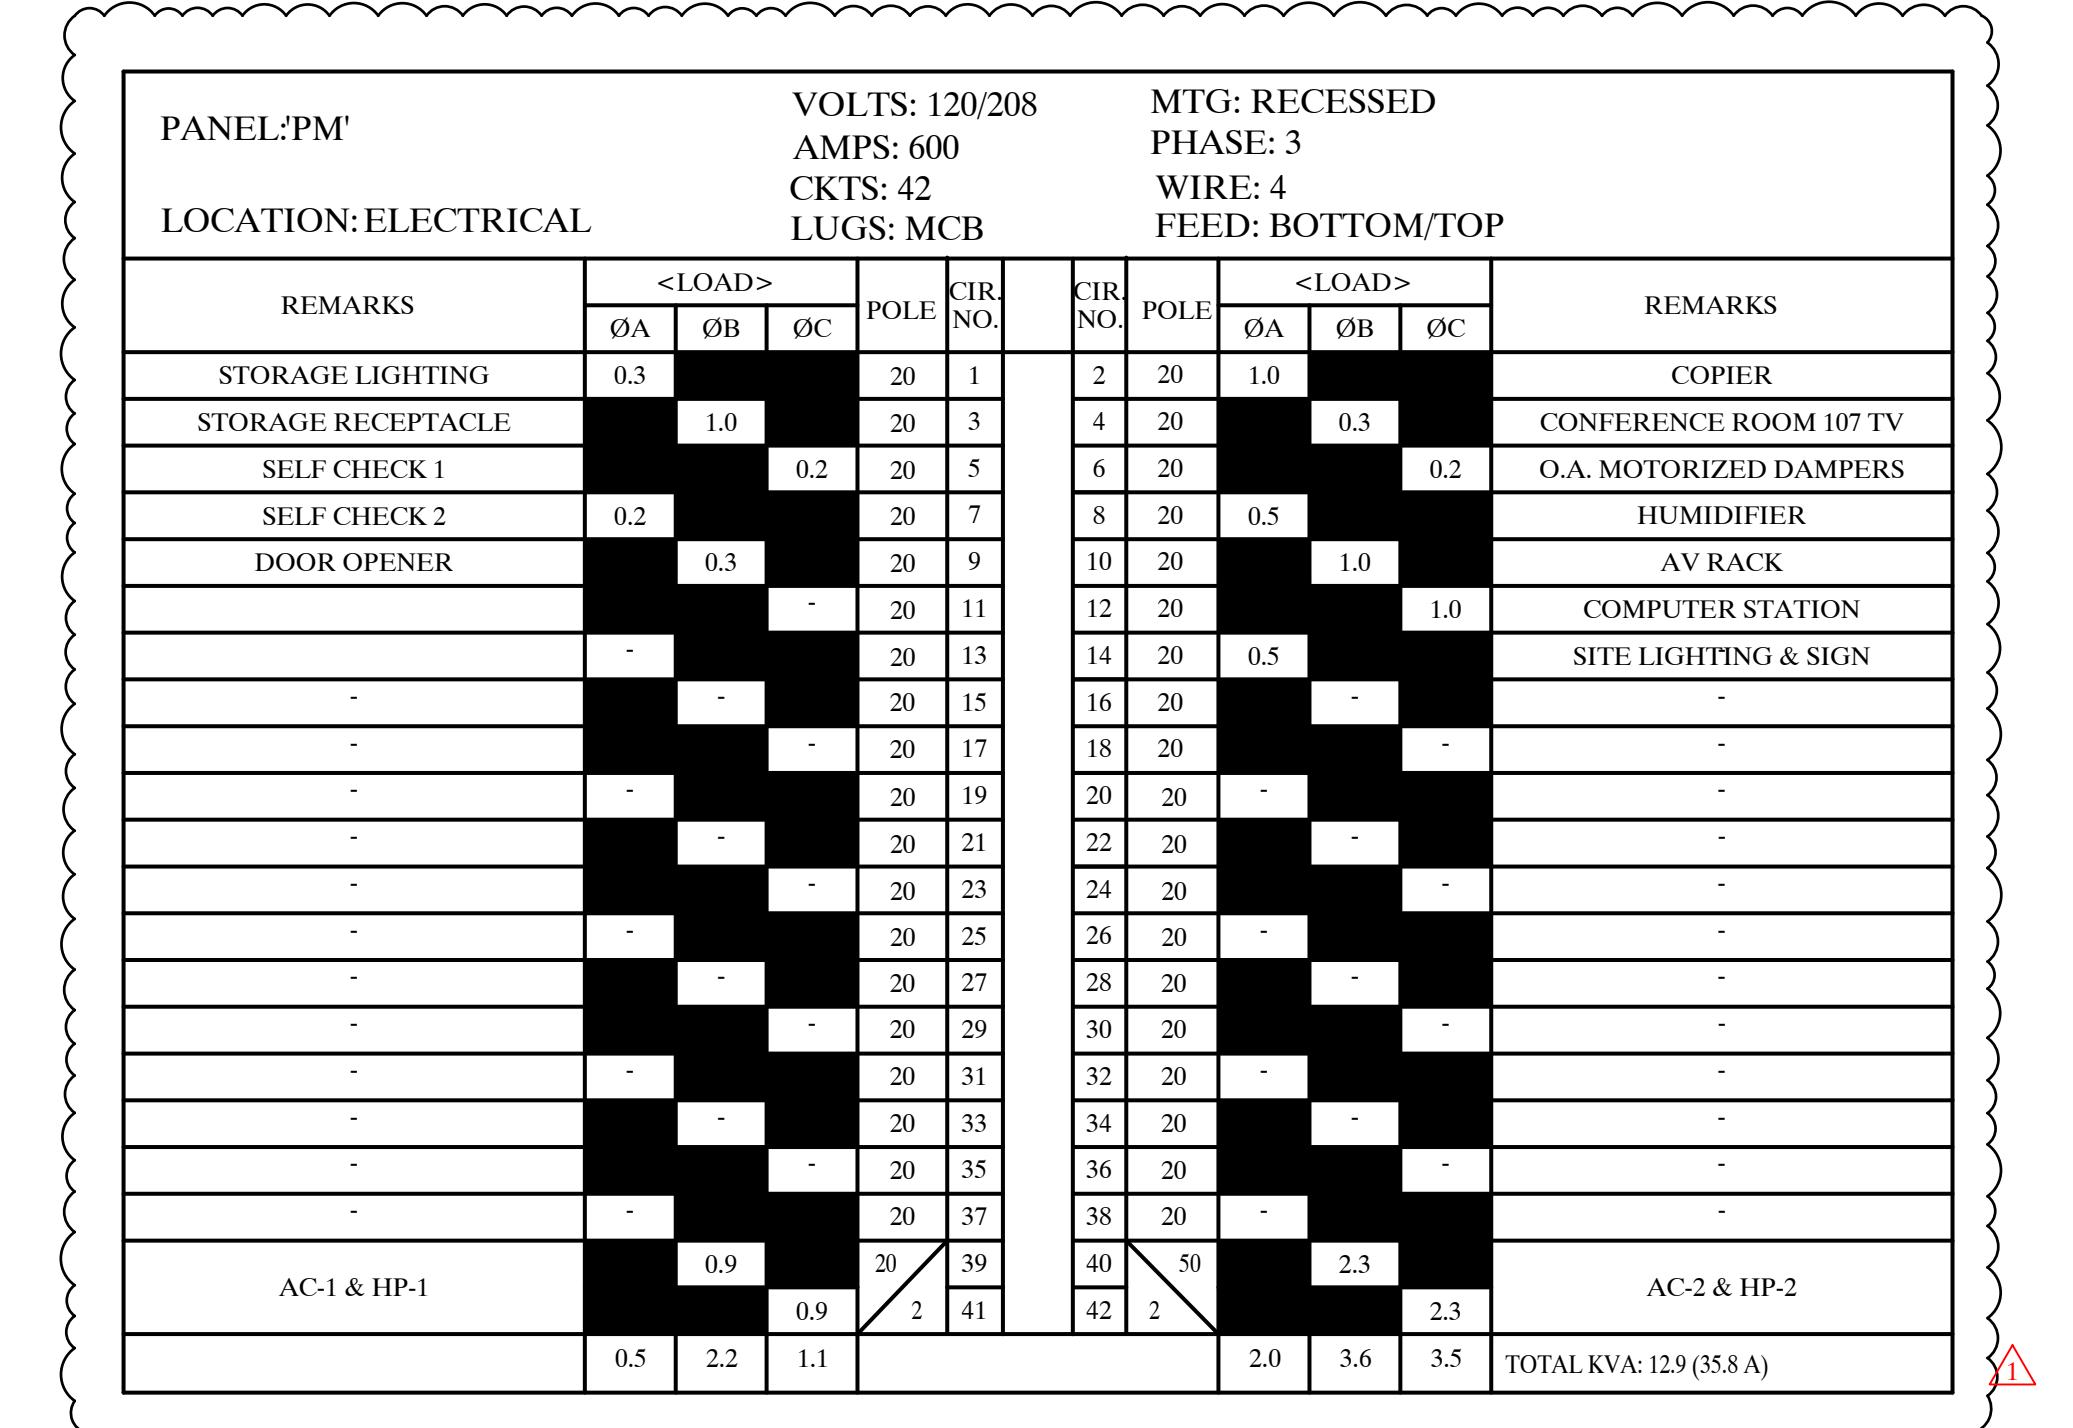

ELECTRICAL ONE-LINE DIAGRAM

NO SCALE

④ ONE-LINE PLAN NOTES

1. EXISTING FEEDER TO MDP TO REMAIN.
2. EXISTING PANEL BOARD TO REMAIN.
3. INSTALL NEW 225A BREAKER.
4. 4-#4/0, 1-#2 GND IN A 2-1/2" CONDUIT.

BUILDING ADDITION & RENOVATION TO SHERIDAN PUBLIC LIBRARY

卷之三

D E S I G N - A I R E E N G I N E E R I N G , I N C .
2707 RAND ROAD
voice (317) 464-9090
www.daengineering.com
Indianapolis, Indiana 46241
fax (317) 464-9393
Email: dae@daengineering.com
Mechanical, Electrical, and Energy Engineering

THE EXCLUSIVE INTELLECTUAL PROPERTY OF
DESIGN-AIRE ENGINEERING, INC., AND ARE
NOT TO BE USED OR REPRODUCED, WHOLE
OR IN PART, WITHOUT THE WRITTEN
CONSENT OF DESIGN-AIRE ENGINEERING.
© COPYRIGHT 2024 DESIGN-AIRE ENGINEERING, INC.

Project number	25138
Date	01.15.26
Drawn by	DAE
Checked by	WJS
Designed by	DAF

E00

ELECTRIC SCHEDULE

BUILDING ADDITION & RENOVATION TO SHERIDAN PUBLIC LIBRARY

103 W. 1ST ST., SHERIDAN, INDIANA 46069

GENERAL DEMOLITION NOTES:


- A. ALL EXISTING TO REMAIN DUCTS MUST BE CLEANED AND SEALED.
- B. PROPOSED DOWNSPOUTS DROPPING NEW DUCTWORK SUPPORTS.
- C. HIGHLIGHTED PINK COLOR INDICATE REMOVE EXISTING DUCTWORK (WITH ACCESSORIES), EQUIPMENT, THERMOSTAT, SUPPLY DIFFUSER AND GRILLE, RETURN AND EXHAUST GRILLE, AND EXHAUST FAN (FOR FURNACE AND COIL DEMOLITION SEE DETAIL 3 ON THIS SHEET).
- D. HIGHLIGHTED BLUE COLOR INDICATE REMAIN AND REUSED EXISTING DUCTWORK, SUPPLY AND RETURN GRILLES (REBALANCE CFM), FLUE VENT, COMBUSTION AIR PVC, NATURAL GAS LINE, CONDENSATE DRAIN AND OVERFLOW PAN UNDER FURNACE.
- E. REPLACE ALL FLEXIBLE AIR CONNECTOR, LENGTHS SHALL BE NOT MORE THAN 5 FEET.
- F. HIGHLIGHTED GREEN COLOR INDICATE NEW DUCTWORK, SUPPLY DIFFUSER, RETURN AND EXHAUST GRILLE, NATURAL GAS LINE, MOTORIZED DAMPER, VOLUME DAMPER, INDOOR AND OUTDOOR UNIT MINI SPLIT SYSTEM, EXHAUST FAN, RELIEF LOUVER WITH BACKDRAFT DAMPER, THERMOSTAT.

DEMOLITION PLAN NOTES:

1. EXISTING LIGHT SHALL BE REPLACED WITH NEW LIGHT AS INDICATED.
2. EXISTING LIGHT TO REMAIN.
3. EXISTING LIGHT SHALL BE DISCONNECTED AND REMOVED.
4. REMOVE EXISTING CONNECTION FOR FUR-3 AND BRANCH CIRCUIT BACK TO MAIN.
5. REMOVE EXISTING CONNECTION FOR AC-3 AND BRANCH CIRCUIT BACK TO MAIN.
6. DISCONNECT AND REMOVE EXISTING EXHAUST FANS, EXISTING CONNECTION TO REMAIN FOR NEW EXHAUST FANS.
7. REMOVE EXISTING CONNECTION FOR EXHAUST FAN AND BRANCH CIRCUIT BACK TO MAIN.
8. RELOCATE OPERATING AND EXISTING CONNECTION TO REMAIN, PROVIDE FLOOR BOX WITH ACCESS COVER.
9. EXISTING ELECTRICAL RECEPTACLE TO REMAIN.
10. DISCONNECT AND REMOVE EXISTING HVAC EQUIPMENT, EXISTING CONNECTION TO REMAIN FOR NEW EQUIPMENT.
11. NOT USED.
12. DISCONNECT AND REMOVE DRINKING FOUNTAIN.
13. ALL EXISTING KITCHEN DEVICES SHALL BE DISCONNECTED AND REMOVED.
14. EXISTING EXTERIOR LIGHTING SHALL BE REPLACED.
15. EXISTING EXTERIOR LIGHTING SHALL BE REMOVED.
16. EXISTING SECURITY CAMERA TO REMAIN.
17. RELOCATE THE EXISTING LIGHTING.
18. EXISTING ELECTRICAL PANEL TO REMAIN.



ELECTRICAL DEMOLITION PLAN
 SCALE: 1/8" - 1'-0"

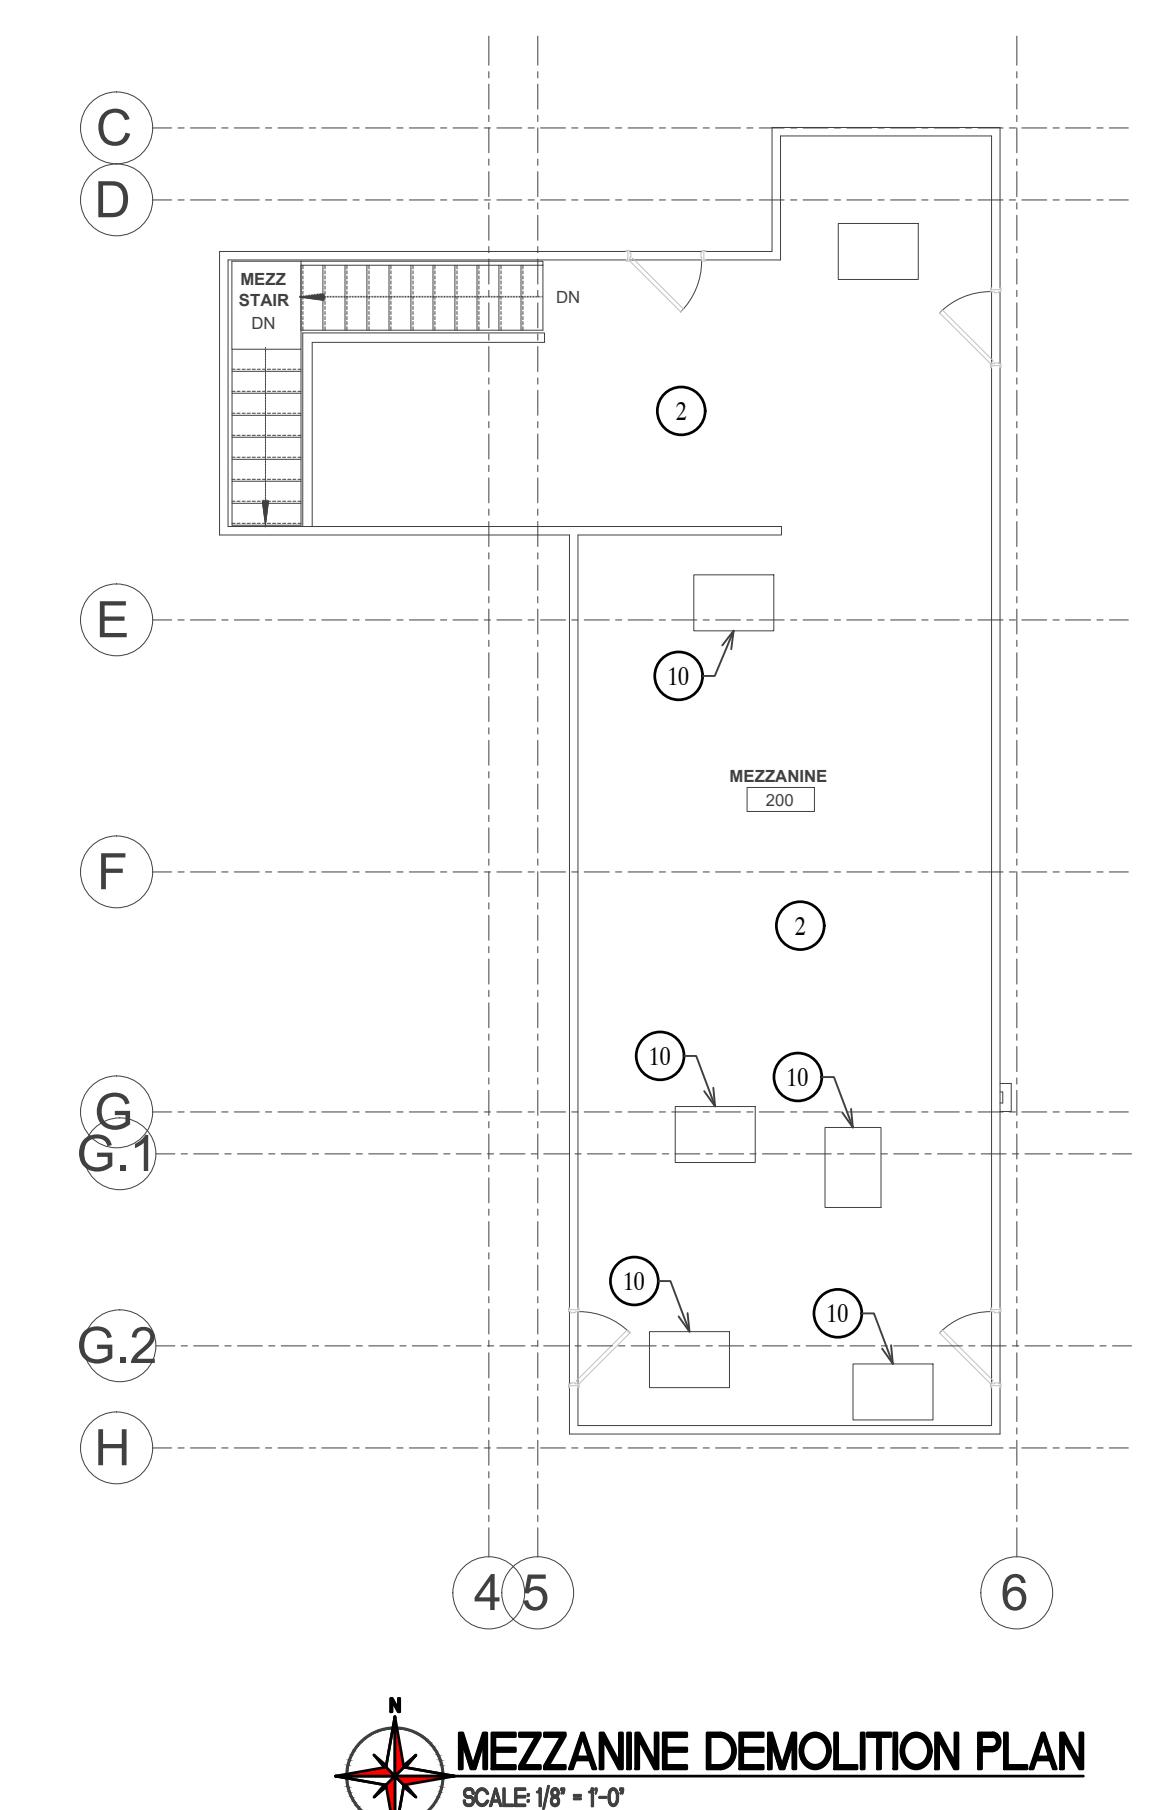

MEZZANINE DEMOLITION PLAN
 SCALE: 1/8" - 1'-0"

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF DESIGN-AIRE ENGINEERING, INC. AND ARE NOT TO BE USED OR REPRODUCED IN WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF DESIGN-AIRE ENGINEERING, INC.

©COPRIGHT 2008, DESIGN-AIRE ENGINEERING, INC.

Project number 25138

Date 01.15.26

Drawn by DAE

Checked by WJS

Designed by DAE

ED101

**ELECTRICAL
DEMOLITION
PLAN**


100%
CONSTRUCTION
DOCUMENTS

WILLIAM J. SNOGRASS
REGISTERED
No. 17006
STATE OF
INDIANA
PROFESSIONAL
ENGINEER
Signature

CERTIFIED

No.	Description	Date
1	ADDENDUM 1	1/26/2026

REVISIONS

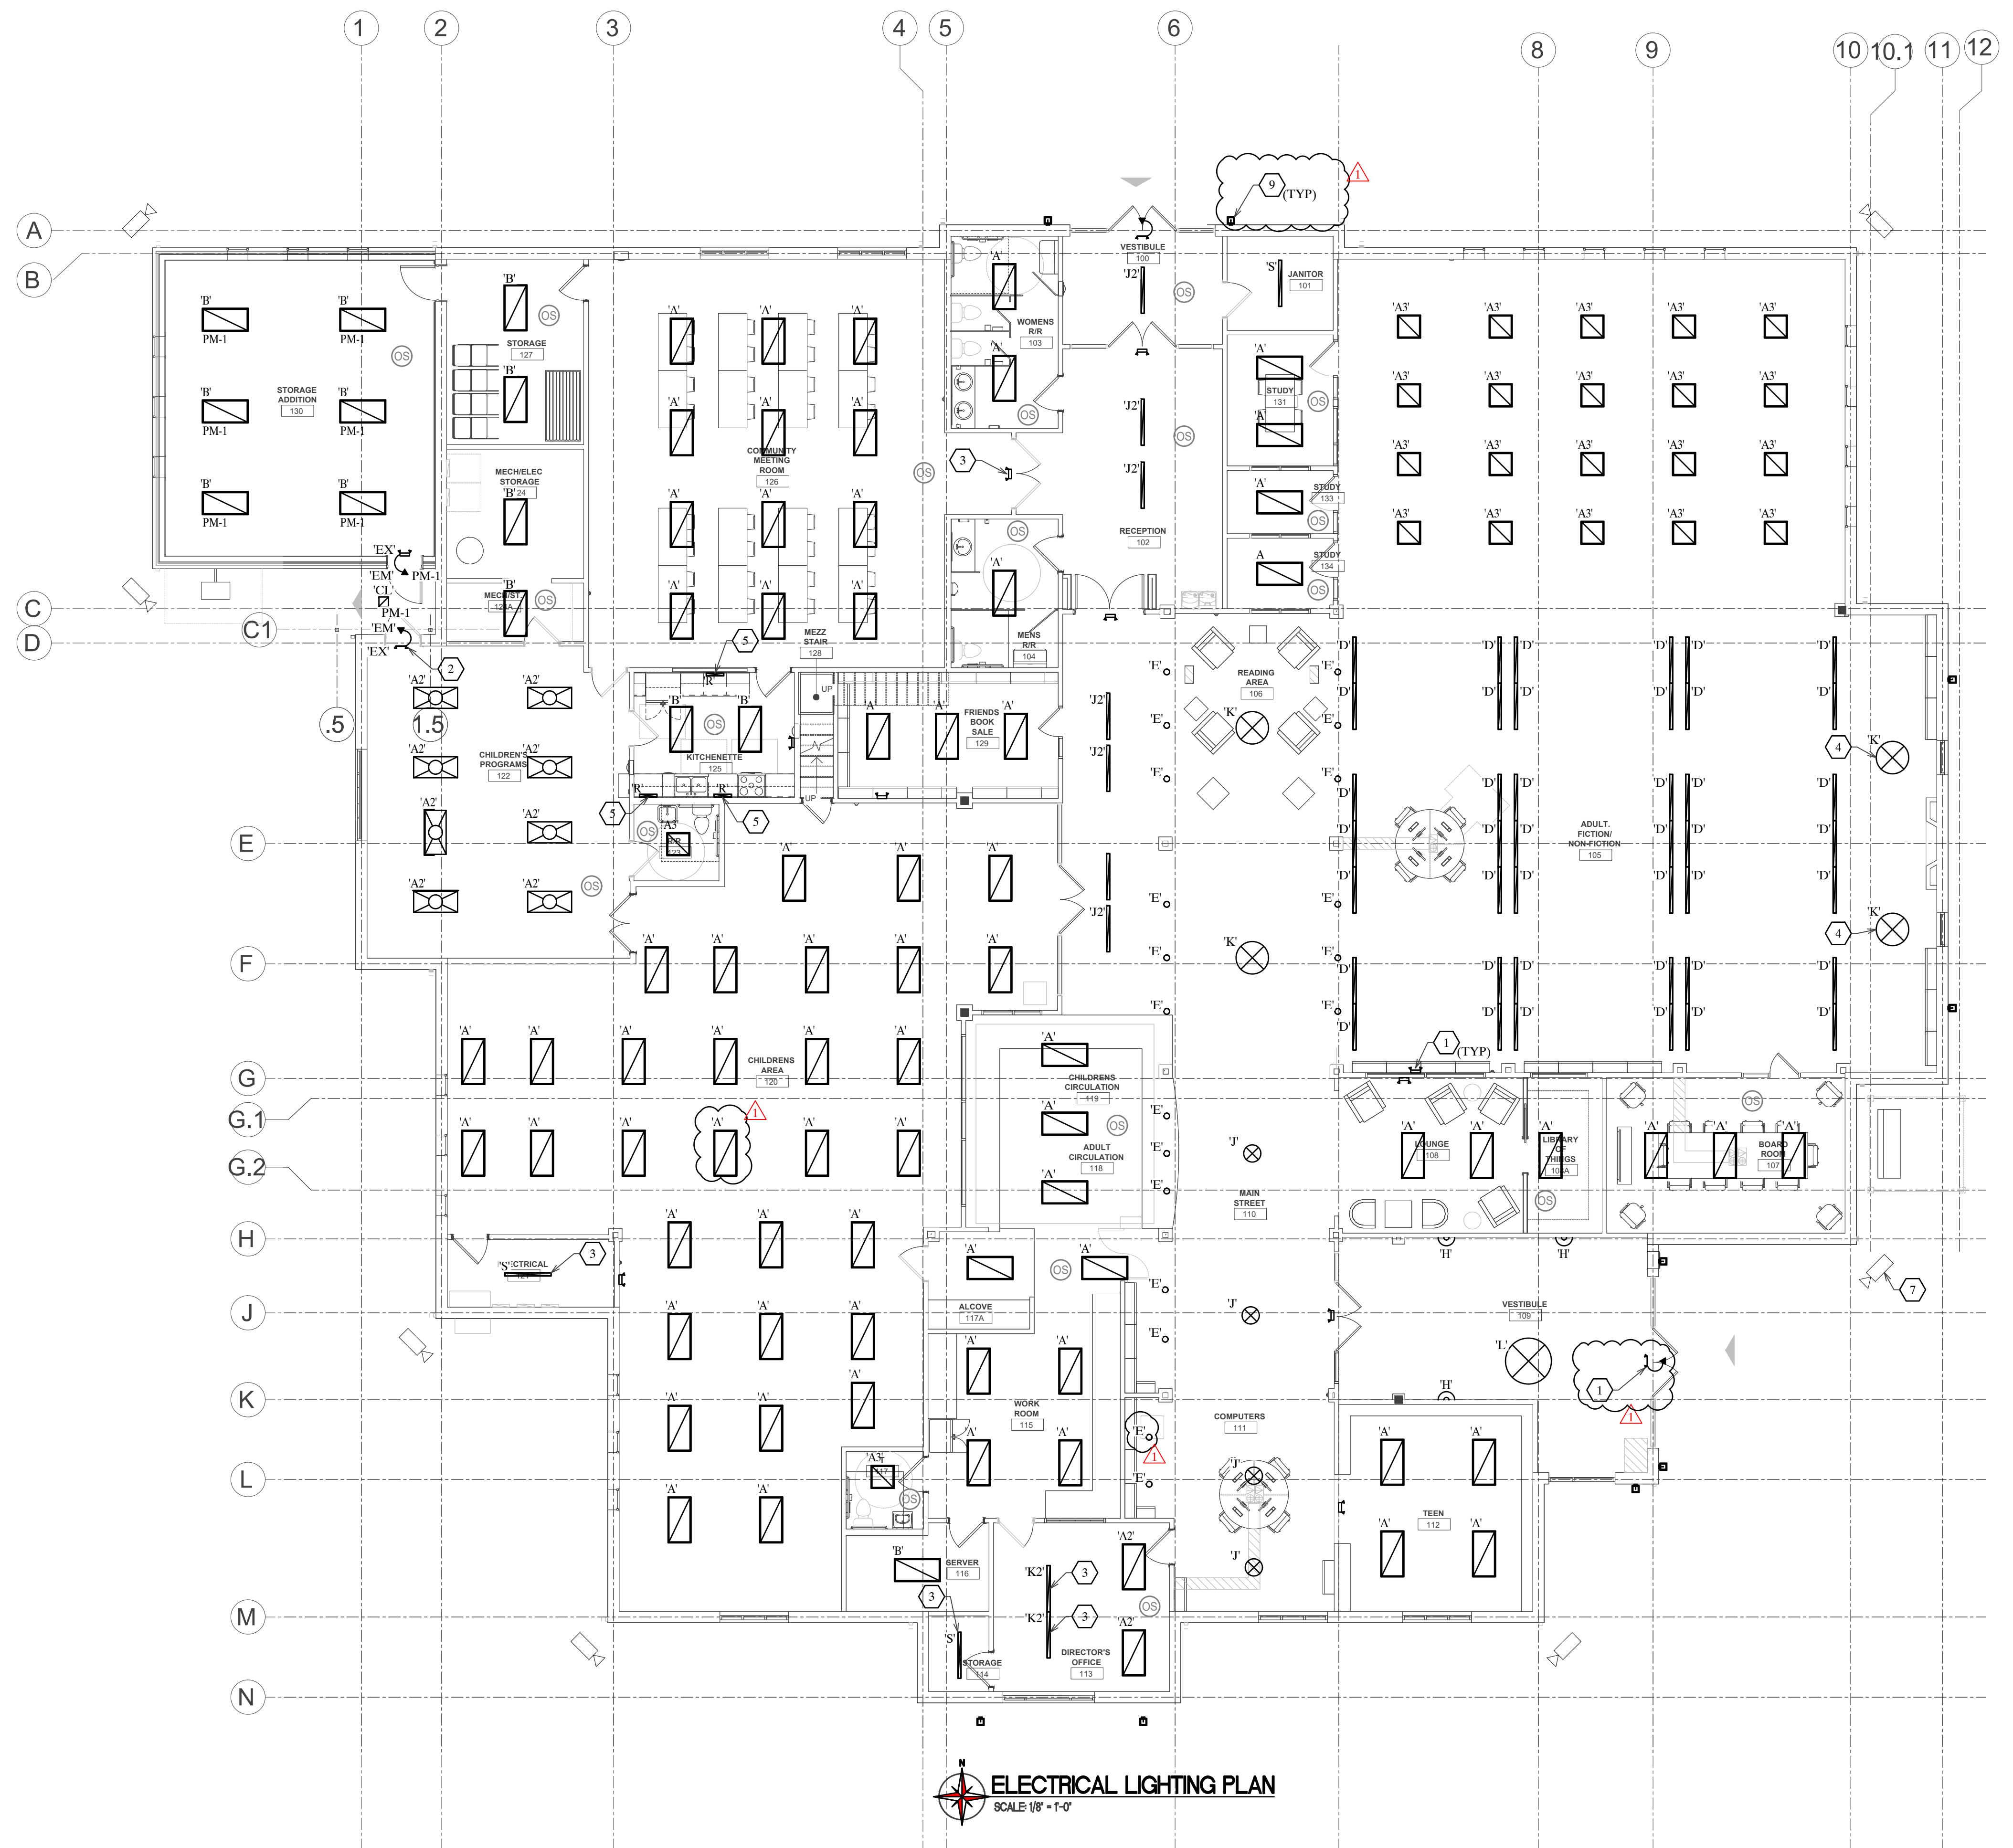


GENERAL NOTES:

- A. ALL WORK SHALL BE IN ACCORDANCE WITH THE BEST QUALITY STANDARDS OF THE TRADE, AND SHALL CONFORM WITH ALL FEDERAL, STATE, AND LOCAL CODES AND STANDARDS.
- B. THE CONTRACTOR SHALL INCLUDE IN BID PROPOSAL ALL COSTS REQUIRED TO COMPLETELY AND PROPERLY INSTALL ALL WORK REQUIRED FOR THE PROJECT, AND SHALL EXAMINE THE SCOPE OF WORK OF OTHER TRADES PRIOR TO SUBMITTING A BID PROPOSAL.
- C. CONSTRUCTION DOCUMENTS SHALL BE FOLLOWED AS CLOSELY AS POSSIBLE; HOWEVER, SYSTEMS HAVE BEEN SHOWN DIAGRAMMATICALLY AND IN SOME CASES, ENLARGED FOR CLARITY. ANY OFFSETS, ADDITIONAL FITTINGS, AND/OR APPURTENANCES REQUIRED TO PROVIDE A COMPLETE AND COORDINATED SYSTEM SHALL BE BORNE BY THE CONTRACTOR.
- D. ALL CIRCUITS OVER 100' IN LENGTH SHALL BE A MINIMUM #10 AWG CONDUCTOR.
- E. WIRING SYSTEM SHALL BE CONDUIT AND WIRE. MINIMUM WIRE SIZE SHALL BE #12 AWG. USE SOLID CONDUCTOR FOR #10 AWG AND SMALLER, USE STRANDED IN LARGER SIZES.
- F. ALL COVER PLATES FOR ELECTRICAL DEVICES SHALL BE OF A COLOR TO MATCH THE AREA COLOR SCHEME AS DIRECTED BY THE OWNER.
- G. THE ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ALL NECESSARY CONDUIT, WIRING, PANELS, LIGHTING, ELECTRICAL DEVICES, SWITCHES AND OTHER COMPONENTS IN COMPLETE COMPLIANCE WITH ALL CURRENT FEDERAL, STATE AND LOCAL CODES AND ORDINANCES.
- H. INSTALL GROUND WIRE IN ALL FEEDERS AND BRANCH CIRCUITS.
- I. MINIMUM CONDUIT SIZE SHALL BE 3/4".
- J. ALL DEDICATED RECEPTACLES SHALL BE 20 AMP RATED.
- K. ALL ELECTRIC COVER PLATE COLOR SELECTED BY ARCHITECT.

KEYED PLAN NOTES:

1. EXISTING EXIT/EMERGENCY LIGHT SHALL REMAIN. PROVIDE NEW EMERGENCY LIGHT WHERE REQUIRED AND TIE TO EXISTING EXIT LIGHT CIRCUIT.
2. BROKEN LINE: EXISTING EMERGENCY LIGHT CONNECT TO NEAREST EXISTING LIGHTING CIRCUIT AS REQUIRED.
3. RELOCATE EMERGENCY LIGHTING FOR LOWER CEILING. VERIFY HEIGHT IN FIELD.
4. PROVIDE NEW LIGHT AND CONNECT TO NEAREST EXISTING LIGHTING CIRCUIT AS REQUIRED.
5. PROVIDE NEW UNDERCOUNTER LIGHT CONTROLLED BY OCCUPANCY SENSOR w/ SWITCH. ALL UNDERCOUNTER LIGHT SHALL BE TIED TOGETHER TO OPERATE SIMULTANEOUSLY.
6. VERIFY EXIT/EMERGENCY LIGHT w/ BATTERY BACKUP IN FIELD.
7. CONTRACTOR SHALL PROVIDE 3/4" CONDUIT ROUGH-INS FOR SECURITY CAMERAS. VERIFY HEIGHT AND EXACT LOCATION WITH OWNER.
8. PROVIDE OVERRIDE SWITCH FOR OCCUPANCY SENSOR.
9. REPLACE EXTERIOR LIGHTING, SEE E301 FOR THE COMPLETE EXTERIOR LIGHTING FIXTURE SCHEDULE.

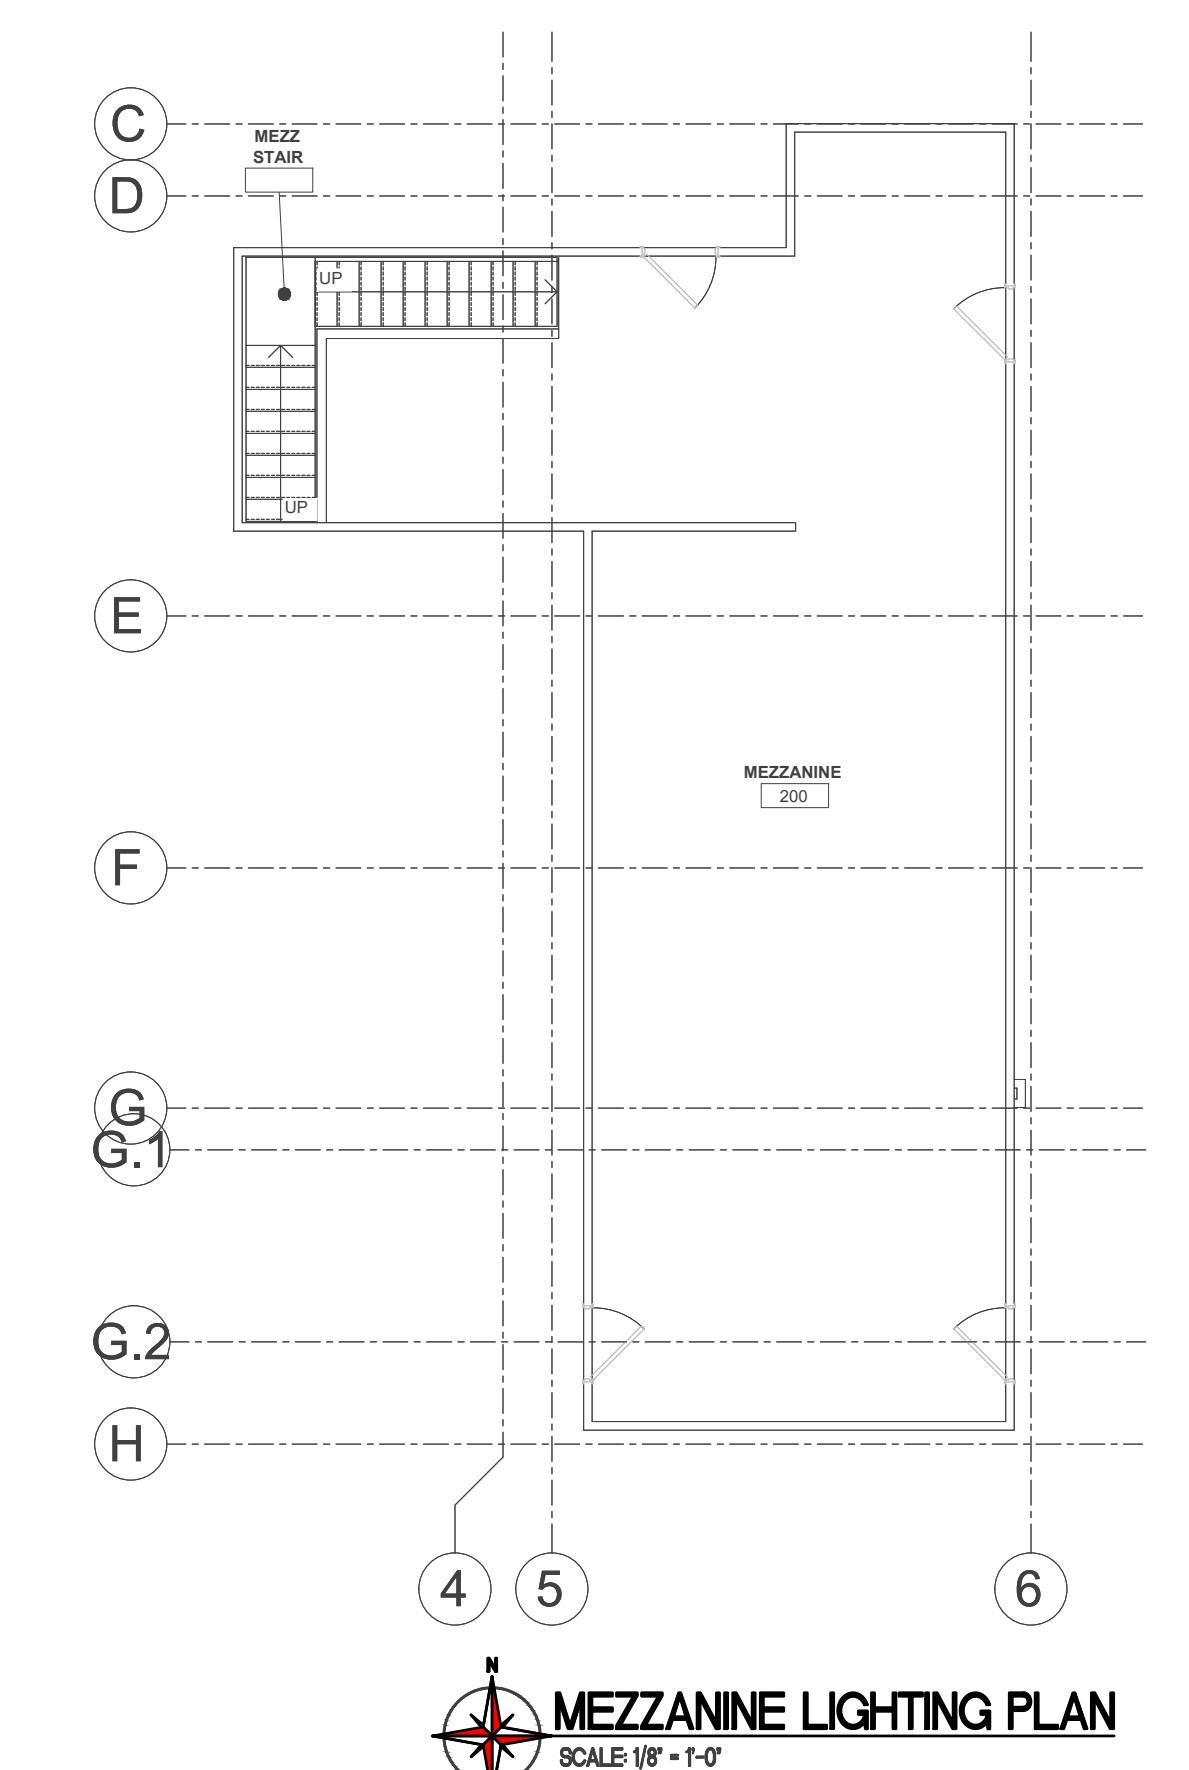

BUILDING ADDITION & RENOVATION TO SHERIDAN PUBLIC LIBRARY

103 W. 1ST ST., SHERIDAN, INDIANA 46069

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF DESIGN-AIRE ENGINEERING, INC. AND ARE NOT TO BE USED OR REPRODUCED IN WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF DESIGN-AIRE ENGINEERING, INC.

©Copyright 2008, Design-Aire Engineering, Inc.

Project number 25138

Date 01.15.26





Drawn by DAE

Checked by WJS

Designed by DAE

E101

ELECTRICAL
LIGHTING PLANS

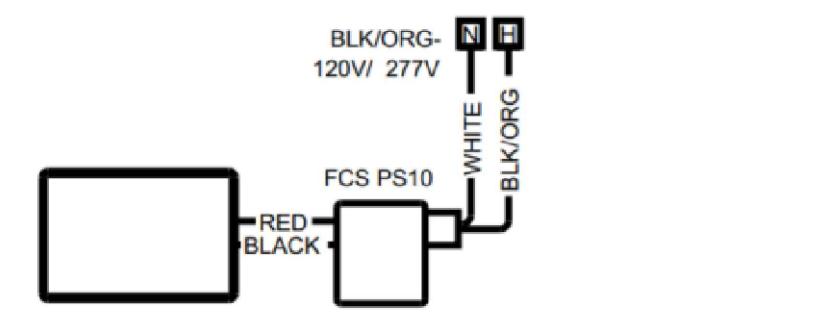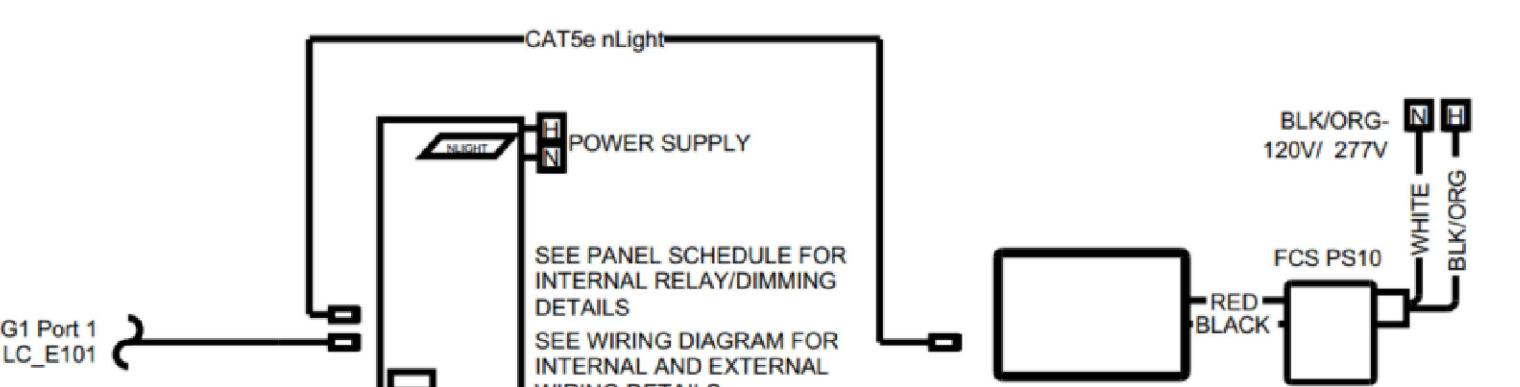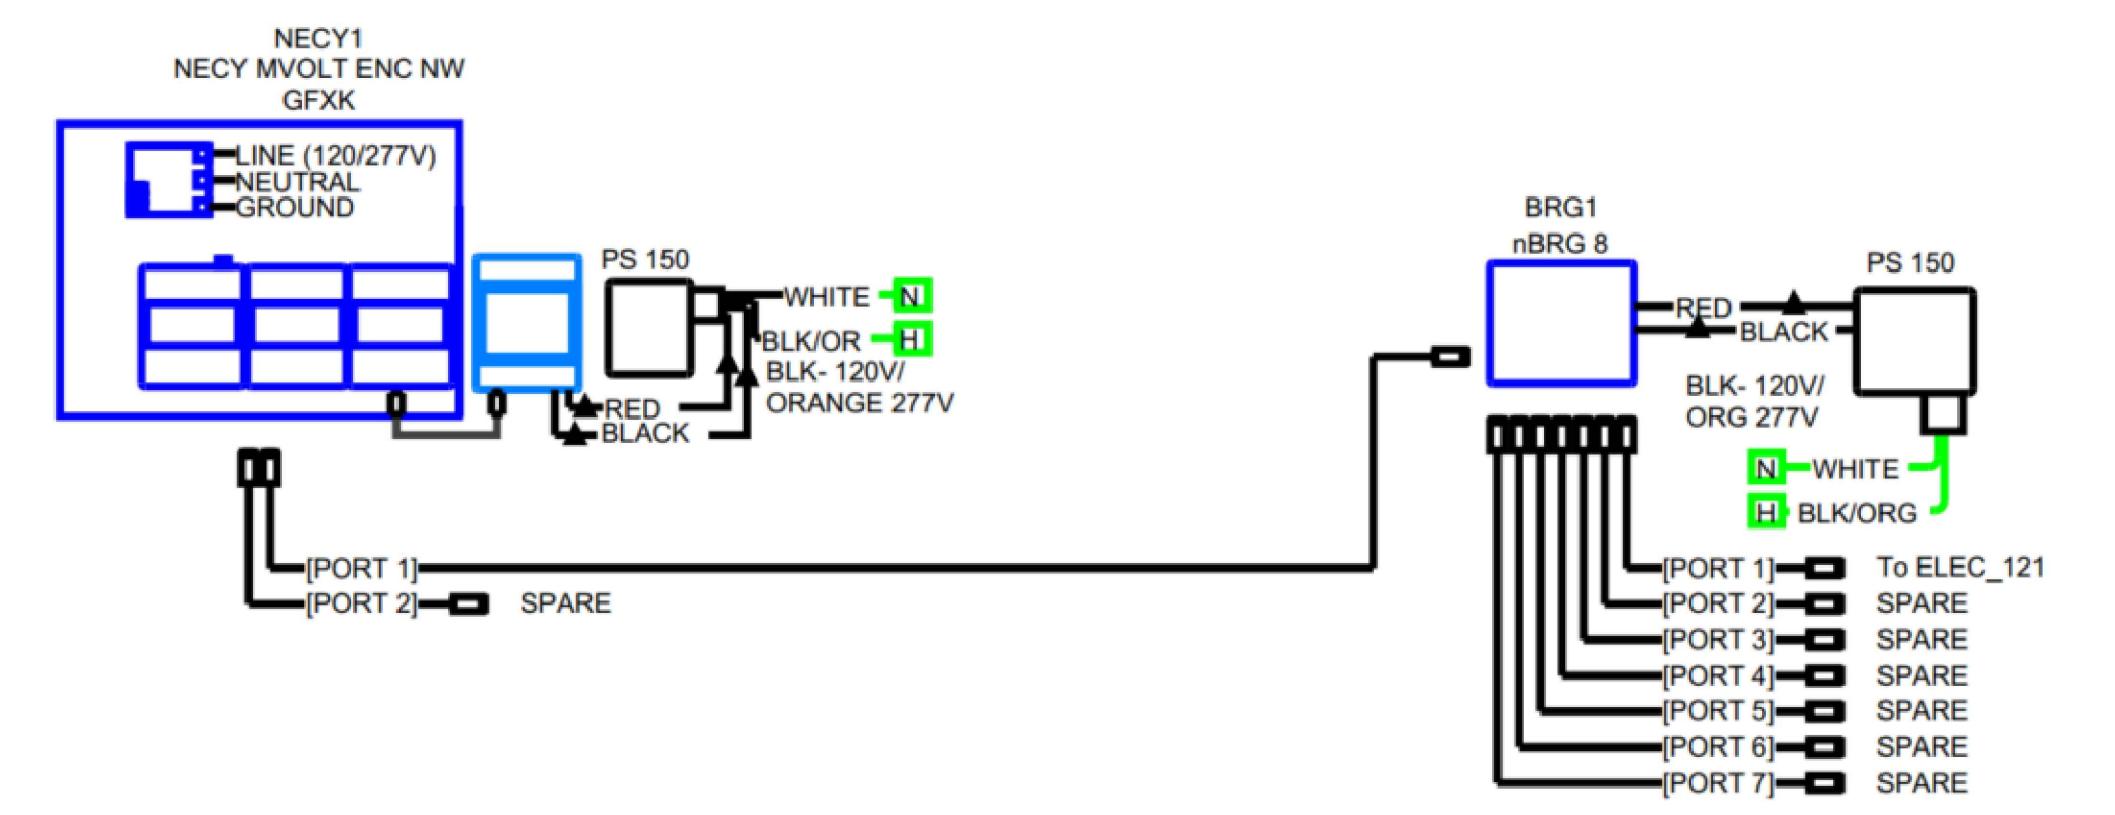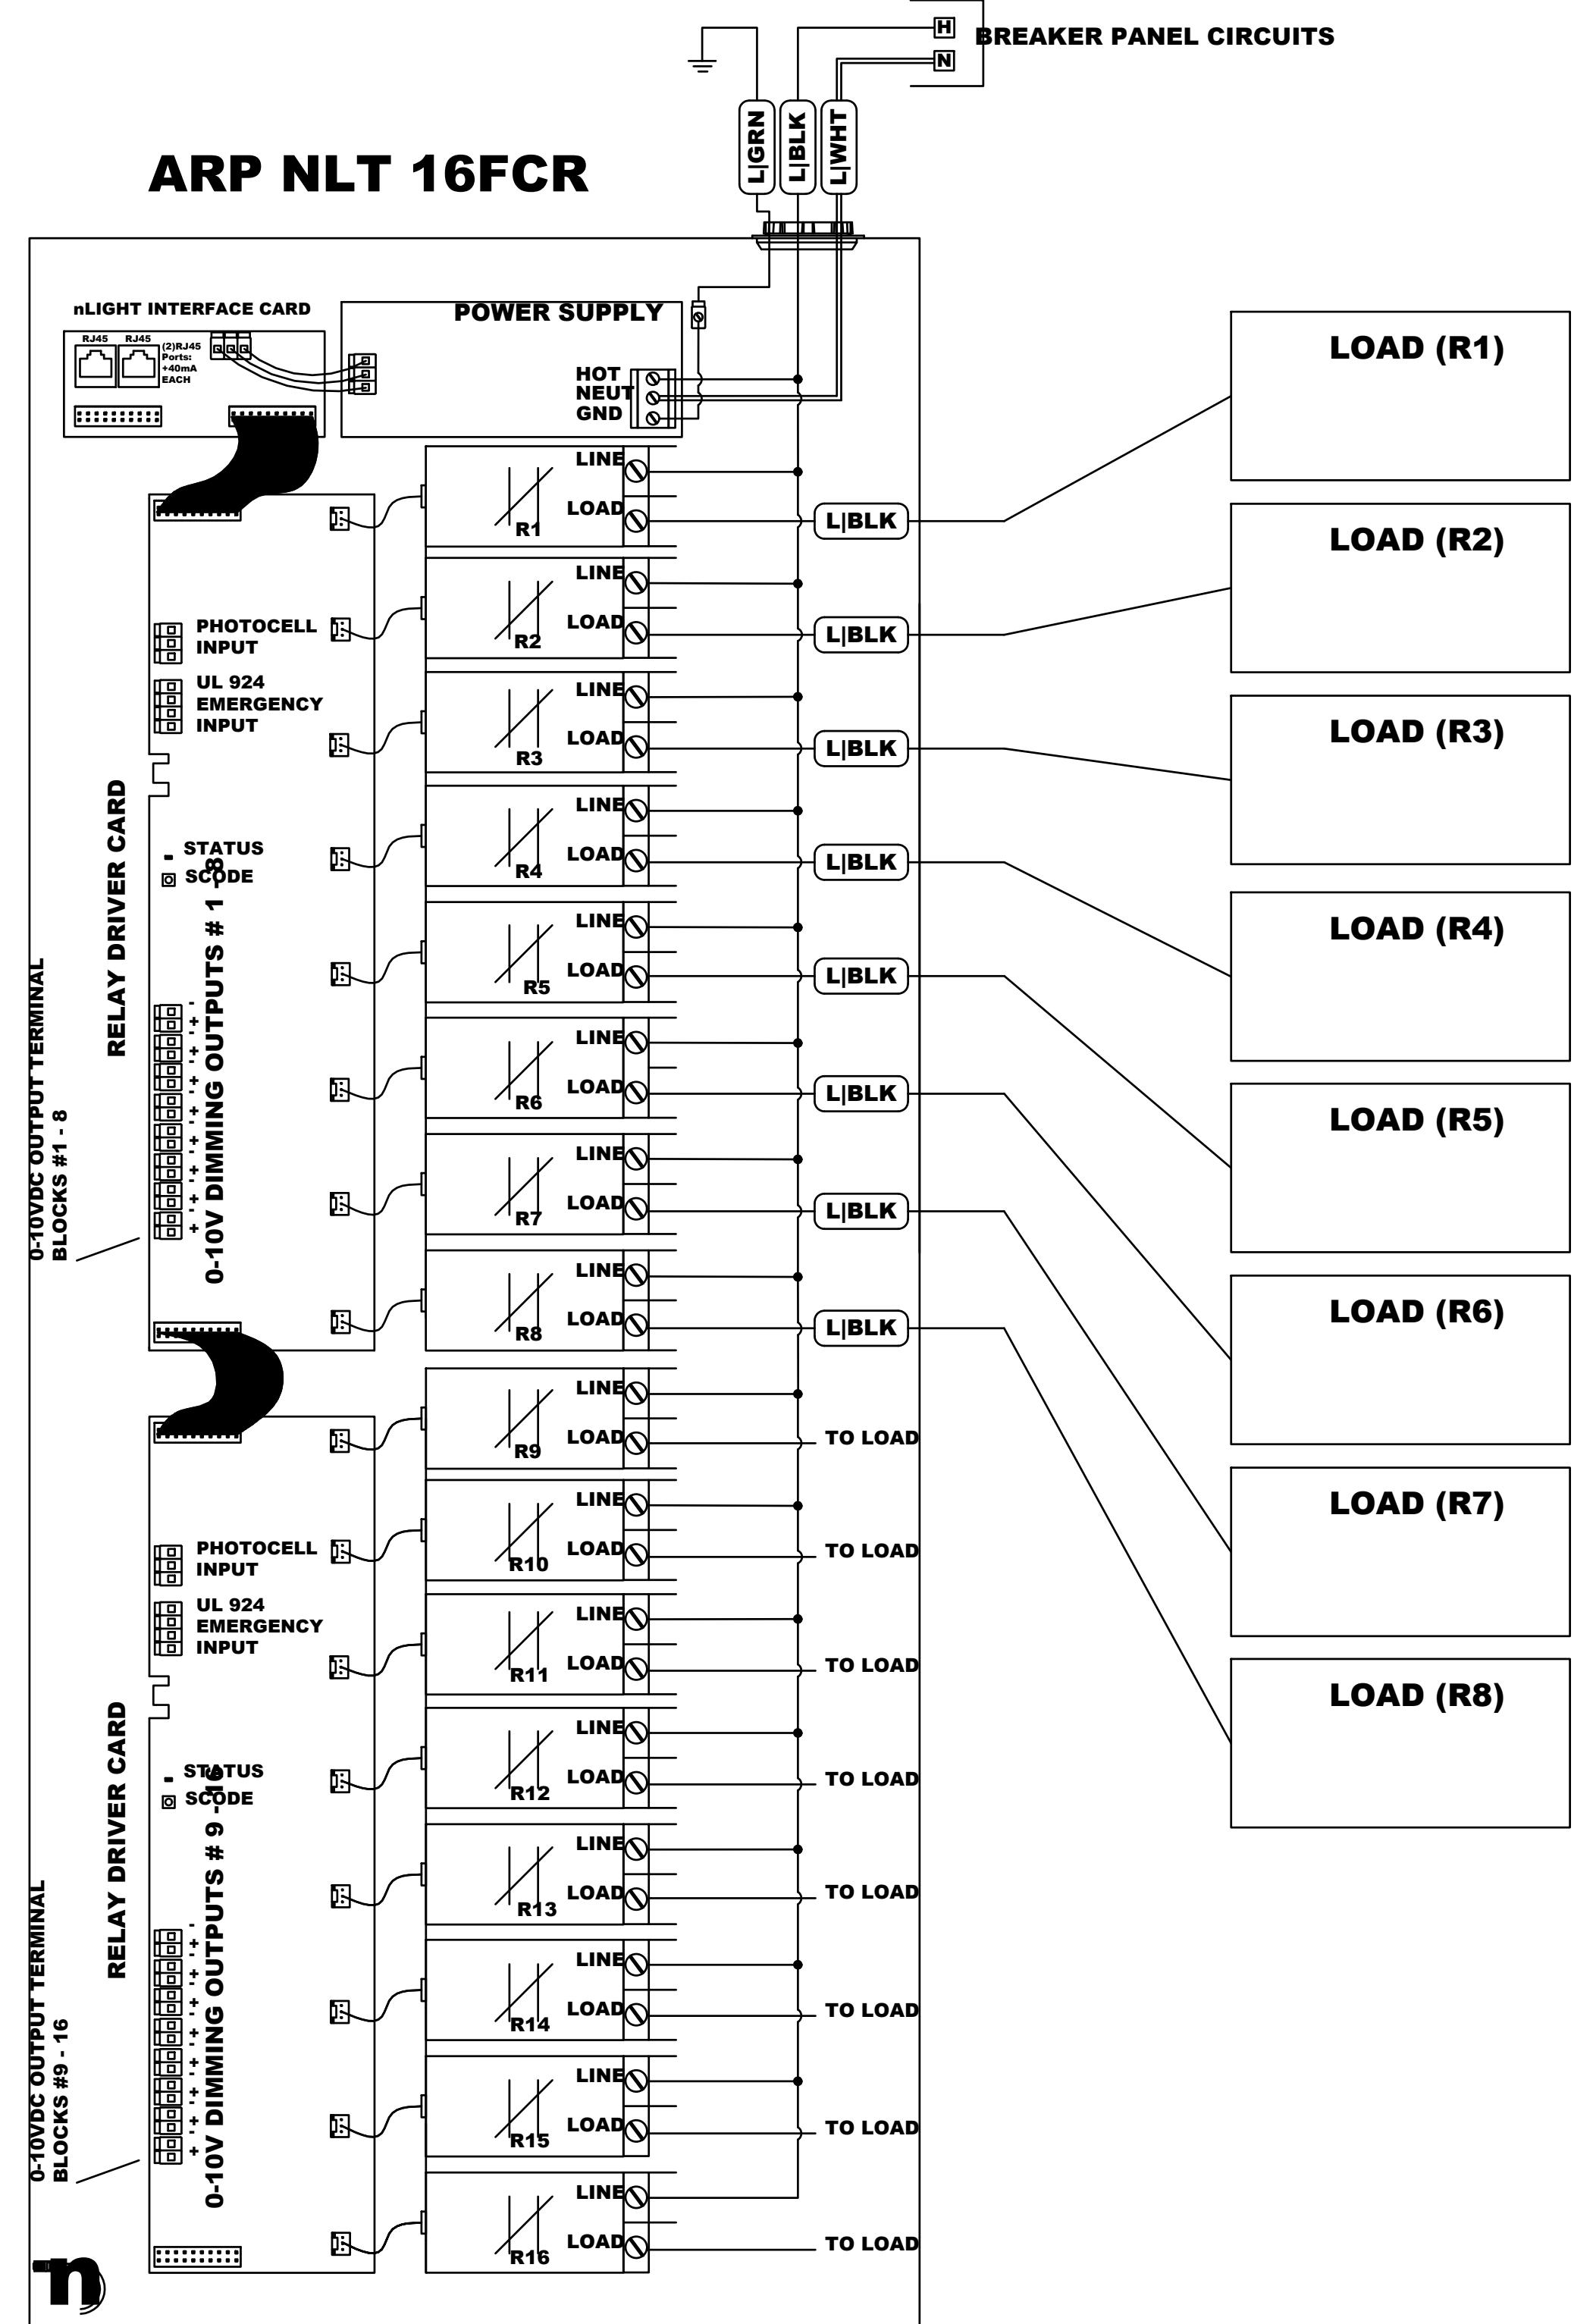

16 RELAY PANEL SHOWN. FOR 12 RELAY PANEL, R13 - R16 WILL BE PROVIDED AS SPACES. WIRE LEGEND

ABB NLT 12FCB/16FCB

L|CLR **LINE VOLTAGE
(VARIOUS COLORS)**

ARP NLT 12FCR/16FCR

N.T.S.

BUILDING ADDITION & RENOVATION TO SHERIDAN PUBLIC LIBRARY

03 W 1ST ST SHERIDAN INDIANA 46069

D E S I G N - A I R E E N G I N E E R I N G , I N C .
2707 RAND ROAD
voice (317) 464-9090
www.daengineering.com
Indianapolis, Indiana 46241
fax (317) 464-9393
Email: dae@daengineering.com
Mechanical, Electrical, and Energy Engineering

ject number	25138
e	01.15.26
wn by	DAE
checked by	WJS

ELECTRICAL LIGHTING CONTROL RISER DIAGRAM

**BUILDING ADDITION & RENOVATION TO
SHERIDAN PUBLIC LIBRARY**

103 W. 1ST ST., SHERIDAN, INDIANA 46069

Project number

25138

Date

01.15.26

Drawn by

DAE

Checked by

WJS

Designed by

DAE

E201



ELECTRICAL
POWER PLANS

GENERAL NOTES:

- A. ALL WORK SHALL BE IN ACCORDANCE WITH THE BEST QUALITY STANDARDS OF THE TRADE, AND SHALL CONFORM WITH ALL FEDERAL, STATE, AND LOCAL CODES AND STANDARDS.
- B. THE CONTRACTOR SHALL INCLUDE IN BID PROPOSAL ALL COSTS REQUIRED TO COMPLETELY AND PROPERLY INSTALL ALL WORK REQUIRED FOR THE PROJECT, AND SHALL EXAMINE THE SCOPE OF WORK OF OTHER TRADES PRIOR TO SUBMITTING A BID PROPOSAL.
- C. CONSTRUCTION DOCUMENTS SHALL BE FOLLOWED AS CLOSELY AS POSSIBLE, HOWEVER, SYSTEMS HAVE BEEN SHOWN DIAGRAMMATICALLY AND IN SOME CASES, ENLARGED FOR CLARITY, ANY OFFSETS, ADDITIONAL FITTINGS, AND/OR APPURTENANCES REQUIRED TO PROVIDE A COMPLETE AND COORDINATED SYSTEM SHALL BE BORNE BY THE CONTRACTOR.
- D. ALL CIRCUITS OVER 100' IN LENGTH SHALL BE A MINIMUM #10 AWG CONDUCTOR.
- E. WIRING SYSTEM SHALL BE CONDUIT AND WIRE, MINIMUM WIRE SIZE SHALL BE #12 AWG.
- F. ALL COVER PLATES FOR ELECTRICAL DEVICES SHALL BE OF A COLOR TO MATCH THE AREA COLOR SCHEME AS DIRECTED BY THE OWNER.
- G. THE ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ALL NECESSARY CONDUIT, WIRING, PANELS, LIGHTING, ELECTRICAL DEVICES, SWITCHES AND OTHER COMPONENTS IN COMPLETE COMPLIANCE WITH ALL CURRENT FEDERAL, STATE AND LOCAL CODES AND ORDINANCES.
- H. INSTALL GROUND WIRE IN ALL FEEDERS AND BRANCH CIRCUITS.
- I. MIN. CONDUIT SIZE SHALL BE 3/4".
- J. ALL DEDICATED RECEPTACLES SHALL BE 20 AMP RATED.
- K. ALL ELECTRIC COVER PLATE COLOR SELECTED BY ARCHITECT.

KEYED PLAN NOTES:

1. VERIFY EXISTING RECEPTACLE IN FIELD, PROVIDE GFI RECEPTACLE AS REQUIRED.
2. INSTALL DEDICATED RECEPTACLE TO EXISTING BRANCH CIRCUIT FOR MICROWAVE.
3. RECONNECT KITCHEN RANGE & HOOD TO EXISTING RECEPTACLE.
4. 20A, 120V-10 CONNECTION FOR HANDICAP DOOR OPENER.
5. RECONNECT EXISTING CONNECTION TO NEW HVAC EQUIPMENT.
6. 20A, 120V-10 CONNECTION FOR SMOKE DETECTOR.
7. EXTEND EXISTING CONDUCTOR AND TELE/DATA TO NEW FLOOR RECEPTACLE, PROVIDE 1" CONDUIT.
8. DEDICATED RECEPTACLE FOR COMPUTER STATION.
9. 20A, 208V-10 CONNECTION FOR MINI-SPLIT OUTDOOR UNIT HP-1.
10. MINI-SPLIT INDOOR UNIT AC-1 POWERED BY OUTDOOR UNIT.
11. 45A, 208V-10 CONNECTION FOR MINI-SPLIT OUTDOOR UNIT HP-2.
12. MINI-SPLIT INDOOR UNIT AC-2 POWERED BY OUTDOOR UNIT.
13. EXTEND EXISTING CONDUCTOR AND TELE/DATA, PROVIDE 3/4" CONDUIT FOR COMPUTER STATION.
14. 20A, 120V-10 CONNECTION FOR NEW EXHAUST FAN.
15. 20A, 120V-10 CONNECTION FOR DOOR HOLDERS, DOOR HOLDERS SHALL BE INTERCONNECTED WITH FIRE ALARM AND SHALL RELEASE UPON ACTIVATION OF THE SMOKE DETECTOR.
16. 120V-10 CONNECTION FOR MOTORIZED DAMPER, POWERED FROM NEAREST LIGHTING CIRCUIT.
17. 20A, 120V-10 CONNECTION FOR HUMIDIFIER.
18. 20A, 120V-10 CONNECTION FOR FURNACE MOTORIZED DAMPER.
19. RECONNECT EXISTING CONNECTION TO NEW HUMIDIFIER.
20. NOT USED.
21. 20A, 120V-10 CONNECTION FOR OPAC SYSTEM.
22. 20A, 120V-10 CONNECTION FOR COPPER.
23. 20A, 120V-10 CONNECTION FOR AC RACK, COORDINATE WITH OWNER TO VERIFY EXACT LOCATION.
24. 20A, 120V-10 CONNECTION FOR NEW COMPUTER STATION, COORDINATE WITH OWNER TO VERIFY EXACT LOCATION.
25. EXTEND EXISTING CONDUCTOR AND TELE/DATA, PROVIDE 1" CONDUIT FOR COMPUTER STATION.
26. VERIFY EXISTING POWER AND DATA IN THE FIELD, PROVIDE NEW AND TIE TO NEAREST POWER CIRCUIT AS REQUIRED.

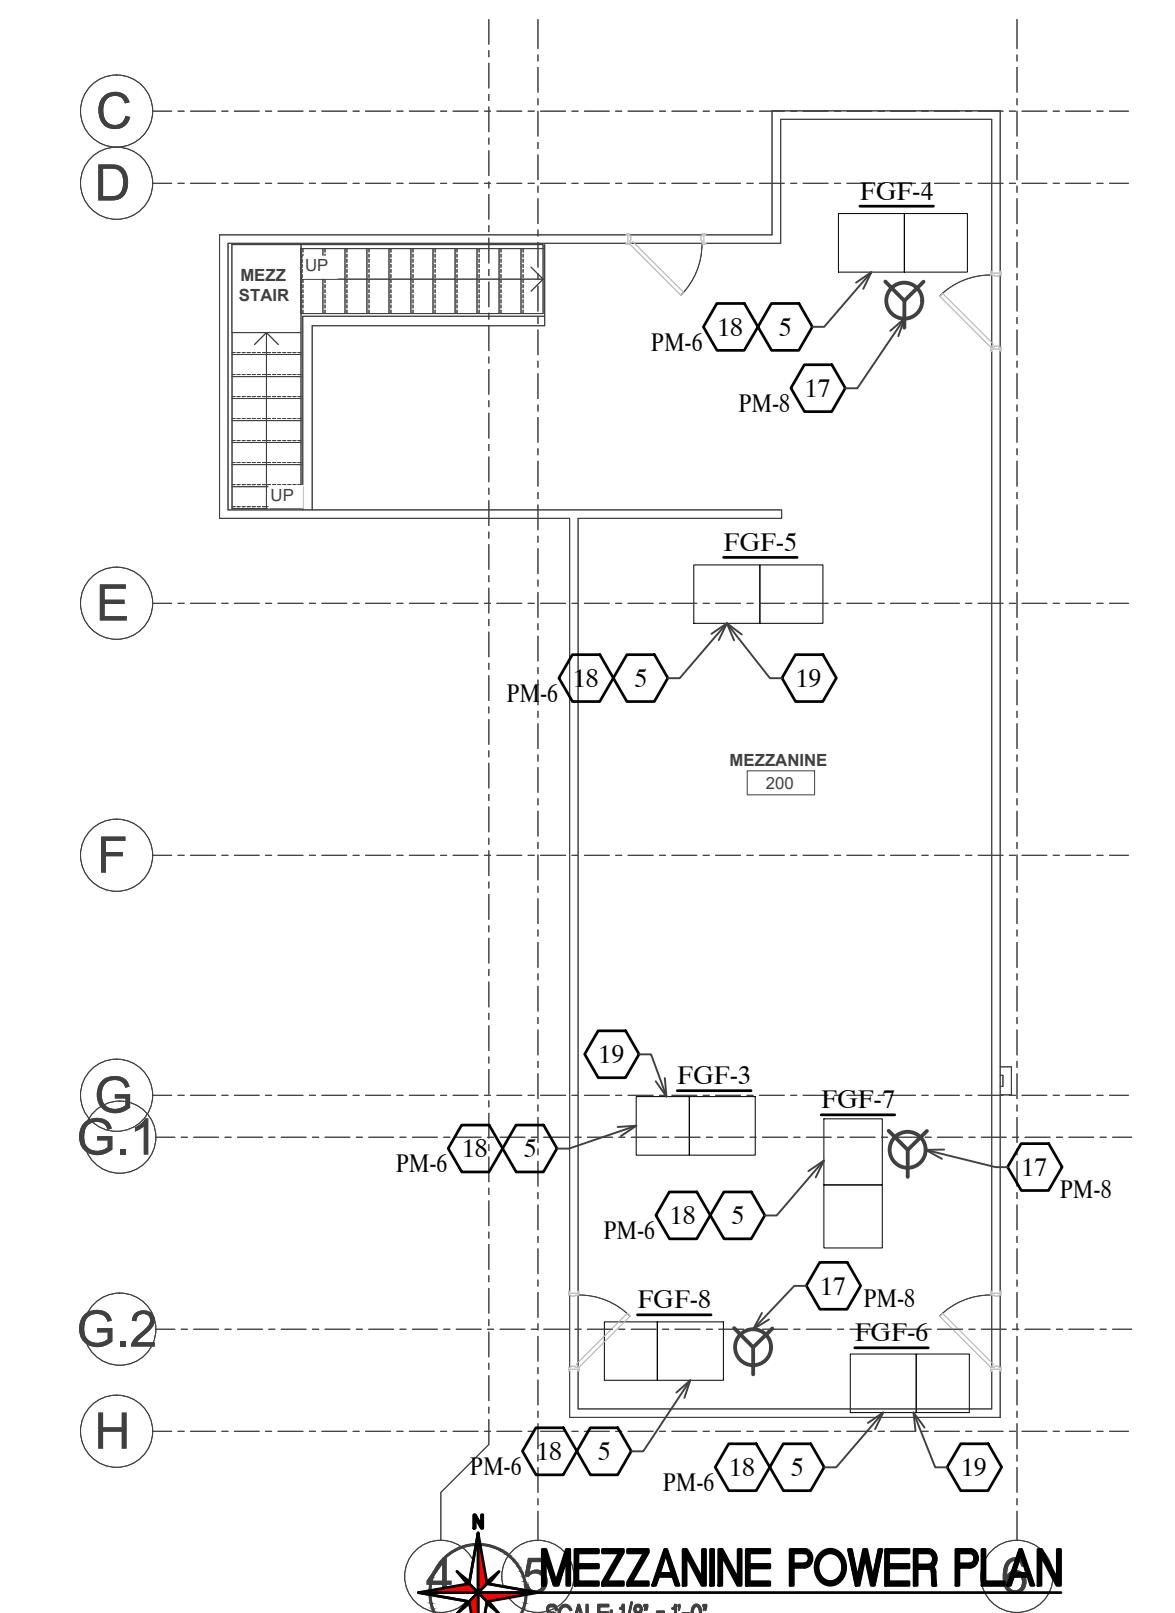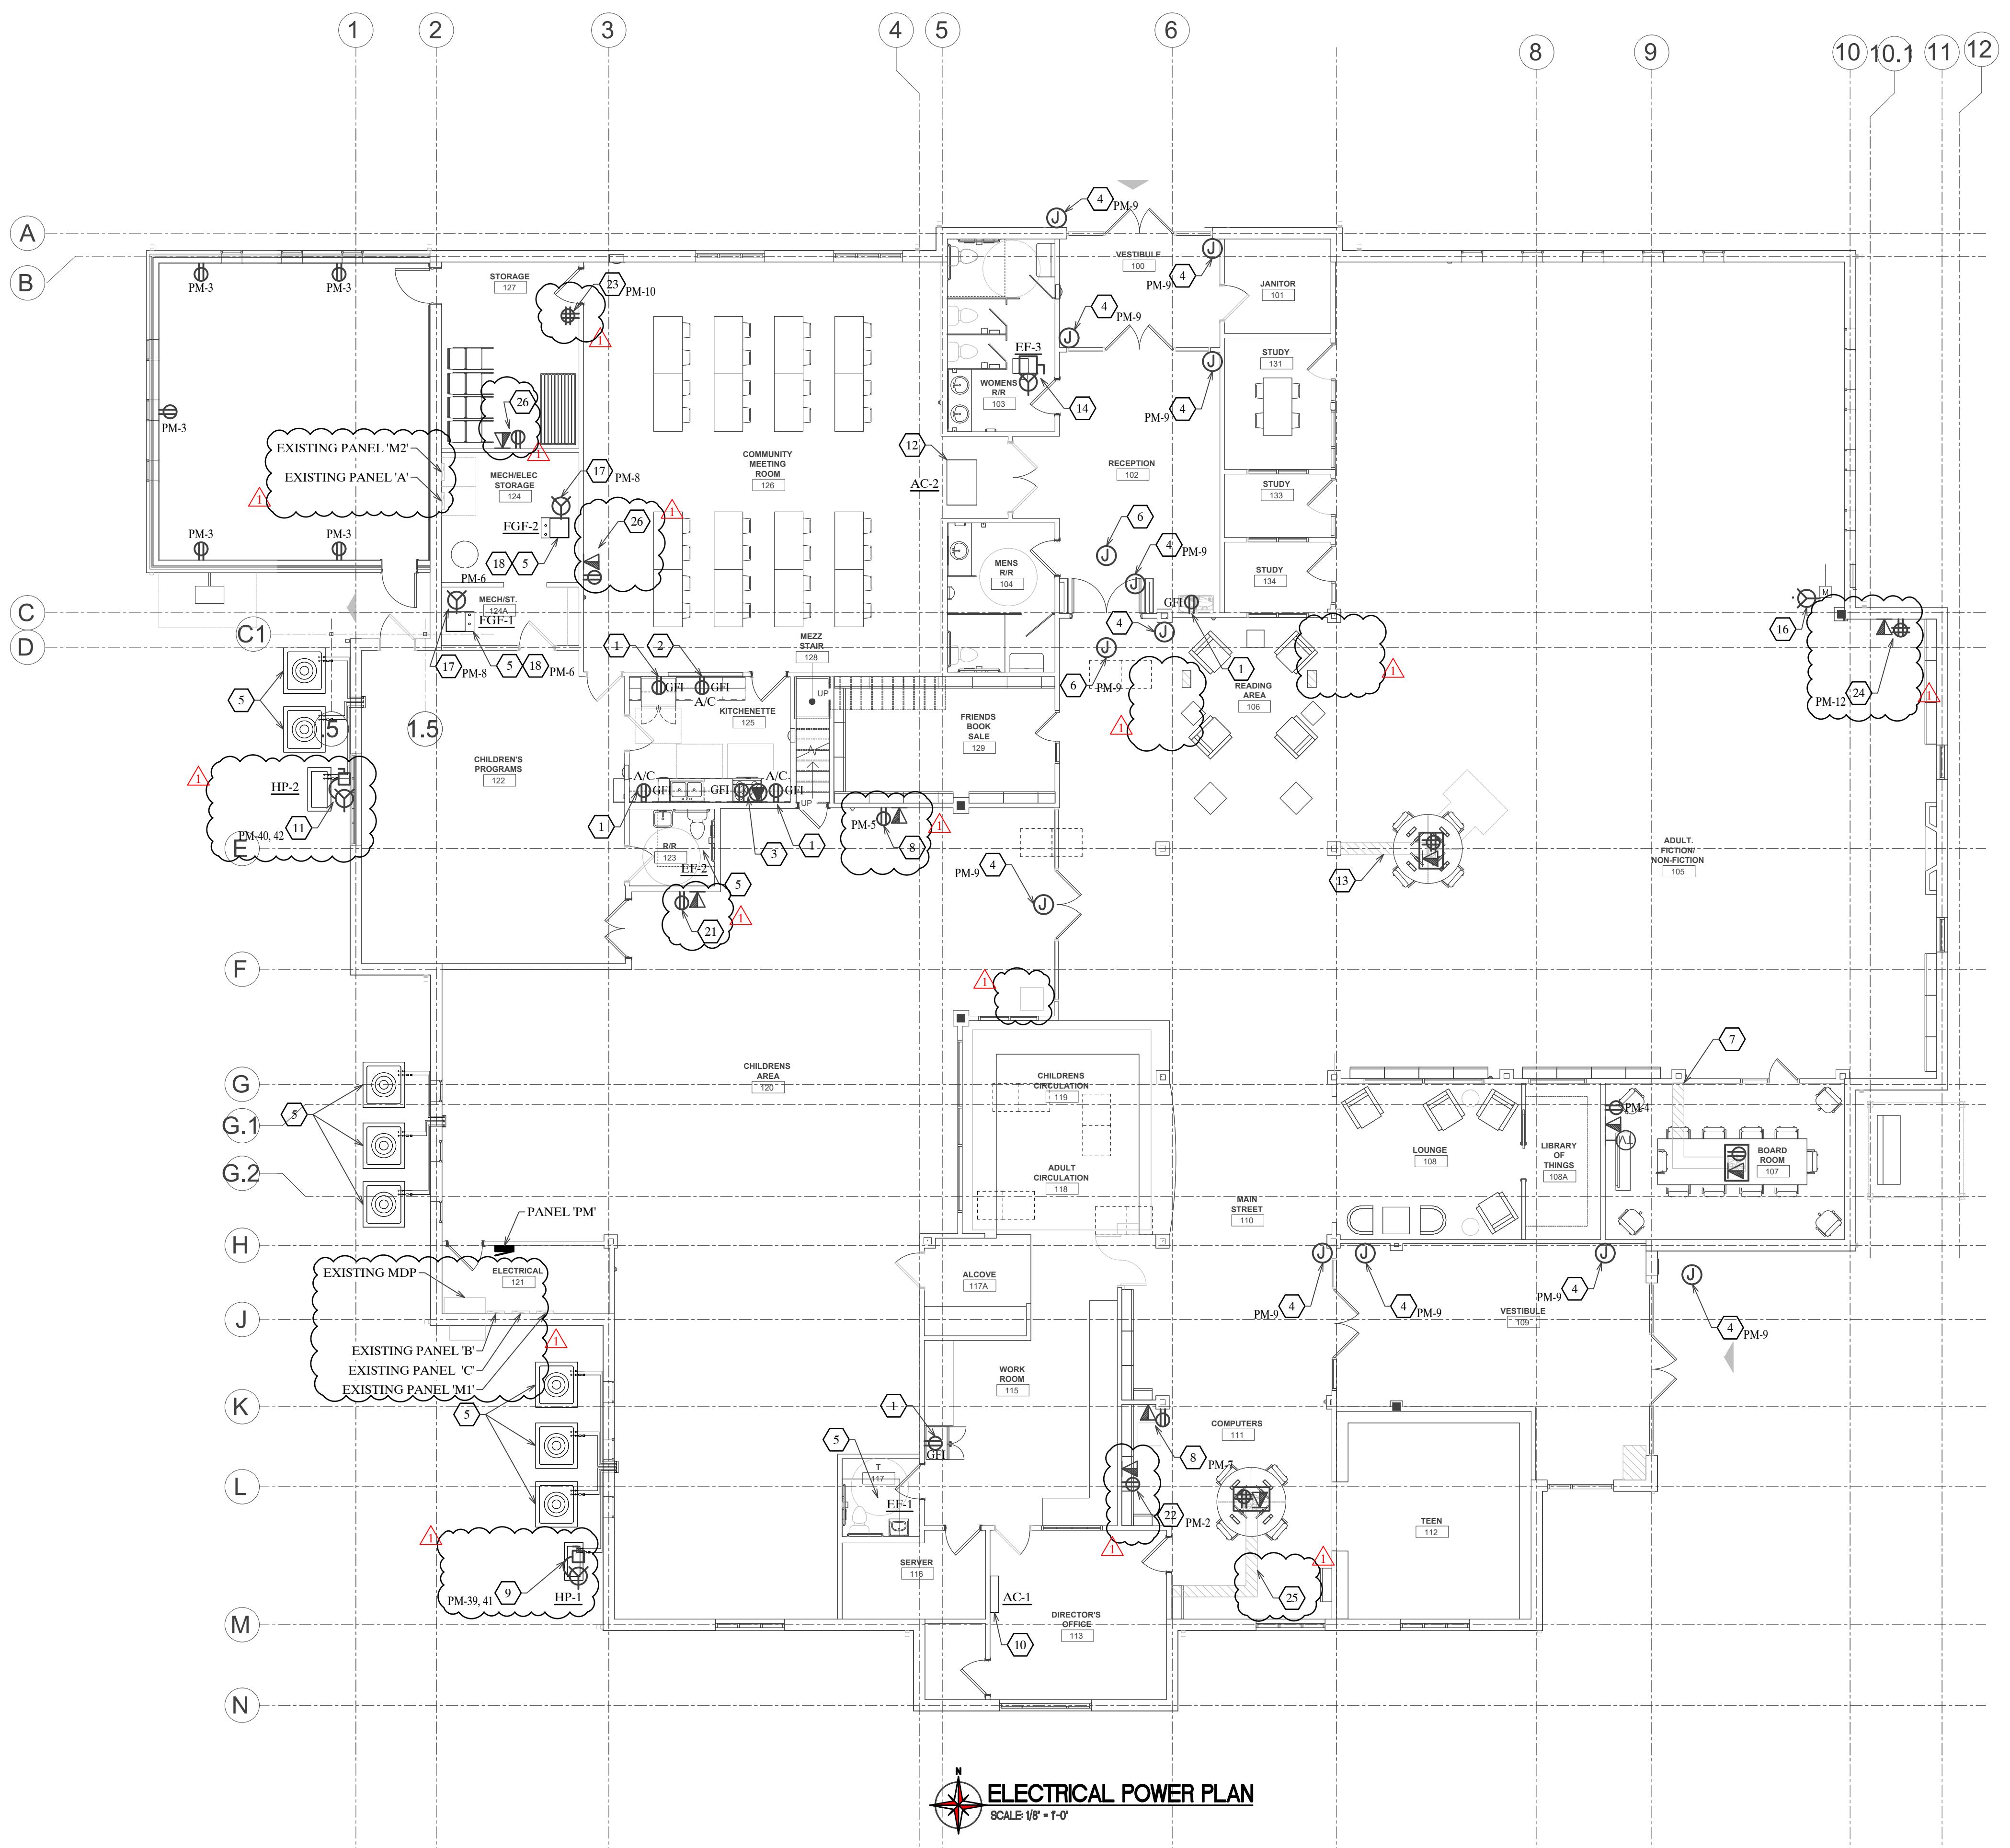

THIS DRAWING IS THE IDEAS, DESIGNS AND CONCEPTS OF DESIGN-AIRE ENGINEERING, INC. THE EXCLUSIVE INTELLECTUAL PROPERTY OF DESIGN-AIRE ENGINEERING, INC. AND ARE NOT TO BE USED OR REPRODUCED IN WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF DESIGN-AIRE ENGINEERING, INC.

©Copyright 2006, Design-Aire Engineering, Inc.

103 W. 1ST ST., SHERIDAN, INDIANA 46069

103 W. 1ST ST., SHERIDAN, INDIANA 46069

Project number

25138

Date

01.15.26

Drawn by

DAE

Checked by

WJS

Designed by

DAE

E201

ELECTRICAL
POWER PLANS

BUILDING ADDITION & RENOVATION TO SHERIDAN PUBLIC LIBRARY

卷之三

www.daengineering.com
www.daengineering.com
Mechanical, Electrical, and Energy Engineering
Email: dae@daengineering.com
Phone: 0411-704-3000

100%
CONSTRUCT
DOCUMENT



CERTIFIED

R

Luminaire Schedule								
Symbol	Qty	Label	Arrangement	Description	LLF	Luminaire Lumens	Luminaire Watts	Total Watts
	3	WP2	Single	WPX1 LED P2 40K Mvolt	0.920	2913	24.42	73.26
	1	TL5	3 @ 120 Degrees	RSX2 LED P4 40K R5	0.920	25663	189.54	568.62
	9	21w dome	Single	LMH020-3000-30G9-000_TW	0.250	1983	24.4	219.6
	2	SL5	Single	RSX2 LED P4 40K R5	0.920	25663	189.54	379.08


Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
CalcPts_1	Illuminance	Fc	0.61	8.7	0.0	N.A.	N.A.
PARKING	Illuminance	Fc	1.90	8.3	0.0	N.A.	N.A.

THIS DRAWING AND THE IDEAS, DESIGN
AND CONCEPTS CONTAINED HEREIN ARE
THE EXCLUSIVE INTELLECTUAL PROPERTY
OF DESIGN-AIRE ENGINEERING, INC., AND
ARE NOT TO BE USED OR REPRODUCED, WH-
OLE OR IN PART, WITHOUT THE WRITTEN
CONSENT OF DESIGN-AIRE ENGINEERING.
© COPYRIGHT 2024, DESIGN-AIRE ENGINEERING, INC.

Project number	2513
Date	01.15.13
Drawn by	DA
Checked by	WJ
Designed by	DA

SITE LIGHTING PLAN

 **ELECTRICAL SITE LIGHTING PHOTOMETRIC**
SCALE: 1" = 20'-0"

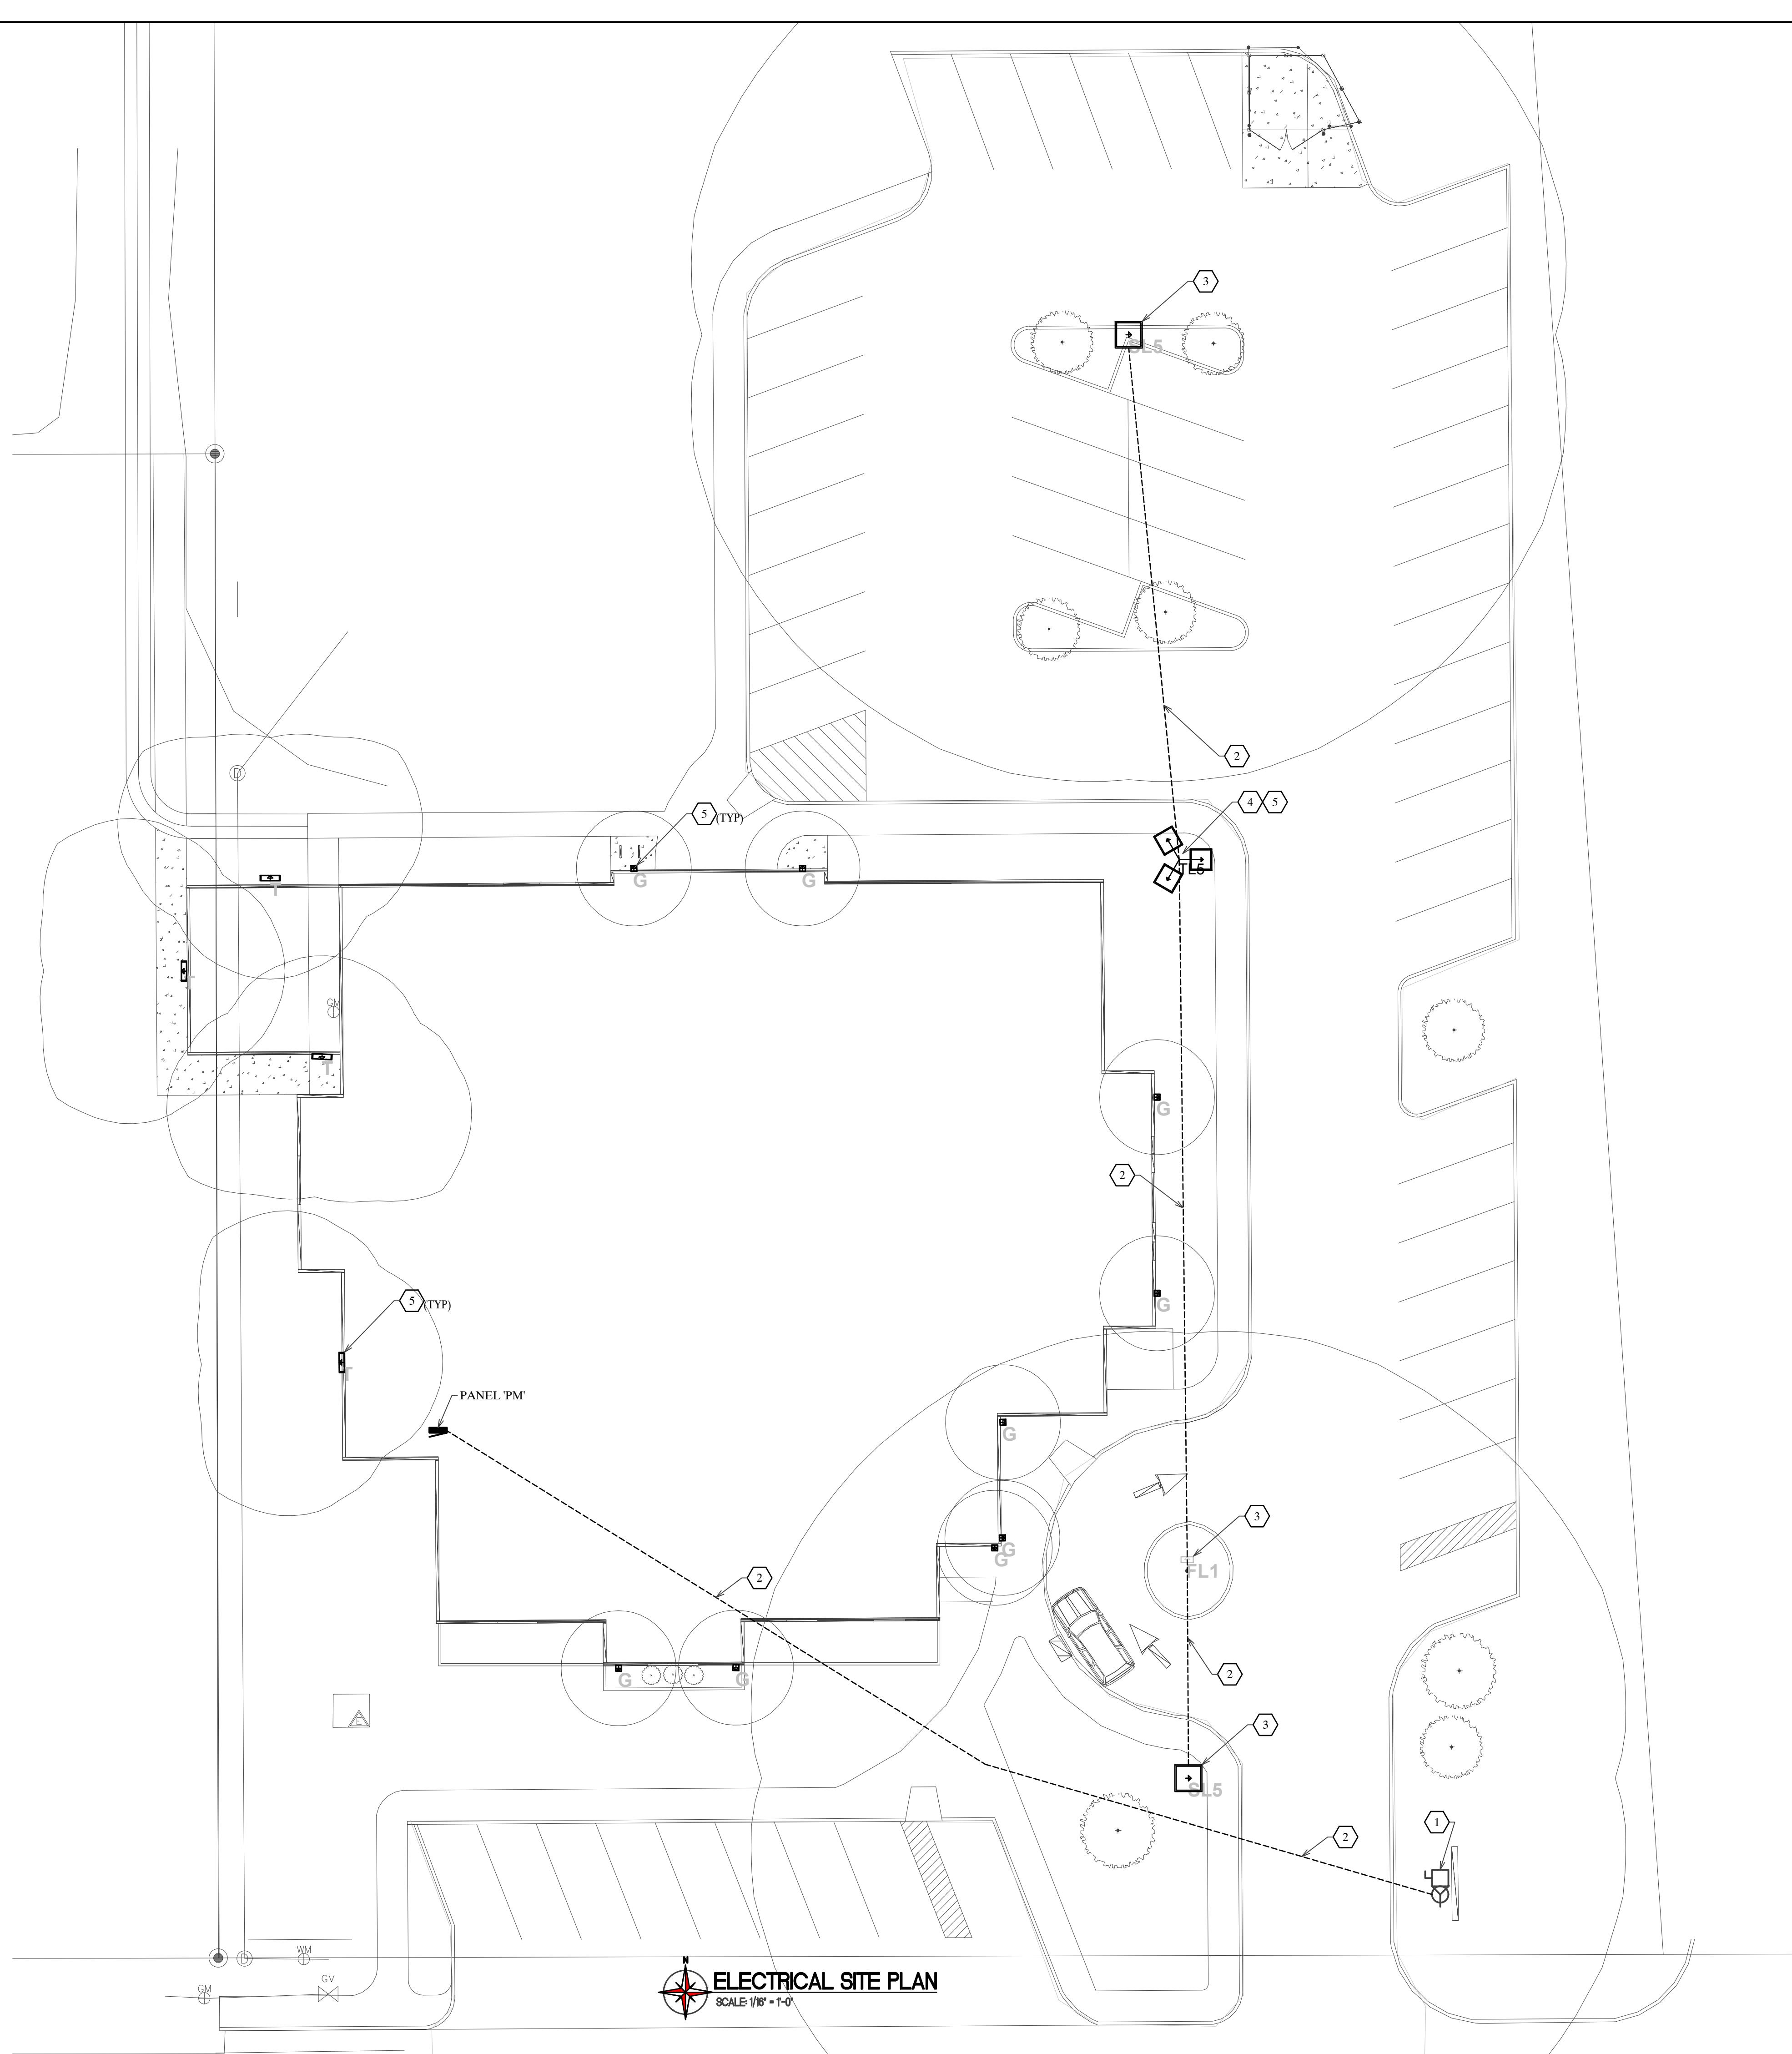

KEYED PLAN NOTES:

1. 20A, 120V-1Ø CONNECTION FOR MONUMENT SIGN, INSTALL 2-#10, 1-#10 GND IN A 1" CONDUIT TO PANEL 'PM'.
2. INSTALL 2-#10, 1-#10 GND IN A 1" CONDUIT.
3. SEE SITE PHOTOMETRIC PLAN FOR EXACT LOCATION OF SITE FIXTURE. CONTRACTOR SHALL VERIFY THE SITE LIGHTING CONTROL IN THE FIELD AND MATCH EXISTING CONTROL. PROVIDE PHOTOCELL SENSOR AS REQUIRED.
4. CONNECT NEW CONDUIT TO EXISTING CONNECTION, VERIFY IN FIELD.
5. REPLACE EXISTING LIGHTING FIXTURES WITH NEW FIXTURES AS AN ADD ALTERNATE PER OWNER, SEE LUMINAIRE SCHEDULE.

Luminaire Schedule								
Symbol	Qty	Label	Arrangement	Description	LLF	Luminaire	Lumens	Total Watts
FL1	1	FL1	Single	ESXF1 ALO SWW2 KY DDB	0.920	5048	34.31	34.31
T	4	T	Single	WPX1 LED P2 40K MVOLT DDBXD	0.920	2913	24.42	97.68
G	9	G	Single	LA844 FR CPS30W18 T3 40K WM5161	0.250	1983	24.4	219.6
SL5	2	SL5	Single	RSX2 LED P4 40K R5 / 20FT POLE	0.920	25663	189.54	379.08

Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
CalcPts_1	Illuminance	Fc	0.29	5.3	0.0	N.A.	N.A.
PARKING	Illuminance	Fc	0.82	2.9	0.0	N.A.	N.A.

BUILDING ADDITION & RENOVATION TO SHERIDAN PUBLIC LIBRARY

103 W. 1ST ST., SHERIDAN, INDIANA 46069

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF DESIGN-AIRE ENGINEERING, INC. AND ARE NOT TO BE USED OR REPRODUCED IN WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF DESIGN-AIRE ENGINEERING, INC.

©Copyright 2016, Design-Aire Engineering, Inc.
Project number 25138
Date 01.15.26
Drawn by DAE
Checked by WJS
Designed by DAE

E302

SITE POWER
PLAN

DAE
DESIGN-AIRE ENGINEERING, INC.
2707 RAND ROAD
INDIANAPOLIS, INDIANA 46241
voice (317) 464-9690
fax (317) 464-9339
Email: dae@designaireengineering.com
www.designaireengineering.com
Mechanical, Electrical, and Energy Engineering