

ADDENDUM #1

August 21, 2026

Leonard Park Playground Improvement Project
Town of Speedway, Indiana

Kieser Consulting Group, LLC.
6801 Lake Plaza Drive, Suite D-401
Indianapolis, Indiana 46220

TO ALL PLAN HOLDERS OF PROCUREMENT DOCUMENTS

This Addendum forms a part of the Contract Documents and modifies the original documents dated August 2026. Bidder shall acknowledge receipt of this Addendum in the space provided on the BID Form. Failure to do so may subject the bidder to disqualification.

Add the attached section, “Section 00210 – Supplementary Instruction to Bidders” to the Project Manual in its stated numerical sequence.

1. Contractor Questions and Answers

The following exhibit includes clarifications to contractor questions.

2. Revised Plan Sheets

The following sheets are revised and should replace the previously issued plan sheets, sheets 102 and 103.

3. Additional Specifications

Turf and Playground Manufacturer Specifications included for reference.

SECTION 00210

SUPPLEMENTARY INSTRUCTION TO BIDDERS

PART 1 – GENERAL

1.1 SPECIAL BID SUBMITTAL INSTRUCTIONS

- A. This Section includes instructions to Bidders regarding contractor questions, updates to plan sheets and manufacturer specifications for turf surface.

PART 2 – PRODUCTS (NOT USED)

PART 3 – EXECUTION

A. Contractors Questions:


- a. Question 1: When is the project proposed for completion?
 - i. Answer: The intent is to complete the project within the Contract Time and by the end of 2026. Synthetic turf installation is subject to the manufacturer's weather and temperature limitations. If acceptable installation conditions cannot be achieved within the Contract Time, completion of the turf installation will be addressed in accordance with the Contract Documents.
- b. Question 2: Is state design release required for the shelter/sun shade? If so who is responsible.
 - i. Answer: Yes. A State Design Release is required for the proposed shade structure. The Engineer will coordinate the State Design Release.
- c. Question 3: Is the project tax exempt?
 - i. Answer: Yes.
- d. Question 4: Is the new turf subbase concrete or stone? Are underdrains required?
 - i. Answer: Turf subbase will be compacted stone. See updated plan sheets in this addendum for more detail. A 4-inch perforated underdrain with filter sock is being added to the site contractors scope. The #53 stone subbase for the turf will be provided by the playground supplier. An additional 4 inches of excavation and placement of 4 inches of #8 stone shall be a part of this project. That work will be followed by 4 inches of #53 aggregate installed by the turf installer. Excavation depth is based on fall height requirement and required surface depth. See plan for more detail of the turf cross section.
- e. Question 5: What is the existing subbase?
 - i. Answer: The existing playground surfacing is understood to have a stone subbase; however, the composition, depth, and condition of the existing stone have not been verified. New base materials shall be provided as indicated on the revised plans.

- f. Question 6: Is the turf install temperature dependent?
 - i. Answer: Yes. Please see the manufacturer specification for more detail. Specifications are attached to this addendum. See section 1.06.
 - g. Question 7: Is turf proposed for the amphitheater?
 - i. Answer: No turf is proposed for the amphitheater. That note will be deleted and an updated plan sheet will be issued as a part of this addendum.
 - h. Question 8: Please provide more information about the “New Landscape Area”.
 - i. Answer: The new landscape area involves two new curb sections and making sure the landscape area is filled with clean dirt. See the updated sheet 103 for a curb detail. No mulch or landscaping is planned as a part of this project. The current curb location is too close to the equipment, so it needs to be reconstructed to be outside of the fall zone.
 - i. Question 9: What will the turf border be attached to?
 - i. Answer: Existing concrete border will be utilized for turf anchor except where new curb is indicated on the revised plans.
 - j. Clarification 1: Landscape Area Removed and Sidewalk Repair: Where an existing landscape area is indicated on the revised plans to be removed and replaced with sidewalk, the area shall be filled in with 4-inch-thick concrete sidewalk in accordance with the detail provided on the revised plans. This work is included in the Site Contractor's scope. This requirement also applies to sidewalk removal and replacement necessary for installation of the underdrain outfalls.
- B. Revised Plan Sheets (See Attached)
- a. Sheet 102 – Removal of the existing sun shades added to demo plan. Concrete under the sun shades is to remain. This is added to the site contractors scope.
 - b. Sheet 103
 - i. Turf - No turf in amphitheater.
 - ii. Turf - Stone base indicated for new turf. 4-inch perforated underdrain with filter sock is added. No concrete base for the turf.
 - iii. Concrete Curb - Curb detail added with dimensions.
 - iv. Concrete Curb - New curb locations identified.
 - v. Underdrain – Added to plan with outfall locations. This is added to the site contractors scope.
- C. Additional Specifications for Reference
- a. Manufacturer Specification for Turf Surface (See Attached)

CONCRETE SIDEWALK DETAIL
(NO SCALE)


SIDEWALK JOINT DETAIL
(NO SCALE)

NOTE:
ALL EQUIPMENT TO BE INSTALLED PER
MANUFACTURER'S INSTRUCTIONS BY A
QUALIFIED INSTALLER.

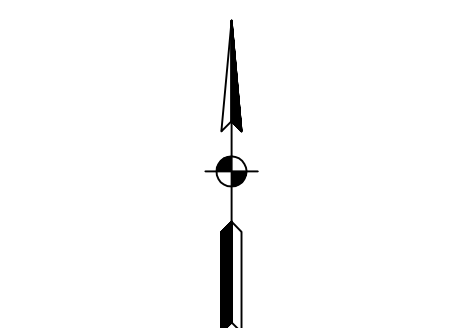

6" CONCRETE CURB DETAIL


(NO SCALE)

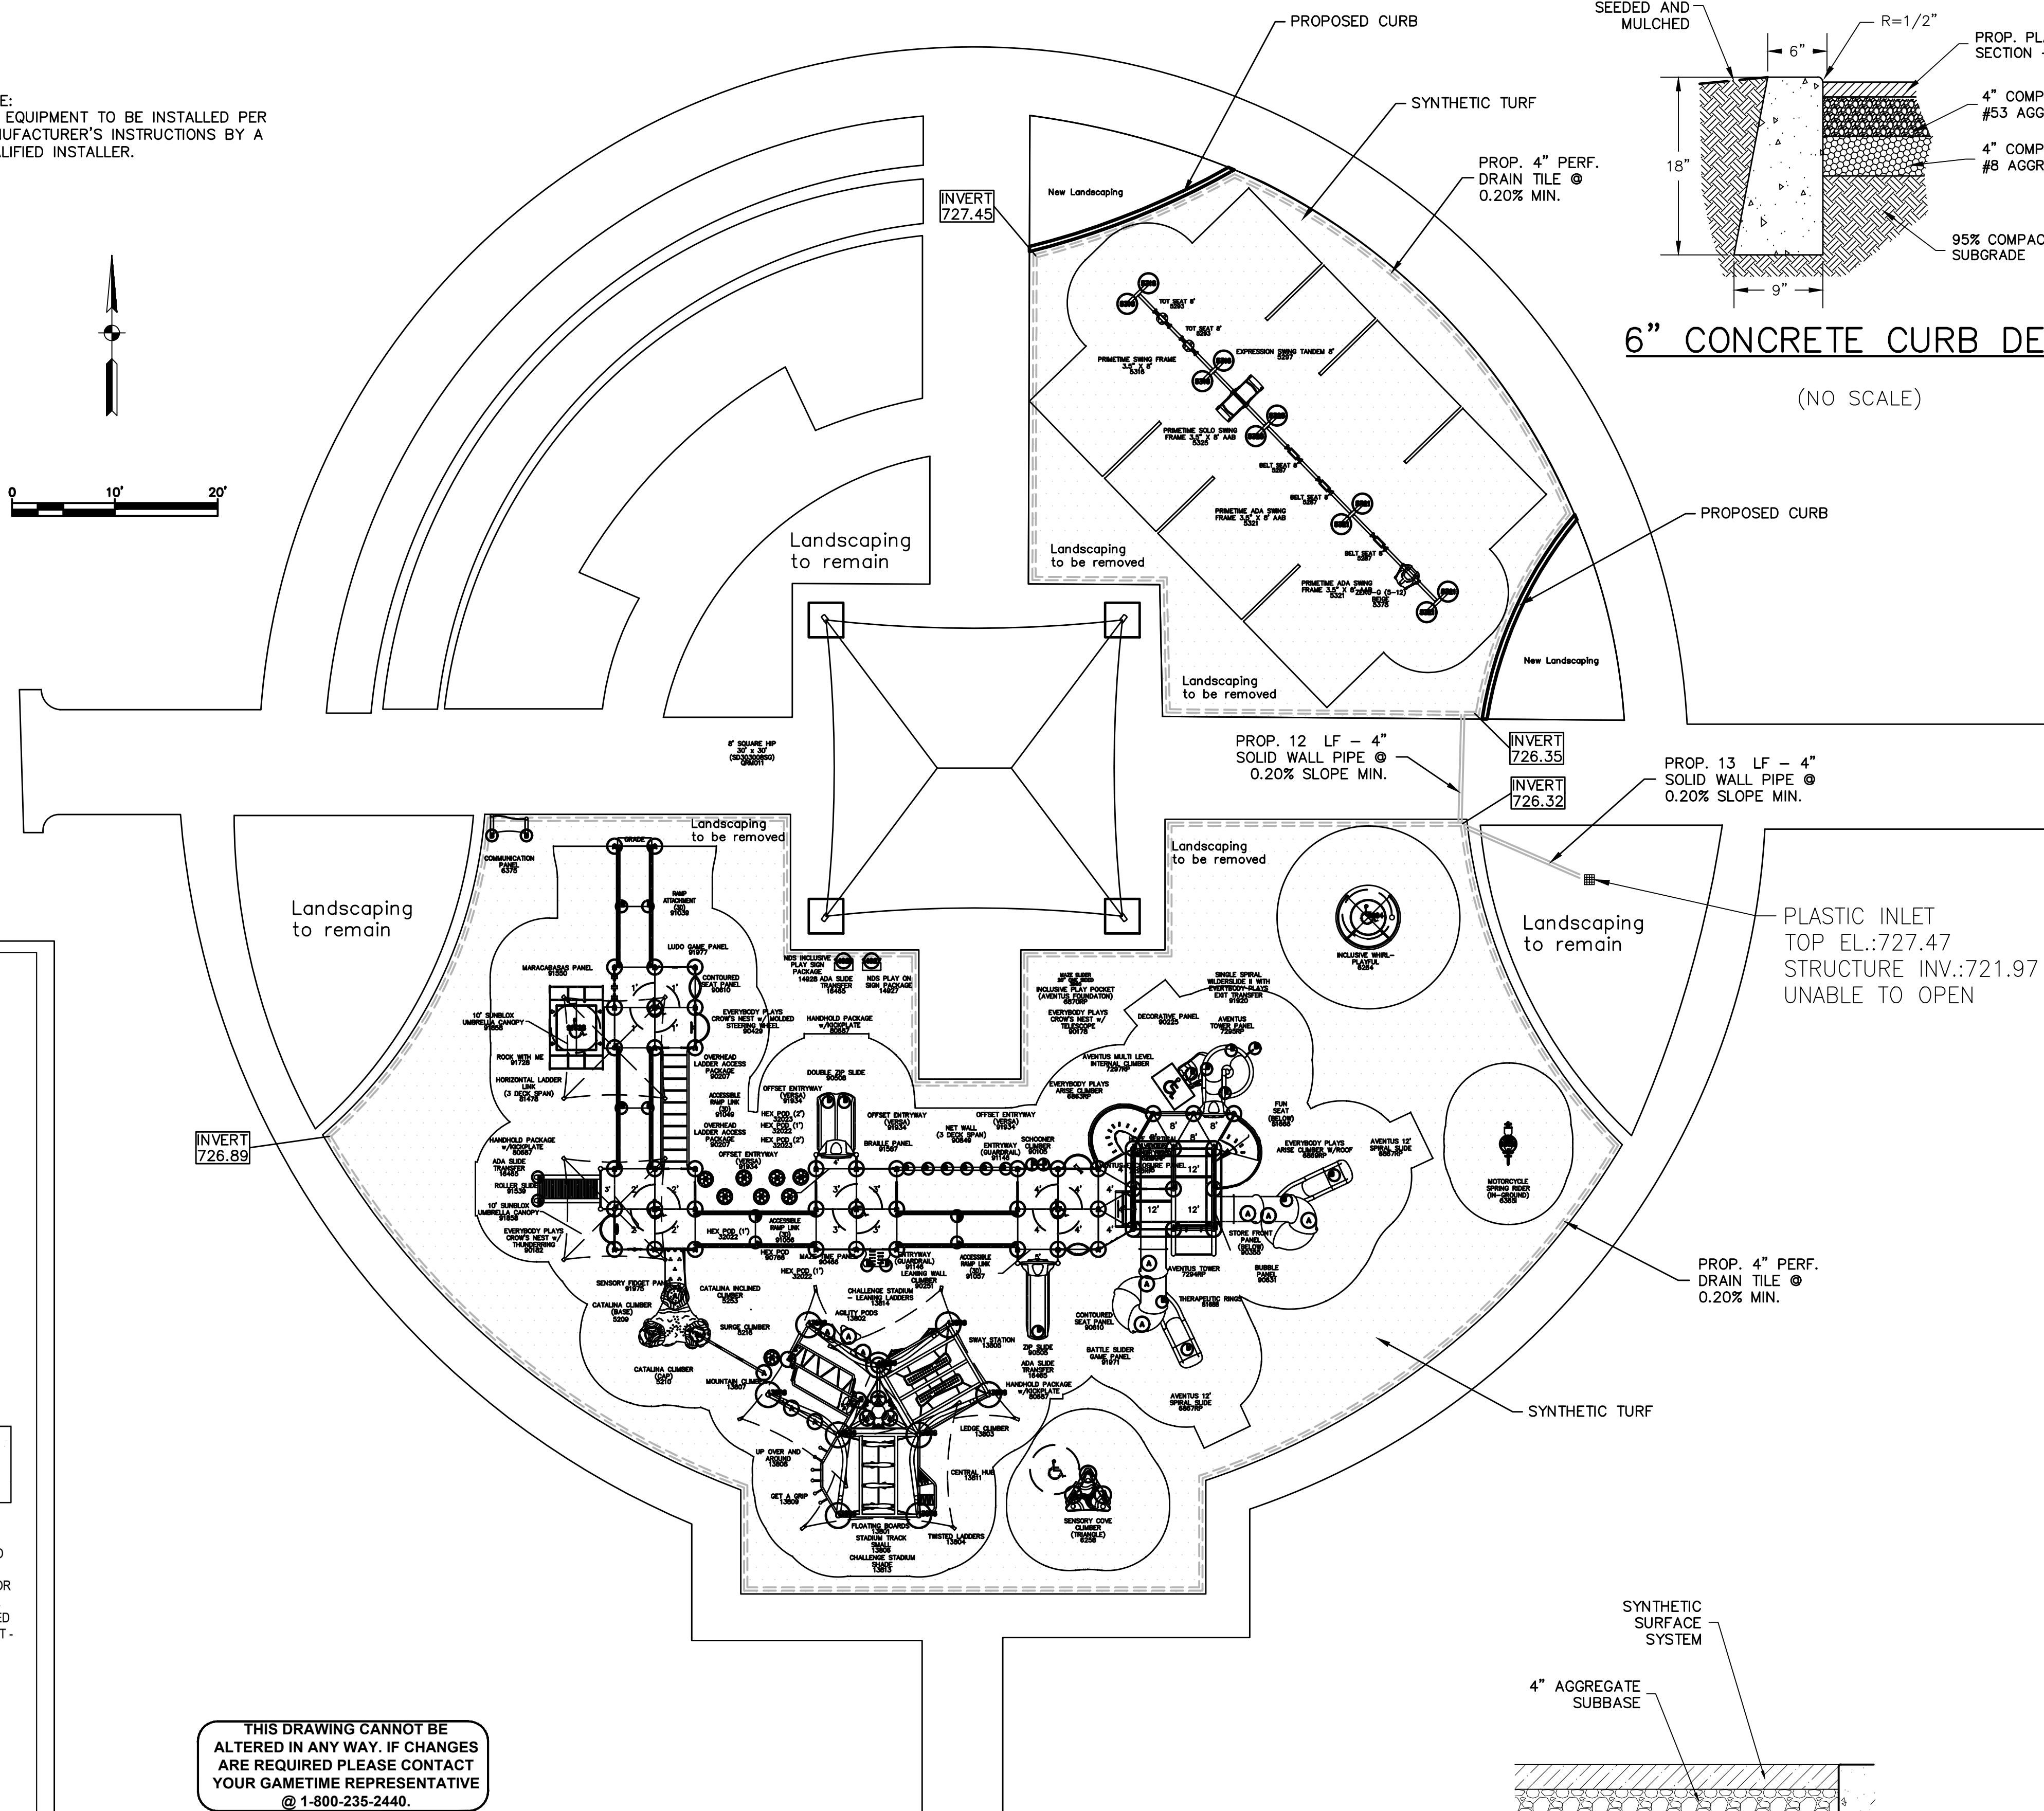

PERIMETER DRAIN DETAIL
(NO SCALE)

SECTION VIEW

- NOTES:
1. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
 2. DO NOT SCALE DRAWING.
 3. THIS DRAWING IS INTENDED FOR USE BY ARCHITECTS, ENGINEERS, CONTRACTORS, CONSULTANTS AND DESIGN PROFESSIONALS FOR PLANNING PURPOSES ONLY. THIS DRAWING MAY NOT BE USED FOR CONSTRUCTION.
 4. ALL INFORMATION CONTAINED HEREIN WAS CURRENT AT THE TIME OF DEVELOPMENT BUT MUST BE REVIEWED AND APPROVED BY THE PRODUCT MANUFACTURER TO BE CONSIDERED ACCURATE.
 5. CONTRACTOR'S NOTE: FOR PRODUCT AND COMPANY INFORMATION VISIT www.CADdetails.com/info AND ENTER REFERENCE NUMBER 5248-078.



GTIMPAX TURF SYNTHETIC GRASS

5248-078
PROTECTED BY COPYRIGHT ©2025 CADDDETAILS.COM LTD.


REVISION DATE 17/03/2025

TYPE	DIAMETER/SIDE	DEPTH*	QTY
A	1'-6" [45.72cm]	2'-6" [76.20cm]	69
B	1'-2" [35.56cm]	2'-6" [76.20cm]	36
N	1'-6" [45.72cm]	3'-6" [106.68cm]	11

*DEPTH IS MEASURED FROM FINISHED GRADE

NOTE:
ON NON-LETTERED HOLES, TO ENSURE
CONCRETE REQUIREMENTS PLEASE REFER TO
EACH COMPONENTS INSTALLATION SHEETS.

IF COMPACTED STONE IS REQUIRED BELOW
SUBGRADE, PLEASE CONTACT GAMETIME
FOR CUSTOM FOOTER DETAILS.

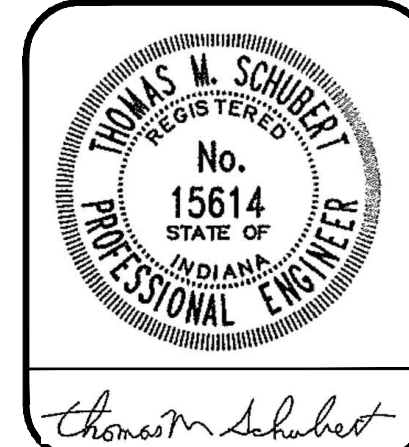[illegible]

**LEONARD PARK
PLAYGROUND RENOVATION**

TOWN OF SPEEDWAY, INDIANA

PROPOSED EQUIPMENT LAYOUT

PLAN DATE:		
8/6/26		
CHECK:	DRAWN:	FIELD:
DK	RS	
DWG FILE:		
PROJ-FILE PATH:		
PROJECT NO.		
N/A		
DRAWING NO.		
C103		

PLAYGROUND RESILIENT SURFACING PLAY PLUS SYNTHETIC TURF

PART 1 – GENERAL

1.01 WORK

- A. Furnishing, delivery, installation, and warranty of a complete synthetic turf system, including drainage, synthetic turf, and resilient infill material.

1.02 ATTENUATION CUSHION LAYER

See Section 2.03

1.03 REFERENCES

- A. ASTM Standard Test Methods
- **F1292** - Standard specification for Impact Attenuation of Surfacing Materials within the Use Zone of Playground Equipment.
 - **F1951** - Standard Specification for Determination of Accessibility of Surface Systems under and around Playground Equipment.
 - **D1577** - Standard Test Method for Linear Density of Textile Fiber
 - **D5848** - Standard Test Method for Mass Per Unit Area of Pile Yarn Floor Covering
 - D418-Standard Test Method for Testing Pile Yarn Floor Covering Construction
 - **D1338**- Standard Test Method for Tuft Bind of Pile Yarn Floor Coverings
 - **D1682** - Standard Method of Test for Breaking Load and Elongation of Textile Fabrics
 - **D5034** - Standard Test Method of Breaking Strength and Elongation of Textile Fabrics (Grab Test)
 - **F1551** - Standard Test Methods for Water Permeability
 - **D2859** - Standard Test Method for Ignition Characteristics of Finished Textile Floor Covering Materials
 - **F355** - Standard Test Method for Shock-Absorbing Properties of Playing Surfaces
 - **D1557** - Test Method for Laboratory Compaction Characteristics of Soil Using Modified Effort.

- B. STC Suggested Guidelines for the Essential Elements of Synthetic Turf Systems
- C. IPEMA Certification: Manufacturer must provide proof of certification. In the interest of public playground safety, IPEMA provides an independent laboratory which validates a manufacturer's certification on conformance to ASTM F1292.

1.04 PROJECT CONDITIONS

- A. Coordinate all work with the work of other sections to avoid delay and interference with other work.
- B. Protect excavations by shoring, bracing sheeting, underpinning, or other methods as required to prevent cave-ins or loose dirt from entering excavations. Barricade open excavations and post warning lights at work adjacent to public streets and walks.

1.05 SITE INSPECTION

- A. The inspection shall include a check for planarity. The finished surface shall not vary from a true plane more than 0.25" in 10' when measured in any direction. The Contractor shall provide all required tools and materials needed for the planarity check, which may include but not be limited to, a laser level, string line, straight edge and/or other assessment materials. The Contractor shall mark in the field any deviations from grade in excess of those specified above, as well as provide a marked-up plan locating the deviations. The Contractor shall correct any deviations to the satisfaction of the Engineer and Synthetic Turf Installer.
- B. The compaction of aggregate base shall be 95% to Standard Proctor and surface tolerances shall not exceed 0.25" over 10'.
- C. The Contractor shall have a state registered surveyor conduct an elevation survey of the area in a 25' grid to determine and verify that subgrade elevations and slopes are within previously specified tolerances. This elevation survey may require further verification of smaller areas within the 25' grid if determined necessary by the Engineer.
- D. When any or all corrective procedures have been completed, the finished sub-base surface must be re-inspected, with the same representatives attending as the initial inspection. If required, additional repair and inspections are to be conducted until the sub-

base surface is deemed acceptable by the Engineer and Synthetic Turf Installer

- E. Once the sub-base surface has been deemed acceptable, the Contractor shall submit a written certificate indicating the acceptance of:
 - 1. The sub-base construction finished surface as totally suitable for the application of the selected synthetic turf system, and
 - 2. The sub-base construction as totally suitable for work under this section to proceed with the final installation and fully warrant the turf surface installation for the period and conditions specified herein.
- F. Commencement of work under this section shall constitute acceptance of the work completed under other sections by the Contractor, acceptance of dimensions of the sub- base, and hence, no claims for extra work based upon these conditions will be permitted.

1.06 ENVIRONMENTAL CONDITIONS

- A. Install synthetic turf surfacing only when ambient air temperature is 50° F and rising or above and the relative humidity is below 35% or as specified by the product manufacturer. Installation will not proceed if rain is imminent.
- B. Install product only when prepared base is suitably free of dirt, dust, and petroleum products, is moisture free and sufficiently secured to prevent unwanted pedestrian and vehicular access.
- C. Maintain all benchmarks, monuments, and other reference points. If disturbed or destroyed, replace as directed.
- D. Adjacent streets, sidewalks, and property shall be kept free of mud, dirt, or similar nuisances resulting from earthwork operations.

1.07 QUALITY CONTROL

- A. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section. All rights reserved. All information contained is subject to change.

Manufacturer: ITS - Sprinturf

- 1. Materials other than those listed must be approved 30 days prior by written addendum. Materials from non-approved manufacturers will not be accepted.
- 2. Must be experienced in the manufacturing of tall-pile synthetic infill turf systems with the same fiber as specified.

3. Manufacturer must be a member in good standing with the STC.
4. Manufacturer must utilize best practices as certified by ISO-9001.
5. Manufacturer must be owned and operated in the U.S.A.
6. Manufacturer must have no periods of insolvency over the last 25 years.

B. **Installer Qualifications:** Company specializing in performing the work of this section.

1. The Synthetic Turf Installer must provide competent workmen skilled in this type of synthetic turf installation. All technicians must have installed similar synthetic turf.
2. Prior to the beginning of installation, the Synthetic Turf Installer shall inspect the subbase. The installer will accept the sub-base in writing when the general contractor provides test results for compaction, planarity and permeability that are in compliance with the synthetic turf manufacturer's recommendations and as stated herein.
3. Remove defective work, whether the result of poor workmanship, defective products or damage, which has been rejected by the Engineer as unacceptable. Replace defective work in conformance with the contract documents.

1.08 SUBMITTALS

Submit the following with Proposal:

1. Submit the exact product name/description as well as the name and location of the manufacturers and suppliers of each component. Manufacturers and suppliers must not be changed after the contract is awarded unless approved by the Owner in writing.
2. Submit two samples, 12"x12" minimum size, illustrating details of finished product as bid, including full cross section of sub-base, turf, and infill material.
3. Product Literature: Submit two copies of manufacturer's recommended installation and maintenance information, including any technical criteria for evaluation of the installed product. Descriptions of all equipment recommended for the maintenance and repair of turf product, as well as a list of any activities not recommended relative to the warranty.
4. Submit a 1-lb sample of the selected bid infill material(s).
5. A letter and specification sheet certifying that the products of this section meet or exceed specified requirements.

6. Certified copies of independent (third-party) laboratory reports on ASTM tests as follows:
 - a. Pile Height, Face Width & Total Fabric Weight, ASTM D418 or D5848
 - b. Primary & Secondary Backing Weights, ASTM D418 or D5848
 - c. Tuft Bind, ASTM D1335
 - d. Grab Tear Strength, ASTM D1682 or D5034
7. ASTM test submittals may vary by no more than 5% of the specified product to bid. Bid winner must show NEW ASTM TESTS with contract submittals.
8. Name and experience of the designated supervisory personnel assigned to this project shall be submitted with the proposal. Changes to this assignment after contract can only be made if approved in writing by the Owner. Include a listing of other on-site personnel and their experience.
9. The Synthetic Turf Installer and Turf Manufacturer shall provide evidence that the turf system does not violate any other manufacturer's patents, patents allowed or patents pending.
10. Provide certificates of compliance for FireFly Sports Testing certification verifying manufacturer's certification of conformance to EPA 1633, EN71-3, ASTM F3496-Details:
 - a. PFAS Testing EPA Method 1633 (Revision A – December 2024): Required PFAS test for all solid materials.
Note: Must be used in place of outdated water-extraction PFAS methods.
 - b. Element Migration (Heavy Metals) EN 71 3 – Migration of Certain Elements
 - c. Testing for 19 restricted elements under simulated gastric conditions.
 - d. Polyaromatic Hydrocarbons (PAH) ASTM F3496 – PAH content in synthetic turf infill and other surface materials as adapted.

1.09 WARRANTY

- A. The Contractor shall provide a minimum wear policy provided by the manufacturer, against defects in materials, and one year against defects in the workmanship. An eight (8) year warranty on materials is provided by the manufacturer; for complete terms, limitations, and conditions, refer to the full warranty document attached to this specification.

- B. Warranty shall be for full replacement of any damaged product within the warranty period. This is subject to reparability. Warranty shall be comprehensive and sufficient to replace all turf if necessary.
- C. Warranty shall become effective from the date of substantial completion.
- D. Warranty shall contain no usage limits for warranted turf.
- E. Submit Manufacturer Warranty and ensure that forms have been completed in Owner's name and registered with Manufacturer.

PART 2 PRODUCTS

2.01 SUPPLIER QUALIFICATIONS

- A. The Owner has conducted an extensive review of synthetic turf products, including visiting installed sites and review of other agencies' review criteria. Based upon their research, they have established the following criteria for acceptance of a synthetic turf product. No variation from these criteria shall be allowed. The Owner's review is considered final.
- B. The Synthetic turf installer shall have minimum experience of at least five years, actively selling, installing and maintaining in-fill synthetic turf project of similar size.
- C. The Synthetic turf installer must provide a list of references based on previous installations.
- D. Installation team shall be established, insured installation firm experienced as a premium turf installer with suitable equipment and supervisory personnel, with a minimum of 5 years' experience with 15-foot-wide tufted materials.

2.02 TURF SYSTEM

- A. **Turf Fiber:**
 - 1. The turf fiber must be tufted to the backing with a minimum tuft bind of 8 pounds.
 - 2. The tufted fiber weight shall be a minimum of 65 ounces per square yard.
 - 3. The turf fiber shall be non-abrasive and a minimum of 100 microns thick for slit tape fibers and 350 microns thick for the monofilament fiber.
 - 4. The turf fiber must contain less than 100 ppm of lead chromate in all colors.
 - 5. The turf fiber systems must be from the same dye lots.
 - 6. The turf fiber must retain a minimum of 75% of its original fibril width after 10,000 cycles on the Lisport Studded Roll Test Machine.

7. The pile fiber shall possess the following characteristics:

Characteristic	Value	Test
Linear Density (Denier)	Slit Film: 5,500, Monofilament: 12,000	ASTM D 1577
Yarn Thickness	Slit film: 120 microns, Monofilament: 270 microns	ASTM D 3218
Tensile Strength	71 N (PE Mono);16 N (PE)	ASTM D 2256
Pile Weight*	65 oz./yd2	ASTM D 5848
Fiber manufacturer must be from the same source		

The above specifications are nominal. *Values are +/-5%.

9. The pile fabric shall possess the following physical characteristics:

Characteristic	Value	Test
Finished Pile Height*	1.25" (41.275mm)	ASTM D 5823
Product Weight (total)*	93oz./yd2	ASTM D 3218
Primary Backing Weight*	8.0oz./yd2	ASTM D 2256
Secondary coating Weight**	20oz./yd2	ASTM D 5848
Fabric Width	15' (4.57m)	ASTM D 5793
Tuft Gauge	3/8"	ASTM D 5793
Grab Tear Strength	350-lb-F	ASTM D 5034
Tuft Bind	>8-lb-F	ASTM D 1335
Infill (Sand)	3 lbs. antimicrobial-coated Silica Sand	None

Except where noted as a minimum, the above specifications are nominal.

*Values are +/-5%. **All values are +/-3 oz./yd2.

B. Backing Material

A. Primary Backing:

- Primary backing must be a dual layered woven polypropylene material.
- Primary backing system weight must be a minimum of 8.0 ounces/square yard.

B. Secondary Backing:

- Secondary backing system weight must be a minimum of 20 ounces/ square yard.
- Secondary backing shall saturate the primary backing and effectively lock the fiber tufts in place to the primary backing.

- iii. Secondary backing must be a heat activated polyurethane coating.
- iv. Secondary backing system shall have minimum tuft bind strength of 8 pounds.
- v. Secondary backing must have ProFlow technology without perforations, allowing the product to drain through any point in the backing.
- C. **Turf roll seams:** to be sewn or glued on site so that no openings larger than the porous backing mat openings are created. All turf fabric edges to be securely bound as per the perimeter detail design. Adhesives for joining seams of turf together shall be Mapei 1K Glue. No substitutions.
- D. **Fabric surface:** shall be constructed and installed in minimum widths of 15 feet with no longitudinal or transverse seams.
- E. The entire system shall be resistant to weather, including ultra-violet light and heat degradation; insects, rot, mildew and fungus growth and be non-allergenic and non-toxic.
- F. The turf material shall be non-combustible and pass the DIN standard pill burn test or ASTM D2859.

2.03 ATTENUATION CUSHION LAYER SECTION

- A. Cushion layer to be Brock Pad or SBR/Chunk base
- B. Brock Pad Underlayment System
 - 1. General Requirements for Underlayment System – An impact energy absorbing sub-base drainage system designed specifically for use with synthetic turf is required. The specified material must have physical, drainage and performance properties that meet the following requirements:
 - 2. Minimum material nominal thickness 50.8 mm (2") – material thickness must be within ± 2 mm (± 0.08 ")
 - 3. Tensile Strength >50 psi (ASTM D3575)
 - 4. Tensile Elongation >10% (ASTM D3575)
 - 5. Compression Strength >20 psi @ 25% strain (ASTM D3575)
 - 6. Water Permeability >1500 in/hr (EN 12616:2013)
 - 7. Water Absorption $\leq 1\%$ after 24 hrs (ASTM C272)
 - 8. Linear Thermal Expansion < 0.10 mm /m /°C (ASTM D696)
 - 9. Flammability Flame Spread < 100 mm /min. (FMVSS 302)
 - 10. Resistance to Chemicals ≤ 2 (ASTM F925)
 - 11. Resistance to Acid and Alkaline Liquids 0% tensile strength loss

- after 100-year model (EN 14030:2010 / ISO 12960:1998)
12. Resistance to Accelerated Aging (Oxidation) <10% tensile strength loss after 100-year model of 56 days at 110oC (ISO 13438:2004)
 13. Resistance to Bacteria - no growth (ASTM G22)
 14. Resistance to Fungi - no growth (ASTM G21)
- C. Optional impact attenuation cushion layer consists of recycled styrene butadiene rubber (SBR) adhered with a 100% solids polyurethane binder to form a resilient porous material.
1. Strands of SBR may vary from 0.5 mm – 2.0 mm in thickness by 3.0 mm – 20 mm in length.
 2. SBR Crumb Rubber (5-9 Mesh) using sieve analysis ASTM D5644 with a fiber content of .1% or less mixed in.
 3. SBR homogeneous rubber pellets derived from rubber powder reclaimed from end of use tires are also acceptable. Genan brand Pellets 3.8/35.
 4. Binder shall be min. 12% of the total weight of the material and shall provide 100% coating of the particles.
 5. The attenuation cushion layer shall meet the requirements herein for impact attenuation.

2.04 SYNTHETIC GLUE MATERIAL

- A. Adhesive products shall be Mapei 1K glue.
- B. Any adhesive products required for the installation of a proposed turf system shall be purpose-suited to the system. The material and application methods shall be as recommended by the adhesive manufacturer.
- C. Disposal of adhesive containers and unused adhesives as well as any fees resulting from such disposal shall be the responsibility of the Contractor.

2.05 INFILL MATERIAL

- C. The synthetic infill material shall consist of a blend of Antimicrobial Coated Silica Sand, ceramic coated silica sand.
1. **Antimicrobial Coated Sand:** infill for synthetic/artificial turf this



product consists of silicon dioxide coated with an acrylic polymer.

HAZARDS DISCLOSURE: This product does not contain known hazardous materials in reportable levels as defined by the OSHA Hazard Communication Standard 29 CFR 1910.1200. This product should be classified as NOT being toxic, corrosive, skin/eye irritants, or a strong sensitizer as defined in 16 CFR 1500.3(b)(5), and 1500.3(b)(7)- (9) of the Federal Hazardous Substances Act.

- (a) Color - green,
- (b) Odor - Odorless
- (c) pH-value - Not applicable.
- (d) Change in condition - Melting point/Melting range: 1713 °C (3115 °F); Boiling point/Boiling range: 2230 °C (4046 °F)
- (e) Flash point - None
- (f) Flammability (solid, gaseous) - Product is not flammable.
- (g) Ignition temperature - Decomposition temperature - Not determined.
- (h) Auto igniting - Product is not self-igniting.
- (i) Danger of explosion - Product does not present an explosion hazard.
- (j) Explosion limits - Lower - Not determined; Upper - Not determined.
- (k) Vapor pressure@ 1732 °C (3150 °F) - 13.5 hPa (10 mm Hg); Density@20 °C (68 °F) - 2.9-3.1 g/cm³ (24.201-25.87 lbs/gal); Bulk density- 110 (lbs per cu ft); Relative density - Not determined; Vapor density - Not applicable.
- (l) Evaporation rate - Not applicable
- (m) Solubility in/ Miscibility with: Water – Insoluble
- (n) Partition coefficient (n-octanol/water) - Not determined
- (o) Viscosity: Dynamic - Not applicable; Kinematic - Not applicable
- (p) Solvent content: Organic solvents - 0.0 %; Solids content - 100.0 %
- (q) Other information: No further relevant information available.

PART 3 EXECUTION

3.01 GENERAL

- A. Installation of the synthetic turf system is to comply with the Manufacturer's recommendations,

requirements and the reviewed and approved shop drawings.

- B. Perform all work in strict accordance with the contract documents and the manufacturer's specifications and instructions. Only those skilled technicians proposed in the bid phase are to be assigned to this project by the Contractor.
- C. The designated Supervisor for the Synthetic Turf Installer must be present during any and all construction activity associated with the field installation, including testing, cleanup and training.
- D. All products and equipment are to be from sources approved by the authorized turf manufacturer and conform to the specifications.

3.02 PRODUCT DELIVERY, STORAGE & HANDLING

- A. Deliver products to site in original containers and wrappers as agreed between the Engineer and Contractor. Inspect products upon delivery for damage.
- B. Store products in a location and in a position, that protects them from crush damage or any other defects.
- C. Handle and store (on and off site) all materials safely to ensure their physical properties are not adversely affected and that they are not subject to vandalism or damage.
- D. Infill shall arrive dry and loose.
- E. Adhesives shall arrive in dry, sealed containers.

3.03 SUB-BASE TYPES AND DETAILS

Sub-Base Requirements: The base shall have the specific minimum slope (2%) and shall vary no more than .125" when measured in any direction with a 10' straight edge.

STONE: The density requirement is 90% to 95% compaction with final condition of stone as level and stable so as not to shift when traveled on or during surface installation process. A compaction test is required and must be submitted to GTImpax prior to installation of turf surfacing.

Failure to provide proof of compaction test will void the five- year warranty of Turf Surfacing should a sub-base failure occur.

DEPTH: 4" minimum thickness



SLOPE: Stone elevation shall maintain .25" per foot towards low end

POROSITY: Base course shall maintain porosity for direct drainage

ENCLOSURE: Stone base course must be surrounded by a retaining curb

DRAINAGE: Subsurface drainage is recommended under and around stone base. Perforated pipe or similar system is acceptable.

TOLERANCES: .25" in any 10' direction and .125" in and 3' direction.

STONE SELECTION: It is critical that different size stones are used so that the base shall be uniformly mixed. The material shall be wetted during mixing operations if necessary, for proper blending.

<u>STONE GRADUATION:</u>	<u>U.S. SIEVE</u>	<u>PERCENT PASSING</u>
	1"	100%
	3/4"	90-100%
	No. 4	35-60%
	No. 30/10	30%
	No. 200	2-9%

FINISH LAYER: In the event turf is going directly over the aggregate, a finishing layer of 1" - 1.5" compacted Decomposed Granite (DG) over the aggregate is highly recommended.

CONCRETE or ASPHALT: Concrete should be finished with a medium broom finish. All new concrete slabs must cure for a minimum of seven days prior to installation. Asphalt cure time requires fourteen days. Once the new asphalt has cured, it must be pressure washed prior to the surfacing being installed. The concrete contractor shall be responsible for flooding the pad to insure proper slope and tolerance. Any areas holding enough water to cover a flat nickel shall be patched prior to arrival of turf installation crews.

DEPTH: 4" minimum thickness

SLOPE: Concrete or Asphalt shall maintain a .25" per foot

TOLERANCE: Concrete must maintain a tolerance of .125" in 10' to avoid low areas that will hold water under the turf.

a. Thermal stability: <2%

3.04 TURF INSTALLATION

- A. Install synthetic turf system in accordance with the Manufacturer's written installation instructions.

- B. Turf shall be attached to the perimeter edge as shown in the construction plans and as per the manufacturer.
- C. All seams shall be brushed thoroughly before infill materials are installed.
- D. All terminations shall be as detailed and approved in the shop drawings.

3.05 INFILL INSTALLATION

- A. The synthetic turf shall be thoroughly brushed prior to installation of infill materials to remove wrinkles.
- B. Turf shall remain free draining at all times before, during and after the infill materials are installed.

3.06 MATERIAL

Playground Synthetic

Turf Manufacturer:

ProGreen Synthetic Turf (855) 464-8873

Location used:

Playground Area

3.01 CLEANING AND COMPLETION

- A. Protect all installed work from other construction activities as installation progresses.
- B. The Contractor shall keep the area clean throughout the construction period and free from the installation process, including track surfaces.
- C. Upon completion of the installation, thoroughly clean surfaces and site of all refuse resulting from the installation process, including track surfaces.
- D. Any damage to existing fixtures or facilities resulting from the installation of the synthetic turf system shall be repaired to original condition at the Contractor's expense prior to substantial completion and commencement of the warranty period.
- E. A deficiency list will be produced by the Engineer at the conclusion of the project. All installation project deficiencies not in dispute must be remedied by the Contractor prior to the issuance of a certificate of substantial completion.



- F. Contractor to provide a written acceptance that the turf and base system is installed in accordance with their recommendations prior to final completion.

End of Document